

SECTION 00 9111 - ADDENDUM NUMBER 1

PARTICULARS

1.01 DATE: MAY 22, 2015

1.02 PROJECT: UNIVERSITY OF SOUTH CAROLINA SCHOOL OF MEDICINE BUILDING 1 MICROSCOPY LAB UPGRADES

1.03 PROJECT NUMBER: STATE PROJECT #H27-6106, A/E #14054.01

1.04 OWNER: UNIVERSITY OF SOUTH CAROLINA

1.05 ARCHITECT: GMK ASSOCIATES, INC.

TO: PROSPECTIVE BIDDERS :

2.01 THIS ADDENDUM FORMS A PART OF THE CONTRACT DOCUMENTS AND MODIFIES THE BIDDING DOCUMENTS DATED 5/12/2015 , WITH AMENDMENTS AND ADDITIONS NOTED BELOW.

2.02 ACKNOWLEDGE RECEIPT OF THIS ADDENDUM IN THE SPACE PROVIDED IN THE BID FORM. FAILURE TO DO SO MAY DISQUALIFY THE BIDDER.

2.03 THIS ADDENDUM CONSISTS OF 2 PAGES AND THE FOLLOWING ATTACHMENTS:

- A. Pre-Bid Meeting attendance sign in sheets
- B. SE-330 LUMP SUM BID FORM
- C. SPECIFICATION 26 0500 - General Electrical Requirements
- D. SPECIFICATION 26 0501 - Minor Electrical Demolition
- E. SPECIFICATION 26 0519 - Low-Voltage Electrical Power Conductors and Cables
- F. SPECIFICATION 26 0526 - Grounding and Bonding for Electrical Systems
- G. SPECIFICATION 26 0529 - Hangers and Supports for Electrical Systems
- H. SPECIFICATION 26 0534 - Conduit
- I. SPECIFICATION 26 0537 - Boxes
- J. SPECIFICATION 26 0553 - Identification for Electrical Systems
- K. SPECIFICATION 26 2416 - Panelboards
- L. SPECIFICATION 26 2726 - Wiring Devices
- M. SPECIFICATION 26 5100 - Interior Lighting
- N. DRAWING E2.1

CHANGES TO THE PROJECT MANUAL - INTRODUCTORY REQUIREMENTS, PROCUREMENT REQUIREMENTS AND CONTRACTING REQUIREMENTS :

3.01 SE-330 LUMP SUM BID FORM

- A. Replace SE-330 in its entirety.

3.02 SECTION 26 0500 - GENERAL ELECTRICAL REQUIREMENTS

- A. Add section in its entirety.

3.03 SECTION 26 0501 - MINOR ELECTRICAL DEMOLITION

A. Add section in its entirety.

3.04 SECTION 26 0519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

A. Add section in its entirety.

3.05 SECTION 26 0526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

A. Add section in its entirety.

3.06 SECTION 26 0529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

A. Add section in its entirety.

3.07 SECTION 26 0534 - CONDUIT

A. Add section in its entirety.

3.08 SECTION 26 0537 - BOXES

A. Add Section in its entirety.

3.09 SECTION 26 0553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

A. Add section in its entirety.

3.10 SECTION 26 2416 - PANELBOARDS

A. Add section in its entirety.

3.11 SECTION 26 2726 - WIRING DEVICES

A. Add section in its entirety.

3.12 SECTION 26 5100 - INTERIOR LIGHTING

A. Add section in its entirety.

CLARIFICATIONS

4.01 MAY 27, 2015 AT 2:00 PM IS THE LATEST TIME THAT AN ADDENDUM CAN BE ISSUED.

4.02 ACCESS TO THE SPACE CAN BE SCHEDULED THROUGH THE SCHOOL OF MEDICINE. CONTACT RICK CAMPBELL AT 803-528-8164 TO SCHEDULE ACCESS TO THE SPACE.

4.03 PARKING SPACES WILL BE PROVIDED TO THE CONTRACTOR. COORDINATE WITH THE SCHOOL OF MEDICINE FOR LOCATIONS.

PRE-BID MEETING ATTENDANCE SIGN IN SHEET

5.01 ISSUED AS PART OF THIS ADDENDUM FOR INFORMATION ONLY. SEE ATTACHED.

CHANGES TO THE DRAWINGS:

6.01 DRAWING E2.1

A. Add sheet E2.1 in its entirety.

END OF ADDENDUM NUMBER 1

University of South Carolina - Pre Bid Sign In Sheet
Columbia, South Carolina

Project Name: USC School of Medicine Building 1 Microcopy Lab Upgrades
 Project Number: H27-6106
 Pre Bid Date & Time: May 21, 2015 at 10:00 am

Name	Company Name	Address	Phone #	Email
Steve Bross	First Class Construction LLC	1815 Gervais St. Suite G Columbia, S.C. 29201	803-926-1922	tmeyer@fccn.com sbross@fccn.com
Tony Riccio	GMC ASSOC	1201 MAIN ST SUITE 2100 COL 743 GREEN ST.	83-256000	jrcauld@gtka.com
TERRIE FOSTER	USC		803-777-9946	TFOSTER@usc.sc.edu
Rick Campbell	USC SOM	VA Campus	803-216-3158	rick.campbell@uscmed.sc.edu
Maquana Brooks	USC	743 Greene St.	771.3596	jbrooks@fmc.sc.edu

***By signing this sheet you agree to receive information electronically.

SE-330 LUMP SUM BID FORM

Bidders shall submit bids on only Bid Form SE-330.

BID SUBMITTED BY: _____
(Bidder's Name)

BID SUBMITTED TO: University of South Carolina
(Owner's Name)

FOR: PROJECT NAME: USC School of Medicine Building 1 Microscopy Lab Upgrades
PROJECT NUMBER: H27-6106

OFFER

§ 1. In response to the Invitation for Construction Services and in compliance with the Instructions to Bidders for the above-named Project, the undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into a Contract with the Owner on the terms included in the Bidding Documents, and to perform all Work as specified or indicated in the Bidding Documents, for the prices and within the time frames indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

§ 2. Pursuant to Section 11-35-3030(1) of the SC Code of Laws, as amended, Bidder has submitted Bid Security as follows in the amount and form required by the Bidding Documents:

Bid Bond with Power of Attorney **Electronic Bid Bond** **Cashier's Check**

(Bidder check one)

§ 3. Bidder acknowledges the receipt of the following Addenda to the Bidding Documents and has incorporated the effects of said Addenda into this Bid:

(Bidder, check all that apply. Note, there may be more boxes than actual addenda. Do not check boxes that do not apply)

ADDENDA: #1 #2 #3 #4 #5

§ 4. Bidder accepts all terms and conditions of the Invitation for Bids, including, without limitation, those dealing with the disposition of Bid Security. Bidder agrees that this Bid, including all Bid Alternates, if any, may not be revoked or withdrawn after the opening of bids, and shall remain open for acceptance for a period of **60** Days following the Bid Date, or for such longer period of time that Bidder may agree to in writing upon request of the Owner.

§ 5. Bidder herewith offers to provide all labor, materials, equipment, tools of trades and labor, accessories, appliances, warranties and guarantees, and to pay all royalties, fees, permits, licenses and applicable taxes necessary to complete the following items of construction work:

§ 6.1 **BASE BID WORK** (as indicated in the Bidding Documents and generally described as follows): The project consists of the demolition and replacement of the suspended ceiling system and mechanical diffusers in the microscopy lab, add hot gas reheat to the existing split system heat pum and connect outside air and return to the existing HVAC unit through ductwork modifications.

\$ _____, which sum is hereafter called the Base Bid.

(Bidder - insert Base Bid Amount on line above)

**SE-330
LUMP SUM BID FORM**

§ 6.2 **BID ALTERNATES** as indicated in the Bidding Documents and generally described as follows:

ALTERNATE # 1 (Brief Description): Add new lighting and all electrical components as indicated on sheet E2.1.

ADD TO or **DEDUCT FROM BASE BID:** \$ _____

(Bidder to Mark appropriate box to clearly indicate the price adjustment offered for each alternate)

ALTERNATE # 2 (Brief Description): _____

ADD TO or **DEDUCT FROM BASE BID:** \$ _____

(Bidder to Mark appropriate box to clearly indicate the price adjustment offered for each alternate)

ALTERNATE # 3 (Brief Description): _____

ADD TO or **DEDUCT FROM BASE BID:** \$ _____

(Bidder to Mark appropriate box to clearly indicate the price adjustment offered for each alternate)

§ 6.3 **UNIT PRICES:**

BIDDER offers for the Agency’s consideration and use, the following **UNIT PRICES**. The **UNIT PRICES** offered by **BIDDER** indicate the amount to be added to or deducted from the **CONTRACT SUM** for each item-unit combination. **UNIT PRICES** include all costs to the Agency, including those for materials, labor, equipment, tools of trades and labor, fees, taxes, insurance, bonding, overhead, profit, etc. The Agency reserves the right to include or not to include any of the following **UNIT PRICES** in the Contract and to negotiate the **UNIT PRICES** with **BIDDER**.

<u>No.</u>	<u>ITEM</u>	<u>Unit of Measure</u>	<u>ADD</u>	<u>DEDUCT</u>
<u>1.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>
<u>2.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>
<u>3.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>
<u>4.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>
<u>5.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>
<u>6.</u>	_____	_____	<u>\$ _____</u>	<u>\$ _____</u>

**SE-330
LUMP SUM BID FORM**

§ 7. LISTING OF PROPOSED SUBCONTRACTORS PURSUANT TO SECTION 3020(b)(i), CHAPTER 35, TITLE 11 OF THE SOUTH CAROLINA CODE OF LAWS, AS AMENDED
(See Instructions on the following page BF-2A)

Bidder shall use the below-listed Subcontractors in the performance of the Subcontractor Classification work listed:

SUBCONTRACTOR CLASSIFICATION By License Classification and/or Subclassification <i>(Completed by Owner)</i>	SUBCONTRACTOR'S PRIME CONTRACTOR'S NAME <i>(Must be completed by Bidder)</i>	SUBCONTRACTOR'S PRIME CONTRACTOR'S SC LICENSE NUMBER <i>(Requested, but not Required)</i>
BASE BID		
ALTERNATE #1		
ALTERNATE #2		
ALTERNATE #3		

If a Bid Alternate is accepted, Subcontractors listed for the Bid Alternate shall be used for the work of both the Alternate and the Base Bid work.

SE-330
LUMP SUM BID FORM

**INSTRUCTIONS FOR
SUBCONTRACTOR LISTING**

1. Section 7 of the Bid Form sets forth an Owner developed list of contractor/subcontractor specialties by contractor license category and/or subcategory for which bidder is required to identify the entity (subcontractor(s) and/or himself) Bidder will use to perform the work of each listed specialty..
 - a. **Column A:** The Owner fills out this column, which identifies the contractor/subcontractor specialties for which the bidder must list either a subcontractor or himself as the entity that will perform this work. Subcontractor specialties are identified by contractor license categories or subcategories listed in Title 40 of the South Carolina Code of laws. If the owner has not identified a specialty, the bidder does not list a subcontractor.
 - b. **Columns B and C:** In these columns, the Bidder identifies the subcontractors it will use for the work of each specialty listed by the Owner in Column A. Bidder must identify only the subcontractor(s) who will perform the work and no others. Bidders should make sure that their identification of each subcontractor is clear and unambiguous. A listing that could be any number of different entities may be cause for rejection of the bid as non-responsive. For example, a listing of M&M without more may be problematic if there are multiple different licensed contractors in South Carolina whose names start with M&M.
2. **Subcontractor Defined:** For purposes of subcontractor listing, a subcontractor is an entity who will perform work or render service to the prime contractor to or about the construction site pursuant to a contract with the prime contractor. Bidder should not identify sub-subcontractors in the spaces provided on the bid form but only those entities with which bidder will contract directly. Likewise, do not identify material suppliers, manufacturers, and fabricators that will not perform physical work at the site of the project but will only supply materials or equipment to the bidder or proposed subcontractor(s).
3. **Subcontractor Qualifications:** Bidder must only list subcontractors who possess a South Carolina Contractor's license with the license classification and/or subclassification identified by the Owner in the first column on the left. The subcontractor license must also be within the appropriate license group for the work of the specialty. If Bidder lists a subcontractor who is not qualified to perform the work, the Bidder will be rejected as non-responsive.
4. **Use of Own forces:** If under the terms of the Bidding Documents, Bidder is qualified to perform the work of a listed specialty and Bidder does not intend to subcontract such work but to use Bidder's own employees to perform such work, the Bidder must insert its own name in the space provided for that specialty.
5. **Use of Multiple Subcontractors:**
 - a. If Bidder intends to use multiple subcontractors to perform the work of a single specialty listing, Bidder must insert the name of each subcontractor Bidder will use, preferably separating the name of each by the word "**and**". If Bidder intends to use both his own employees to perform a part of the work of a single specialty listing and to use one or more subcontractors to perform the remaining work for that specialty listing, bidder must insert his own name and the name of each subcontractor, preferably separating the name of each with the word "**and**". Bidder must use each entity listed for the work of a single specialty listing in the performance of that work.
 - b. **Optional Listing Prohibited:** Bidder may not list multiple subcontractors for a specialty listing, in a form that provides the Bidder the option, after bid opening or award, to choose to use one or more but not all the listed subcontractors to perform the work for which they are listed. A listing, which on its face requires subsequent explanation to determine whether it is an optional listing, is non-responsive. If bidder intends to use multiple entities to perform the work for a single specialty listing, bidder must clearly set forth on the bid form such intent. Bidder may accomplish this by simply inserting the word "**and**" between the names of each entity listed for that specialty. Agency will reject as non-responsive a listing that contains the names of multiple subcontractors separated by a blank space, the word "or", a virgule (that is a /), or any separator that the Agency may reasonably interpret as an optional listing.
6. If Bidder is awarded the contract, bidder must, except with the approval of the Agency for good cause shown, use the listed entities to perform the work for which they are listed.
7. If bidder is awarded the contract, bidder will not be allowed to substitute another entity as subcontractor in place of a subcontractor listed in Section 7 of the Bid except for one or more of the reasons allowed by the SC Code of Laws.
8. Bidder's failure to identify an entity (subcontractor or himself) to perform the work of a subcontractor specialty listed in the first column on the left will render the Bid non-responsive.

SE-330 LUMP SUM BID FORM

§ 8. LIST OF MANUFACTURERS, MATERIAL SUPPLIERS, AND SUBCONTRACTORS OTHER THAN SUBCONTRACTORS LISTED IN SECTION 7 ABOVE (*FOR INFORMATION ONLY*):

Pursuant to instructions in the Invitation for Construction Services, if any, Bidder will provide to Owner upon the Owner's request and within 24 hours of such request, a listing of manufacturers, material suppliers, and subcontractors, other than those listed in Section 7 above, that Bidder intends to use on the project. Bidder acknowledges and agrees that this list is provided for purposes of determining responsibility and not pursuant to the subcontractor listing requirements of SC Code Ann § 11-35-3020(b)(i).

§ 9. TIME OF CONTRACT PERFORMANCE AND LIQUIDATED DAMAGES

a) CONTRACT TIME

Bidder agrees that the Date of Commencement of the Work shall be established in a Notice to Proceed to be issued by the Owner. Bidder agrees to substantially complete the Work within 30 Calendar Days from the Date of Commencement, subject to adjustments as provided in the Contract Documents.

b) LIQUIDATED DAMAGES

Bidder further agrees that from the compensation to be paid, the Owner shall retain as Liquidated Damages the amount of \$ 200 for each Calendar Day the actual construction time required to achieve Substantial Completion exceeds the specified or adjusted time for Substantial Completion as provided in the Contract Documents. This amount is intended by the parties as the predetermined measure of compensation for actual damages, not as a penalty for nonperformance.

§ 10. AGREEMENTS

- a) Bidder agrees that this bid is subject to the requirements of the laws of the State of South Carolina.
- b) Bidder agrees that at any time prior to the issuance of the Notice to Proceed for this Project, this Project may be canceled for the convenience of, and without cost to, the State.
- c) Bidder agrees that neither the State of South Carolina nor any of its agencies, employees or agents shall be responsible for any bid preparation costs, or any costs or charges of any type, should all bids be rejected or the Project canceled for any reason prior to the issuance of the Notice to Proceed.

§ 11. ELECTRONIC BID BOND

By signing below, the Principal is affirming that the identified electronic bid bond has been executed and that the Principal and Surety are firmly bound unto the State of South Carolina under the terms and conditions of the AIA Document A310, Bid Bond, included in the Bidding Documents.

ELECTRONIC BID BOND NUMBER: _____

SIGNATURE AND TITLE: _____

**SE-330
LUMP SUM BID FORM**

CONTRACTOR'S CLASSIFICATIONS AND SUBCLASSIFICATIONS WITH LIMITATION

SC Contractor's License Number(s): _____

Classification(s) & Limits: _____

Subclassification(s) & Limits: _____

By signing this Bid, the person signing reaffirms all representation and certification made by both the person signing and the Bidder, including without limitation, those appearing in Article 2 of the Instructions to Bidders, is expressly incorporated by reference.

BIDDER'S LEGAL NAME: _____

ADDRESS: _____

TELEPHONE: _____

EMAIL: _____

SIGNATURE: _____ **DATE:** _____

PRINT NAME: _____

TITLE: _____

SECTION 26 0500 - GENERAL ELECTRICAL REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Work included in these specifications and included on the drawings shall include furnishing all labor, materials, supplies, and equipment to perform all work required including cutting, channeling, chasing, excavating and backfilling, demolition (if any) to install a complete and working electrical system(s) in accordance with these sections of the specifications and the accompanying drawings. This shall include all required preparation work, demolition, raceways, coordination, etc. required to install the electrical system.
- B. It is recognized that separate subcontracts may be instituted by the General Contractor or the Division 26 Contractor with other contractors and/or suppliers. It is the responsibility of the Division 26 Contractor to completely inform, coordinate and advise those subs as to all of the other requirements, conditions and information associated with providing and installing the total job.
- C. The electrical work shall include, but in no way be limited to the following:
 - 1. Raceways Systems
 - a. Power
 - b. Lighting
 - 2. Power Systems
 - a. Interior
 - 3. Electrical Demolition

1.02 RELATED SECTIONS

- A. Drawings and specifications including General Conditions, Supplementary Conditions and Division 01 specification sections, apply to work of this and all sections in Division 26. Division 26 General Provisions described in this section apply to all sections of Division 26.

1.03 SPECIFIED MATERIALS:

- A. Throughout the drawings and specifications, equipment and systems have been selected and are referenced by name, manufacturer, model number, etc. These references are not intended to limit competition. Products by other listed manufacturers will be acceptable.
- B. If a listed manufacturer other than the basis of design is used, it is the contractor's responsibility for changes in dimension, structural, electrical changes, etc. required for proper installation, function and final performance.

1.04 REFERENCES

- A. The Contractor is responsible for obtaining all required permits and complying with the current editions, or the editions referenced in the other individual sections of these specifications, of all applicable National (NEC, IBC, NFPA), State, County, and Municipal codes and regulations. This shall include, but not be limited to, the following:
 - 1. NEMA MG 1 - Motors and Generators; National Electrical Manufacturers Association.
 - 2. NFPA 70 - National Electrical Code
 - 3. NFPA - National Fire Protection Association
 - 4. Federal Occupational Safety and Health Act (OSHA)
 - 5. NFPA 101 (Life Safety Code);

6. International Building Code (IBC)
 7. International Fire Code
- B. Unless noted otherwise, the contractor shall comply with the latest edition and update of any and all codes and standards.
 - C. Compliance with Underwriters Laboratories: All products installed under the contract shall have the Underwriters Laboratories (UL) label where such marking is available. Products which are not UL labeled will not be acceptable if labeled products are available from another approved manufacturer.
 - D. The above listed requirements are required of the electrical contractor by this contract whether these requirements are shown on the drawings, mentioned in the specifications or not.
 - E. The contractor(s) shall submit all items necessary to obtain all required permits to the appropriate Federal/State/County/City agencies, obtain all required permits, and pay for any and all required fees.

1.05 DEFINITIONS

- A. Concealed - Embedded in masonry or installed within other building elements including but not necessarily limited to crawl spaces, spaces above ceilings, in walls, in chases, shafts . It shall also include conduit installed in the ground beneath a floor slab. Not visible.
- B. Exposed - Installed in such a manner that it can be seen. All exposed materials shall be installed in a neat manner. If in the engineer's opinion the installed materials are not installed in a neat manner, it shall be removed and reinstalled to the satisfaction of the engineer.
- C. Furnish - When used in the Division 26 plans and/or specifications the word "furnish" shall mean to purchase a piece of equipment or material and to have said equipment/material transported to the project site (or other location if so directed). All items to be furnished shall include any and all mounting hardware, support, and accessory required for installation and proper operation. Unless otherwise noted, when a piece of equipment or material is to be furnished by the contractor, it shall also be installed.
- D. Provide - When used in the Division 26 plans and/or specifications the word "provide" shall mean to furnish and install complete and ready for use and to put into operation. Include any and all options, accessories, and mounting/installation hardware required for a complete and operating system or element of the electrical system.
- E. Install - When used in the Division 26 plans and/or specifications the word "install" shall mean to unload and transport the equipment/material to the installation point of the job site. Any and all mounting hardware (whether specified or called for by name / model number, or not) shall be included. Perform every operation necessary, including any and all final adjustments, etc. required for proper operation.
- F. Controlled - When used in the Division 26 plans and/or specifications, the word "controlled" shall mean to govern delivery of operating voltage or power to equipment or systems by means of, but not limited to, feeders, disconnects, breakers, switches, starters, etc..

1.06 COORDINATION OF WORK IN OTHER SECTIONS

- A. The Division 26 contractor is responsible for including any and all work related to the electrical that is noted in any part of the specifications or any part of the drawings, including Divisions 01, 48 and any other sections.

- B. If any piece of equipment is shown on any part of the drawings ("A" (Architectural) drawings, "M" (Mechanical) drawings, "P" (Plumbing) drawings, or "E" (Electrical) drawings), it is the responsibility of the Division 26 Contractor to furnish and install electrical service as required to that equipment. Do a complete review of all contract documents and include electrical service for all such equipment whether or not it is also shown in Electrical documents. Electrical service shall comply with all requirements of the equipment shop drawings and all codes.
- C. The Division 26 Contractor will supply power to equipment at the voltage indicated on the Division 26 drawings. The Division 26 Contractor and all other contractors will be held responsible for coordinating the equipment voltages, control equipment, wiring, and locations and type of terminations/connections and/or disconnects required to comply with the National Electrical Code, International Building Code, all local codes, and the equipment manufacturer's requirements. If equipment is furnished to the project at a voltage other than that shown on the Division 26 drawings, the contractor supplying the equipment and all other subcontractors will be held responsible for making any necessary adjustments to correct the conflict, to the satisfaction of the Electrical Engineer.

1.07 INTERPRETATION OF THE DRAWINGS AND SPECIFICATIONS (CONTRACT DOCUMENTS):

- A. Refer to the section of the specifications which cover General Conditions, Division 01, and Instructions to bidders. These sections and their requirements are a part of this contract and are binding on this section of the work.
- B. Electrical Drawings are diagrammatic in nature except where specific dimensions, or specific details are shown on the electrical, mechanical, or architectural drawings. The Electrical Contractor shall refer to other drawings for exact locations of equipment, building dimensions, architectural details and conditions affecting the electrical work; however, field measurements take precedence over dimensioned drawings. The Electrical Contractor shall provide all labor and materials and all incidental elements; junction and pull boxes, filters, pull wires, connectors, support materials, fuses, disconnect switches, lamps, and labels, to install, connect, start-up and result in a complete and working system in accordance with the drawings and specifications. Unless noted otherwise on the plans or in these specifications, all final connections are the responsibility of the Division 26 Contractor.
- C. In order to show the electrical work required under this contract on the drawings, it is necessary to utilize symbols and schematic diagrams/details. These symbols and schematic diagrams/details do not have any dimensional significance nor do they delineate every item required for the intended installations. The work shall be installed in accordance with the intent diagrammatically expressed on the drawings, and in conformity with the dimensions indicated on the final architectural and structural working drawings and on equipment shop drawings. No interpretation shall be made from the limitations of symbols and diagrams that any elements necessary for complete work are excluded.
- D. When the details of specific and/or general installation requirements show specific dimensioning and/or positioning requirements of the items to be installed, these dimensions shall be field verified and followed. It is the intent of these details to only establish the general feasibility of the work required. These details in no way delete, reduce, or substitute the requirement of field coordination for the indicated work.

- E. The contractor is responsible for coordinating the installation of all electrical work with the work of other contractors and/or trades. This contractor shall refer to the other drawings (demolition, site, civil, architectural, kitchen, structural, plumbing, mechanical, etc.) to assure that the installed electrical work is installed in a coordinated fashion. Conflicts on installation work due to the lack of proper coordination of this contractor shall result in the work being removed and coordinated and properly reinstalled. Report to the Engineer any and all discrepancies that the contractor(s) find in the field between the electrical drawings and the other drawings.
- F. The installation of any and all equipment/systems is subject to clarification as indicated in the review comments of the Engineer on the shop drawings. The contractor shall be aware that if the equipment of an approved equal manufacturer is to be installed, the equipment, controls, functions, conduit routing, power requirements, etc. may be different. It is the responsibility of the electrical contractor to coordinate the installation requirements of the equipment to be installed with the electrical plans of the specified equipment/systems. If there are any additional equipment, power service, conduit, conductors, controls, etc. required to install the approved equal equipment, these additional requirements shall be furnished and installed.
- G. Submission of a proposal and ultimate acceptance of an agreement or contract for execution of this section of work will be construed as evidence that the Electrical Contractor and each interested Subcontractor and/or vendor has carefully read and accepts all conditions set forth in each Division under specification Divisions titled "Instructions To Bidders" and Division 01, "General Conditions", in so far as such conditions may affect both the bidding for and execution of this section of work.

1.08 ELECTRICAL SYSTEMS

- A. All electrical systems shown on the plans or specified in the Construction Manual shall have equipment furnished and installed so that the system is a complete and functioning system that complies with the intent of the specifications, whether each and every element of each and every system is specified or not. Any and all equipment, options, and system elements necessary for proper operation shall be furnished and installed, whether specifically called for (specified by name or catalog number) or not.

1.09 SPECIAL ELECTRICAL REQUIREMENTS

- A. Provide all wiring, connectors, fittings, connections, and all accessories for the complete installation of, and final connections to, equipment furnished under other divisions of the specifications and where indicated on the electrical drawings or otherwise specified.
- B. The Electrical Contractor shall coordinate with all other contractors the electrical service provided as shown on the electrical plans with respect to voltage, phase, and ampacity. This coordination shall take place before any equipment is ordered and is for the purpose of the contractor providing equipment that requires electrical connection ordering the correct equipment to match the electrical service provided. Any changes in the characteristics of the circuits that serve any electrically operated equipment shall be made.
- C. Make all final connections to all equipment, provided under the electrical contract and equipment provided under other sections, except where noted on the plans to provide "rough-in only". Where connections are to be made by someone other than the Division 26 contractor, coordinate with the equipment supplier to determine the rough-in requirements. In the case

where rough-in is installed now but equipment unknown or is to be installed in the future, install outlet box sized for the conductors installed, install conductors and leave 8" of pigtails for each conductor. Tape all conductors, leave a note in the box as to the panel the circuit is connected, and install a cover plate over the outlet box. In the panel that the circuit terminates, do not connect the circuit to a breaker, tag the circuit with information as to the location of the outlet box, and leave enough pigtail in the panel so that connection can be made to any breaker space in the panel.

- D. The Electrical Contractor is hereby alerted that certain features of control, other functions, or systems may be specified in this division by performance, and as such, all elements of wiring or other materials and devices for the complete installation may not be shown on the drawings. The Electrical Contractor shall provide for the final and complete installation of all features called for by drawings or specifications.
- E. Note that the Mechanical Division includes furnishing all motors for equipment furnished and installed by Division 23. In addition, unless otherwise shown on the electrical drawings, starters for Division 23 equipment shall also be provided by Division 23. The Division 26 work shall include installing all of the individually mounted, stand alone starters and the power wiring from the electrical system through ALL motor starters to the final connection to the motors. The only exception for this requirement of the Division 26 scope furnishing and installing starters shall be where the Division 23 equipment has a control panel that includes the starter and/or disconnect. Coordinate with Division 23.
- F. Where equipment is prewired, the power wiring shall extend to the power terminals of the pre-wired equipment. Control wiring for the mechanical equipment and temperature control wiring is covered under Division 23 and is not a part of Division 26 unless specifically noted.

1.10 DIMENSIONS ON DRAWINGS, IN FIELD, VERIFICATION

- A. The contractor shall be responsible for visiting the site in order to become familiar with existing conditions and coordinating the required work as needed. No increase in contract cost will be considered due to the contractor not being aware of existing conditions.
- B. Do not scale drawings. Confirm all dimensions in the field. Coordinate all installations with shop drawings and other contractors work. Where discrepancies are found on the contract documents, the contractor shall include in the project cost any and all materials, items and labor required to make any and all changes required to install the work correctly. Where discrepancies are found on the project the contractor shall stop work in that area and contact the engineer.

1.11 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Required submittals are listed with each section of the electrical specifications.

1.12 RECORD DRAWINGS

- A. The electrical contractor shall keep a set of construction drawings during the length of the project on which he shall note any and all changes from the original drawings. Of special importance is noting the actual location of all service entrances into the building and where conduit stub outs have been installed. This record set of drawings shall be updated daily. The drawings shall be neat, orderly and marked in a way to be clearly interpreted. The record

drawings shall be turned over to the Architect to update drawing files for a final set of drawings for the owners record.

1.13 QUALITY ASSURANCE

- A. All equipment shall be installed in compliance with the manufacturer's published installation recommendations and requirements, with any and all required accessories and mounting hardware, and/or as approved by the Engineer. The manufacturer's published installation requirements and recommendations shall become a part of the Owner's Manual (See Paragraph 1.15)

1.14 OPERATING AND MAINTENANCE MANUALS:

- A. The Manuals generally include all project submittals updated to reflect actually installed conditions; operating instructions; maintenance schedules; training material; warranty and bonds; and contact information for sales, warranty and service of equipment. Refer to Division 01 of the specifications for complete requirements.
- B. Provide manuals for each product or system.

1.15 TRAINING AND INSTRUCTIONS:

- A. The Contractor shall provide training and instructions by knowledgeable representatives of the products installed to fully train and instruct representatives of the using agency in the location, function and operation of devices, equipment and systems installed under Division 26. The instruction shall include maintenance procedures for all such items. See specific sections in the Project Manual for devices, equipment and systems for detailed requirements for training and instructions.

1.16 DELIVERY, STORAGE, AND PROTECTION

- A. Where equipment is purchased by the electrical contractor to be installed in conformance with the contract documents, the contractor shall follow the following procedure as it relates to delivery, storage, and installation:
 - 1. Coordinate any and all information with any and all contractors who are to do work to accommodate the division 26 equipment/work.
 - 2. Coordinate delivery of equipment.
 - 3. Unload the equipment from delivery trucks.
 - 4. Inspect equipment for damage. Report damage immediately and arrange for the equipment to be repaired or replaced. No claims for time extensions or additional work related to the damage will be accepted if not made within ten days of the delivery of the equipment.
 - 5. Inspect the equipment to assure correct make, model number, voltage, etc.
 - 6. Provide for safe handling and field storage up to the time of permanent placement in the project.
 - 7. Provide for any and all field assembly and internal connection as may be necessary for proper operation.
 - 8. Install in place including any and all required mounting supports, connectors, fittings, connections, and accessories required for complete system operation.

1.17 MANUFACTURER'S FIELD SERVICES:

- A. Provide manufacturer's field services where required under the specific sections of the Project Manual using authorized and trained manufacturer's representatives of the equipment or systems in question. The field services shall include the following as a minimum:
 - 1. Inspect the installation to verify that the installation meets or exceeds all manufacturer's requirements and recommendations for proper operation.
 - 2. Start/energize the equipment and verify that the equipment/system is operating and functioning as required by these specifications and the manufacturer's requirements.
 - 3. Provide written certification that field services have been performed and that equipment/system is operating and functioning as required by these specifications and the manufacturer's requirements. Submit the certification as part of the closeout documents.
- B. Refer to specific sections of the Project Manual and provide all field service requirements listed in addition to these general requirements.

1.18 WARRANTY

- A. All work, equipment, and materials shall be new and without defects or blemishes, and guaranteed to be free from defects for a period of one (1) year after the final date of project acceptance as defined by the Architect (NOT THE DATE OF INSTALLATION OR START-UP). All installation and installation materials shall also be guaranteed for the one (1) year period. This shall cover such items as equipment pads, supports, leaks from around equipment installation, etc and is intended to cover everything installed or provided under this division of the contract.
- B. Manufactured pieces of equipment shall have their guarantee also backed by the equipment manufacturer.
- C. During the guarantee period there shall be no charge to the Owner for items and work done under the guarantee clause (Service calls). This shall apply to replacement equipment, equipment shipping charges, mileage, labor, all taxes, etc.
- D. Refer to the other sections of the Project Manual for warranty requirements that may exceed these general requirements and follow those requirements for the equipment, devices, materials or systems in question.
- E. See Section 01 7000 - Execution and Closeout Requirements, for additional warranty requirements.

PART 2 PRODUCTS

2.01 GENERAL:

- A. All products shall be of new manufacturer (unless the plans and/or other sections of this specification call for existing or other identified products to be used), age of less than one year, and the latest model of a manufacturer. A new product shall not be used if the manufacturer has introduced a product as a replacement. All materials and apparatus for the work shall be furnished, delivered, erected, connected and finished in every detail, and shall be so selected and arranged as to fit into the building spaces in compliance with all code requirements.
- B. All equipment that is provided by the contractor, subcontractors, or specialty subcontractor (fire alarm, etc) to be installed at the project site, shall be purchased, installed and maintained by the local (to the project site) authorized, licensed, factory distributor/installer/supplier. The

contractor shall include with the submittals, verification in writing from the manufacturer, that the supplier and/or distributor is a factory authorized and licensed by the manufacturer to provide, install, and maintain (throughout the entire length of the warrantee period) the equipment. THERE SHALL BE NO EXCEPTIONS TO THIS REQUIREMENT.

- C. By providing equipment to the project, a manufacturer guarantees to provide replacement parts for the equipment for a period of five (5) years, even if the item provided goes out of manufacture.
- D. Manufacturer's catalog numbers listed are not necessarily complete and are for general identification only. It is the responsibility of the Contractor to provide complete catalog numbers and to provide all accessories for installation as implied by the accompanying description of the equipment, material or device, the demonstrated use on the drawings, and the specifications contained herein. Products provided shall be a standard product which has a history of successful installation and operation for a minimum period of two years. Prototype or custom made equipment is not acceptable unless so specified herein.
- E. Manufacturer's instructions shall be obtained by the Contractor and used for the installation of all equipment and devices where such manufacturer's instructions are available.
- F. Completeness: Provide all boxes, off-sets, bends, raceways, devices, raceway supports, installation brackets and supports, flexible connections, wiring connectors, labels and terminals for the complete installation and operation of all products. Each unit of product shall be assembled and installed and all surfaces shall be clean and free of dents, scratches, and abrasions or marred areas.

2.02 IDENTIFICATION

- A. All equipment shall be marked and/or identified so that maintenance crews can locate equipment.
- B. All equipment items; switchboards, distribution, power, receptacle and lighting panelboards, transformers, disconnects, motor control centers, switches, lighting contactors and wiring gutters, of the electrical system shall be labeled. Each distribution switch and circuit breaker in a switchboard, or individually mounted, shall be labeled. These labels shall be engraved, black laminated plastic labels, with 1/2 inch white letters. For equipment connected to the emergency power system, the labels shall be red laminated plastic with white letters. Attach the labels to the equipment with two sheet metal screws or rivets.
- C. Circuit breakers in distribution panels (panels with hinged doors) shall be labeled by means of a typed circuit breaker directory. For all breakers serving lighting, receptacle, and HVAC circuits, the contractor shall include on the panel schedule by the breaker number the room number(s) served by the circuit. The room number(s) shall be the same number(s) as the room number(s) on the door, not the space number as shown on the plans. See Section 26 2416.
- D. Wire and cable identification shall be made so that all wire and cable can be identified by means of color coding as noted in Section 26 0553. Wiring marker for use in wire and terminal identification shall be white cloth backed with a rubber based, pressure sensitive adhesive labels. Each wire or cable in a feeder at its terminal points, and in each pull-box, junction box, and panel gutter through which it passes shall be identified. Where two or more feeders enter or leave a device or enclosure, the cable shall be tagged to indicate destination of cable run.

Each common wire, common circuit or common loop of a system, fire alarm, sound system, or TV system, shall be identified.

- E. Device plates for local toggle switches, toggle switch-type motor starters, pilot lights, and the like, whose function is not readily apparent shall be labeled suitably describing the equipment controlled or indicated. These labels shall be engraved, black laminated plastic labels, with 1/4 inch white letters. For equipment connected to the emergency power system, the labels shall be red laminated plastic with white letters. Attach the labels to the equipment cover plates with glue recommended by the manufacturer.
- F. Where used with an empty raceway for wires of a future system, each box or cabinet shall be identified on the inside by means of indelible markings indicating the system for which it is installed. Label any junction box, which includes wiring, with indelible markings on the outside showing system and voltage.

PART 3 EXECUTION

3.01 GENERAL

- A. Before any work is started, the electrical contractor shall coordinate the work of other contractors that will affect the work of the electrical contractor. The electrical contractor shall inspect the work of all other trades to determine if the other work is ready for the electrical contractor to start his work.
- B. Any and all electrical installations shall be coordinated with other trades, contractors and the Owner.
- C. The contractor shall make himself familiar with existing conditions, site information, etc. so that conflicts are avoided.
- D. All work shall be installed per all applicable code, rules, regulations, shop drawings and manufacturer's installation recommendations.
- E. The electrical contractor shall be responsible for returning to original, pre-construction condition, any paved areas, sidewalks, planting, walls, and other areas disturbed during electrical installation work.
- F. The electrical equipment shall be installed as close as possible to the location as shown on the plans. If during the installation, it is required to install equipment in locations other than the one shown on the plans, the contractor shall make a sketch of the proposed changes, submit it to the Engineer, and after the Engineer has given approval, then proceed with the installation.
- G. Working spaces and clearances shall not be less than the required minimums in the National Electric Code (NEC).

3.02 EXAMINATION

- A. The Electrical Contractor is responsible for visiting and examining the site to determine those portions of the site or present buildings affected by this work so as to become familiar with existing conditions and difficulties that will attend the execution of the work, before submitting proposals.
- B. Submission of a proposal will be considered as evidence that such examination has been made and later claims for labor, equipment, or materials because of difficulties encountered, which could have been foreseen had such examination been made, will not be recognized.

3.03 ADDITIONS RENOVATIONS AND REMODELING

- A. All electrical work shall be coordinated and phased so as to assure electrical service to any other buildings or parts of buildings that require use during construction.
- B. All existing electrical system elements shall be protected from damage during any and all additions, renovations, and remodeling.
- C. All new electrical equipment and installations shall be installed and connected to existing work or existing electrical system elements in a neat and careful manner. Any existing electrical work or system elements that are disturbed or damaged shall be replaced or repaired to the pre-construction condition.

3.04 LOCATIONS OF EQUIPMENT REQUIRING ELECTRICAL SERVICE AND CONNECTIONS:

- A. Coordinate the exact installed location of equipment that requires electrical connections that is furnished and installed by other contractors. The electrical drawings try to show the correct location of all of these items, but it is the responsibility of the electrical contractor to coordinate with all other contractors to determine the exact installed location of all equipment furnished and installed by other contractors and wired by the electrical contractor. Such coordination shall include, but not limited to exact location, location of electrical connection, type of connection required, and electrical characteristics.

3.05 OPENINGS, CUTTING AND PATCHING:

- A. Contractor shall arrange for openings in the building structure or components to allow for installation of electrical work or transport of electrical equipment as the project progresses.
- B. Any cut portion of the building, wall, sidewalk, paved drives, ceiling, floors, roofs, etc., install any raceway or apparatus or transport equipment, shall be restored in a manner such that the end product complies with the specification for that type of work. Where existing work is cut, restore to the original (pre-construction) condition. The electrical contractor shall be responsible for returning to original, pre-construction condition, any of the above noted areas or other areas disturbed during electrical installation work.
- C. Structural, load bearing, or supporting device shall not be cut without approval in writing from the Architect.

3.06 LOCATIONS OF OUTLET BOXES FOR EQUIPMENT AND GENERAL WIRING:

- A. All outlets for lighting, power, and equipment, not specifically dimensioned are located diagrammatically on the drawings.
- B. If so directed by the Architect / Engineer / Owner, any outlet box may be moved 10 feet in any direction.

3.07 PAINTING:

- A. Exposed conduit, ungalvanized troughs, metal frames and support racks and wooden surfaces provided under this section shall be painted. Paint color shall match and be the same paint as the room finish paint unless noted elsewhere on the plans or in the specifications. Clean surfaces completely of all oil, wax, rust and old paint prior to repainting. Paint shall be applied to backup boards before switches, troughs, and devices are installed. Paint shall include a primer and two coats of finished paint. Touch-up scratched, or marred surfaces of lighting

fixtures and equipment with paint obtained from the equipment manufacturer especially for that purpose.

3.08 ELECTRICAL SYSTEM TESTING:

- A. At the time of the final inspection, or at such times as parts of the system may be completed, all electrical systems shall be tested for compliance with the specifications. The Contractor shall provide all personnel and equipment; current, voltage and resistance measuring instruments, ladders and lights to assist the Engineer in conducting the tests. Authorized representatives of the manufacturer shall be present to demonstrate compliance with specifications of their specific system.
- B. The Contractor shall remove equipment covers as directed for inspection of internal wiring. Accessible ceiling shall be removed as directed for inspection of equipment above the ceilings. After inspection and correction of any problems found, the Contractor shall replace all cover plates, access plates and removable ceiling.
- C. The life safety system shall be demonstrated to function in accordance with the specifications. Each device shall be tested for proper operation.

3.09 CLEANING:

- A. At completion of the work the Contractor shall clean all exposed elements of the electrical system so that all markings deteriorating the original finish appearance are removed. All lighting fixtures, lenses, and reflectors shall be cleaned inside and out and all lamps shall be left clear of dust, dirt, and grime.
- B. The Contractor shall specifically examine the interiors of panelboard cans, equipment cabinets, lighting fixtures, junction boxes, and like components where conduit and wire connections have been made, and all resulting wire ends, insulation cuttings, knock-out plugs, metal filings and any other trash shall be removed so that interiors and exteriors are left free of all debris.

END OF SECTION

SECTION 26 0501 - MINOR ELECTRICAL DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical demolition.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching and extending work: As specified in individual sections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify field measurements and circuiting arrangements are as shown on Drawings.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Demolition drawings are based on casual field observation .
- D. Beginning of demolition means installer accepts existing conditions.

3.02 PREPARATION

- A. Disconnect existing electrical service only after the new service has been installed and the system is ready for the switchover.
- B. Coordinate electrical service outages with the Owner.
- C. Existing Electrical Service: Maintain existing system in service until new system addition is complete and ready to be energized. Disable the existing system only to make switchovers and connections. Minimize outage duration.
 - 1. Obtain permission from Owner at least 72 hours before partially or completely disabling system.
- D. Existing Fire Alarm System: Maintain existing system in service. Disable system only to make connections to new equipment. Minimize outage duration.
 - 1. Notify Owner before partially or completely disabling system.
 - 2. Notify local fire service.
 - 3. Make notifications at least 72 hours in advance.
 - 4. Make temporary connections to maintain service in areas adjacent to work area.

3.03 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK

- A. Remove, relocate, and extend existing installations to accommodate new construction.
- B. Remove abandoned wiring to source of supply.
- C. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.
- D. Disconnect and remove abandoned luminaires. Remove brackets, stems, hangers, and other accessories.
- E. Repair adjacent construction and finishes damaged during demolition and extension work.
- F. Maintain access to existing electrical installations that remain active. Modify installation or provide access panel as appropriate.

- G. Extend existing installations using materials and methods compatible with existing electrical installations, or as specified.

3.04 CLEANING AND REPAIR

- A. See Section 01 7419 - Construction Waste Management and Disposal for additional requirements.
- B. Clean and repair existing materials and equipment that remain or that are to be reused.

END OF SECTION

SECTION 26 0519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES
PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Single conductor building wire.
- B. Wiring connectors.
- C. Electrical tape.
- D. Wire pulling lubricant.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 26 0526 - Grounding and Bonding for Electrical Systems: Additional requirements for grounding conductors and grounding connectors.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire; 2013.
- B. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes; 2010.
- C. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation; 2004 (Reapproved 2009).
- D. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape; 2010.
- E. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- F. NECA 120 - Standard for Installing Armored Cable (AC) and Metal-Clad Cable (MC); National Electrical Contractors Association; 2006.
- G. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; International Electrical Testing Association; 2013 (ANSI/NETA ATS).
- H. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- I. UL 44 - Thermoset-Insulated Wires and Cables; Current Edition, Including All Revisions.
- J. UL 486A-486B - Wire Connectors; Current Edition, Including All Revisions.
- K. UL 486C - Splicing Wire Connectors; Current Edition, Including All Revisions.
- L. UL 486D - Sealed Wire Connector Systems; Current Edition, Including All Revisions.
- M. UL 1569 - Metal-Clad Cables; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:

1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
 3. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.
- B. NEMA WC 3 - Rubber-Insulated Wire and Cable for the Transmission and Distribution of Electrical Energy.
- C. NEMA WC 5 - Thermoplastic-Insulated Wire and Cable for the Transmission and Distribution of Electrical Energy.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements.
- B. Product Data: Provide for each cable assembly type.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Also submit instructions for splicing and terminating aluminum conductors.
- D. Project Record Documents: Record actual locations of components and circuits.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 CONDUCTOR AND CABLE APPLICATIONS

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.
- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Concealed Dry Interior Locations: Use only building wire in raceway or building wire with Type THHN insulation in raceway.
- D. Above Accessible Ceilings: Use only building wire in raceway, building wire with Type THHN insulation in raceway, or metal clad cable.
- E. Use solid conductor for feeders and branch circuits 10 AWG and smaller.
- F. Use stranded conductors for control circuits.
- G. Use conductor not smaller than 12 AWG for power and lighting circuits and all other wiring where the voltage is greater than 48 volts.
- H. Use conductor not smaller than 16 AWG for control circuits.
- I. Use 10 AWG conductors for 20 ampere, 120 volt branch circuits longer than 75 feet.

- J. Use 10 AWG conductors for 20 ampere, 277 volt branch circuits longer than 200 feet.
- K. Conductor sizes are based on copper unless indicated as aluminum or "AL".

2.02 WIRE MANUFACTURERS

- A. Cerro Wire Inc: www.cerrowire.com.
- B. Industrial Wire & Cable, Inc: www.iewc.com.
- C. Southwire Company: www.southwire.com.
- D. Substitutions: See Section 01 6000 - Product Requirements.

2.03 CONDUCTOR AND CABLE GENERAL REQUIREMENTS

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Provide new conductors and cables manufactured not more than one year prior to installation.
- D. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- E. Comply with NEMA WC 70.
- F. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- G. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- H. Conductors for Grounding and Bonding: Also comply with Section 26 0526.
- I. Conductor Material:
 - 1. Provide copper conductors only. Aluminum conductors are not acceptable for this project. Conductor sizes indicated are based on copper.
- J. Minimum Conductor Size:
 - 1. Branch Circuits: 12 AWG.
 - a. Exceptions:
 - 1) 20 A, 120 V circuits longer than 75 feet: 10 AWG, for voltage drop.
 - 2) 20 A, 120 V circuits longer than 150 feet: 8 AWG, for voltage drop.
 - 3) 20 A, 277 V circuits longer than 150 feet: 10 AWG, for voltage drop.
- K. Conductor Color Coding:
 - 1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
 - 2. Color Coding Method: Integrally colored insulation.
 - 3. Color Code:
 - a. 480Y/277 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Brown.
 - 2) Phase B: Orange.
 - 3) Phase C: Yellow.
 - 4) Neutral/Grounded: Gray.
 - b. 208Y/120 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.

- 4) Neutral/Grounded: White.
- c. Equipment Ground, All Systems: Green.

2.04 SINGLE CONDUCTOR BUILDING WIRE

- A. Description: Single conductor insulated wire.
- B. Conductor Stranding:
 - 1. Feeders and Branch Circuits:
 - a. Size 10 AWG and Smaller: Solid.
- C. Insulation Voltage Rating: 600 V.
- D. Insulation:
 - 1. Copper Building Wire: Type THHN/THWN or THHN/THWN-2, except as indicated below.
- E. Conductor: Copper.
 - 1. For Sizes Smaller Than 4 AWG: Copper.
- F. Insulation Voltage Rating: 600 volts.
- G. Insulation: NFPA 70, Type THHN/THWN.
- H. Insulation: Thermoplastic material rated 60 degrees C.

2.05 COLOR CODE

- A. All cables shall be color coded. Color coding shall be as follows:
 - 1. 208/120 Volt Phase 277/480 Volt
 - a. Black A Brown
 - b. Red B Orange
 - c. Blue C Yellow
 - d. White Neutral Gray
 - e. Green Ground Green

2.06 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.
- B. Connectors for Grounding and Bonding: Comply with Section 26 0526.
- C. Wiring Connectors for Splices and Taps:
 - 1. Copper Conductors Size 8 AWG and Smaller: Use twist-on insulated spring connectors.
- D. Wiring Connectors for Terminations:
 - 1. Provide motor pigtail connectors for connecting motor leads in order to facilitate disconnection.
- E. Do not use insulation-piercing or insulation-displacement connectors designed for use with conductors without stripping insulation.
- F. Do not use push-in wire connectors as a substitute for twist-on insulated spring connectors.

2.07 WIRING ACCESSORIES

- A. Electrical Tape:

1. Vinyl Color Coding Electrical Tape: Integrally colored to match color code indicated; listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; suitable for continuous temperature environment up to 221 degrees F.
 2. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; conformable for application down to 0 degrees F and suitable for continuous temperature environment up to 221 degrees F.
- B. Wire Pulling Lubricant: Listed; suitable for use with the conductors or cables to be installed and suitable for use at the installation temperature.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that raceway installation is complete and supported.
- E. Verify that field measurements are as shown on the drawings.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Clean raceways thoroughly to remove foreign materials before installing conductors and cables.

3.03 INSTALLATION

- A. Circuiting Requirements:
 1. Unless dimensioned, circuit routing indicated is diagrammatic.
 2. When circuit destination is indicated and routing is not shown, determine exact routing required.
 3. Arrange circuiting to minimize splices.
- B. Install products in accordance with manufacturer's instructions.
- C. Install conductors and cable in a neat and workmanlike manner in accordance with NECA 1.
- D. Installation in Raceway:
 1. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
 2. Pull all conductors and cables together into raceway at same time.
 3. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.
 4. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- E. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.

1. Installation Above Suspended Ceilings: Do not provide support from ceiling support system. Do not provide support from ceiling grid or allow conductors and cables to lay on ceiling tiles.
- F. Terminate cables using suitable fittings.
- G. Group or otherwise identify neutral/grounded conductors with associated ungrounded conductors inside enclosures in accordance with NFPA 70.
- H. Make wiring connections using specified wiring connectors.
 1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies.
 2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
 3. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminates. Do not use wire brush on plated connector surfaces.
- I. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
- J. Insulate ends of spare conductors using vinyl insulating electrical tape.
- K. Identify conductors and cables in accordance with Section 26 0553.
- L. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 8400.
- M. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.
- N. Install wire and cable securely, in a neat and workmanlike manner, as specified in NECA 1.
- O. Route wire and cable as required to meet project conditions.
 1. Wire and cable routing indicated is approximate unless dimensioned.
 2. Where wire and cable destination is indicated and routing is not shown, determine exact routing and lengths required.
 3. Include wire and cable of lengths required to install connected devices within 10 ft of location shown.
- P. Where a circuit home run is shown on the plans without any conductor or raceway identification, it shall be a minimum of 2 # 12, 1 # 12 Ground, ½" Conduit. Where a overcurrent device is shown for the circuit, size the conductor and raceway to match the overcurrent device rating.
- Q. Use no wire smaller than 12 AWG for power and lighting circuits, and no smaller than 14 AWG for control wiring.
- R. Place an equal number of conductors for each phase of a circuit in same raceway or cable.
- S. Use wiring methods indicated.
- T. Pull all conductors into raceway at same time.
- U. Protect exposed cable from damage.

- V. Support cables above accessible ceiling, using spring metal clips or metal cable ties to support cables from structure or ceiling suspension system. Do not rest cable on ceiling panels. Provide braid rings or drive rings.
- W. Use suitable cable fittings and connectors.
- X. Neatly train and lace wiring inside boxes, equipment, and panelboards.
- Y. Thoroughly clean conductor surfaces before installing lugs and connectors.
- Z. Make splices, taps, and terminations to carry full ampacity of conductors with no perceptible temperature rise. Splice or tap only in accessible junction boxes or other electrical enclosures.
- AA. Use solderless pressure connectors with insulating covers for copper conductor splices and taps, 8 AWG and smaller.
- AB. Use insulated spring wire connectors with plastic caps for copper conductor splices and taps, 10 AWG and smaller.
- AC. Apply electrical tape to the ends of spare conductors and otherwise secure conductors to prevent accidental contact with persons or enclosures.
- AD. Identify and color code wire and cable under provisions of Section 26 0553. Identify each conductor with its circuit number or other designation indicated.

3.04 FIELD QUALITY CONTROL

- A. Perform inspection, testing, and adjusting in accordance with Section 01 4000.
- B. Perform field inspection and testing in accordance with Section 01 4000.
- C. Inspect wire and cable for physical damage and proper connection.
- D. Inspect and test in accordance with NETA ATS, except Section 4.
- E. Correct deficiencies and replace damaged or defective conductors and cables.

END OF SECTION

SECTION 26 0526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.
- D. Grounding and bonding components.

1.02 SYSTEM DESCRIPTION

- A. Furnish all labor, materials, services, equipment and appliances required in conjunction with a grounding system as indicated in the Contract Documents.
- B. Ground each separately-derived system neutral to separate grounding electrode.
- C. Bond together system neutrals, service equipment enclosures, exposed non-current carrying metal parts of electrical equipment, metal raceway systems, grounding conductor in raceways and cables, receptacle ground connectors, and plumbing systems.

1.03 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Additional requirements for conductors for grounding and bonding, including conductor color coding.
- B. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.04 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; International Electrical Testing Association; 2013 (ANSI/NETA ATS).
- C. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. UL 467 - Grounding and Bonding Equipment; Current Edition, Including All Revisions.

1.05 PERFORMANCE REQUIREMENTS

- A. Grounding System Resistance: 5 ohms.

1.06 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Project Record Documents: Record actual locations of components and grounding electrodes.
- C. Certificate of Compliance: Indicate approval of installation by authority having jurisdiction.

1.07 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

PART 2 PRODUCTS

2.01 GROUNDING AND BONDING REQUIREMENTS

- A. Existing Work: Where existing grounding and bonding system components are indicated to be reused, they may be reused only where they are free from corrosion, integrity and continuity are verified, and where acceptable to the authority having jurisdiction.
- B. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- C. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- D. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- E. Grounding Electrode System:
 - 1. Provide connection to required and supplemental grounding electrodes indicated to form grounding electrode system.
 - a. Provide continuous grounding electrode conductors without splice or joint.
 - b. Install grounding electrode conductors in raceway where exposed to physical damage. Bond grounding electrode conductor to metallic raceways at each end with bonding jumper.
- F. Bonding and Equipment Grounding:
 - 1. Provide bonding for equipment grounding conductors, equipment ground busses, metallic equipment enclosures, metallic raceways and boxes, device grounding terminals, and other normally non-current-carrying conductive materials enclosing electrical conductors/equipment or likely to become energized as indicated and in accordance with NFPA 70.
 - 2. Provide insulated equipment grounding conductor in each feeder and branch circuit raceway. Do not use raceways as sole equipment grounding conductor.
 - 3. Where circuit conductor sizes are increased for voltage drop, increase size of equipment grounding conductor proportionally in accordance with NFPA 70.
 - 4. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
 - 5. Terminate branch circuit equipment grounding conductors on solidly bonded equipment ground bus only. Do not terminate on neutral (grounded) or isolated/insulated ground bus.
 - 6. Provide bonding jumper across expansion or expansion/deflection fittings provided to accommodate conduit movement.
 - 7. Provide bonding for interior metal air ducts.

2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:
 - 1. Provide products listed, classified, and labeled as suitable for the purpose intended.
 - 2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in addition to requirements of Section 26 0519:
 - 1. Use insulated copper conductors unless otherwise indicated.
- C. Connectors for Grounding and Bonding:

1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
2. Unless otherwise indicated, use mechanical connectors, compression connectors, or exothermic welded connections for accessible connections.

2.03 CONNECTORS AND ACCESSORIES

- A. Mechanical Connectors: Bronze.
- B. Exothermic Connections:
- C. Wire: Stranded copper.
- D. Grounding Electrode Conductor: Size to meet NFPA 70 requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as shown on the drawings.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify existing conditions prior to beginning work.

3.02 GENERAL INSTALLATION REQUIREMENTS

- A. Install products in accordance with manufacturer's instructions.
- B. Install grounding and bonding system components in a neat and workmanlike manner in accordance with NECA 1.
- C. Make grounding and bonding connections using specified connectors.
 1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.
 2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.
 3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.
 4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- D. Identify grounding and bonding system components in accordance with Section 26 0553.
- E. Ground electrical work in accordance with NEC Article 250, local codes as specified herein, and as shown on the drawings.
- F. Provide a separate, insulated equipment grounding conductor in feeder and branch circuits. Terminate each end on a grounding lug, bus, or bushing.
- G. Install ground cables continuous between connections. Splices will not be allowed except where indicated on the drawings. Connections made by the CADWELD(R) Process are not

considered splices. Where ground cables pass through floor slabs, building walls, etc., and are not in metallic enclosures, provide the sleeves of approved nonmetallic material.

- H. Install equipment grounding conductors in raceway with feeder conductors.
- I. Ground interior lighting fixtures with grounding conductor to rigid metal raceways serving them. Flexible metal conduit shall have a ground wire installed with the power conductors.
- J. Provide bonding to meet requirements described in Quality Assurance.
- K. Equipment Grounding Conductor: Provide separate, insulated conductor within each feeder and branch circuit raceway. Terminate each end on suitable lug, bus, or bushing.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Provide field inspection in accordance with Section 01 4000. Inspect grounding and bonding system conductors and connections for tightness and proper installation
- C. Inspect and test in accordance with NETA ATS except Section 4.
- D. Perform inspections and tests listed in NETA ATS, Section 7.13.
- E. Perform ground electrode resistance tests under normally dry conditions. Precipitation within the previous 48 hours does not constitute normally dry conditions.
- F. Investigate and correct deficiencies where measured ground resistances do not comply with specified requirements.

3.04 COORDINATION

- A. Coordinate the work under this section with the work under other divisions of the specifications.

END OF SECTION

SECTION 26 0529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment components for equipment, conduit, cable, boxes, and other electrical work.

1.02 RELATED REQUIREMENTS

- A. Section 26 0534 - Conduit: Additional support and attachment requirements for conduits.
- B. Section 26 0537 - Boxes: Additional support and attachment requirements for boxes.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for non-metallic channel (strut) framing systems..
- C. Shop Drawings: Include details for fabricated hangers and supports where materials or methods other than those indicated are proposed for substitution.
- D. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.06 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. Comply with applicable building code.

1.07 RECORD DRAWINGS

- A. Comply with the applicable instructions in Section 26 0500.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of electrical work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported with a minimum safety factor of 50%. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Do not use products for applications other than as permitted by NFPA 70 and product listing.
 - 5. Do not use wire, chain, perforated pipe strap, or wood for permanent supports.
- B. Conduit and Cable Supports: Straps, clamps, etc. suitable for the conduit or cable to be supported.
 - 1. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
 - 2. Conduit Clamps: Bolted type unless otherwise indicated.
- C. Outlet Box Supports: Hangers, brackets, etc. suitable for the boxes to be supported.
- D. Non-Metallic Channel (Strut) Framing Systems: Factory-fabricated continuous-slot non-metallic channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Comply with MFMA-4.
 - 2. Channel Material:
 - a. Outdoor and Damp or Wet Indoor Locations: Use non-metallic.
- E. Anchors and Fasteners:
 - 1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
 - 2. Finish: Galvanized or painted steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install support and attachment components in a neat and workmanlike manner in accordance with NECA 1.

- C. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- E. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- F. Conduit Support and Attachment: Also comply with Section 26 0534.
- G. Box Support and Attachment: Also comply with Section 26 0537.
- H. Secure fasteners according to manufacturer's recommended torque settings.
- I. Remove temporary supports.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.
- E. Install hangers and supports as required to adequately and securely support electrical system components, in a neat and workmanlike manner, as specified in NECA 1 and fastended to the building structure.
 - 1. Do not use powder-actuated anchors
 - 2. Fabricate supports from structural steel or steel channel, rigidly welded or bolted to present a neat appearance. Use hexagon head bolts with spring lock washers under all nuts.

END OF SECTION

SECTION 26 0534 - CONDUIT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Liquidtight flexible metal conduit (LFMC).
- B. Electrical metallic tubing (EMT).
- C. Conduit fittings.
- D. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables.
- B. Section 26 0526 - Grounding and Bonding for Electrical Systems.
 - 1. Includes additional requirements for fittings for grounding and bonding.
- C. Section 26 0537 - Boxes.
- D. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.03 DESCRIPTION OF WORK

- A. Unless otherwise noted on the drawings or specified elsewhere in Division 26, route all conductors in conduit. The electrical plans indicate the general location of circuiting, electrical devices, and/or outlet boxes. If approved by the Engineer, conduit runs may be modified at the time of construction to adapt to the construction conditions, but in no case shall a circuit be combined with another circuit or modified.

1.04 FIRE ALARM SYSTEM RACEWAYS

- A. Wiring is not shown on the plans for the fire alarm system but shall be considered typical for the system around which the design is based. Provide raceways to fully accommodate system wiring, devices and equipment based on floor plan layouts and specifications.

1.05 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC); 2005.
- B. ANSI C80.3 - American National Standard for Steel Electrical Metallic Tubing (EMT); 2005.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- D. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT); National Electrical Contractors Association; 2006.
- E. NECA 111 - Standard for Installing Nonmetallic Raceways (RNC, ENT, LFNC); National Electrical Contractors Association; 2003.
- F. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; National Electrical Manufacturers Association; 2012 (ANSI/NEMA FB 1).
- G. NEMA TC 2 - Electrical Polyvinyl Chloride (PVC) Conduit; National Electrical Manufacturers Association; 2013.
- H. NEMA TC 3 - Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing; National Electrical Manufacturers Association; 2013.

- I. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- J. UL 1 - Flexible Metal Conduit; Current Edition, Including All Revisions.
- K. UL 6 - Electrical Rigid Metal Conduit-Steel; Current Edition, Including All Revisions.
- L. UL 360 - Liquid-Tight Flexible Steel Conduit; Current Edition, Including All Revisions.
- M. UL 514B - Conduit, Tubing, and Cable Fittings; Current Edition, Including All Revisions.
- N. UL 651 - Schedule 40 and 80 Rigid PVC Conduit and Fittings; Current Edition, Including All Revisions.
- O. UL 797 - Electrical Metallic Tubing-Steel; Current Edition, Including All Revisions.

1.06 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate minimum sizes of conduits with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate the arrangement of conduits with structural members, ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 3. Verify exact conduit termination locations required for boxes, enclosures, and equipment installed under other sections or by others.
 - 4. Coordinate the work with other trades to provide roof penetrations that preserve the integrity of the roofing system and do not void the roof warranty.
 - 5. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not begin installation of conductors and cables until installation of conduit is complete between outlet, junction and splicing points.

1.07 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conduits and fittings.

1.08 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.09 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 CONDUIT APPLICATIONS

- A. Do not use conduit and associated fittings for applications other than as permitted by NFPA 70 and product listing.

- B. Unless otherwise indicated and where not otherwise restricted, use the conduit types indicated for the specified applications. Where more than one listed application applies, comply with the most restrictive requirements. Where conduit type for a particular application is not specified, use galvanized steel rigid metal conduit.
- C. Exposed, Interior, Not Subject to Physical Damage: Use electrical metallic tubing (EMT).
- D. Connections to Vibrating Equipment:
 - 1. Damp, Wet, or Corrosive Locations: Use liquidtight flexible metal conduit.
 - 2. Maximum Length: 6 feet unless otherwise indicated.
 - 3. Vibrating equipment includes, but is not limited to:
 - a. HVAC equipment.

2.02 CONDUIT REQUIREMENTS

- A. Existing Work: Where existing conduits are indicated to be reused, they may be reused only where they comply with specified requirements, are free from corrosion, and integrity is verified by pulling a mandrel through them.
- B. Fittings for Grounding and Bonding: Also comply with Section 26 0526.
- C. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- D. Provide products listed, classified, and labeled as suitable for the purpose intended.
- E. Minimum Conduit Size, Unless Otherwise Indicated:
 - 1. Branch Circuits: 1/2 inch (16 mm) trade size.
 - 2. Branch Circuit Homeruns: 3/4 inch (21 mm) trade size.
 - 3. Control Circuits: 1/2 inch (16 mm) trade size.
 - 4. As shown on plans.
- F. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.03 LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC)

- A. Manufacturers:
 - 1. AFC Cable Systems, Inc: www.afcweb.com.
 - 2. Electri-Flex Company: www.electriflex.com.
 - 3. International Metal Hose: www.metalhose.com.
- B. Description: NFPA 70, Type LFMC polyvinyl chloride (PVC) jacketed steel flexible metal conduit listed and labeled as complying with UL 360.
- C. Fittings:
 - 1. Manufacturers:
 - a. Bridgeport Fittings Inc: www.bptfittings.com.
 - b. O-Z/Gedney, a brand of Emerson Industrial Automation: www.emersonindustrial.com.
 - c. Thomas & Betts Corporation: www.tnb.com.
 - 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 3. Material: Use steel or malleable iron.

4. Fittings shall be of the type that uses a threaded grounding cone, a steel, nylon or plastic compression ring, insulated throat, and a gland for tightening. Fittings shall be made of steel, have insulated throats and have a male thread and locknut or male bushing with a ring seal. Each connector shall provide a low resistance ground connection between the flexible conduit and the outlet box, conduit or other equipment to which it is connected.

2.04 ELECTRICAL METALLIC TUBING (EMT)

- A. Manufacturers:
 1. Allied Tube & Conduit: www.alliedeg.com.
 2. Republic Conduit: www.republic-conduit.com.
 3. Wheatland Tube Company: www.wheatland.com.
- B. Description: NFPA 70, Type EMT steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.
- C. Fittings:
 1. Manufacturers:
 - a. Bridgeport Fittings Inc: www.bptfittings.com.
 - b. O-Z/Gedney, a brand of Emerson Industrial Automation: www.emersonindustrial.com.
 - c. Thomas & Betts Corporation: www.tnb.com.
 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 3. Material: Use steel or malleable iron.
 4. Connectors and Couplings: Use compression (gland) or set-screw type.
 - a. Do not use indenter type connectors and couplings.
- D. Description: ANSI C80.3 [; galvanized tubing.]
- E. EMT connections shall be made tight to boxes and cabinets using insulated throat ferrous metal fittings specifically designed for use with EMT conduit. Use insulating insert at all joints to prevent any abrasion of wires during installation.
- F. For EMT installation encased in concrete, join EMT with moisture proof type fittings so as to be completely sealed against intrusion of moisture.

2.05 ACCESSORIES

- A. Corrosion Protection Tape: PVC-based, minimum thickness of 20 mil.
- B. Conduit Joint Compound: Corrosion-resistant, electrically conductive; suitable for use with the conduit to be installed.
- C. Solvent Cement for PVC Conduit and Fittings: As recommended by manufacturer of conduit and fittings to be installed.
- D. Pull Strings: Use nylon cord with average breaking strength of not less than 200 pound-force.
- E. Sealing Compound for Sealing Fittings: Listed for use with the particular fittings to be installed.
- F. Modular Seals for Conduit Penetrations: Rated for minimum of 40 psig; Suitable for the conduits to be installed.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install conduit in a neat and workmanlike manner in accordance with NECA 1.
- C. Install electrical nonmetallic tubing (ENT) in accordance with NECA 111.
- D. Install liquidtight flexible nonmetallic conduit (LFNC) in accordance with NECA 111.
- E. Conduit Routing:
 1. Unless dimensioned, conduit routing indicated is diagrammatic.
 2. When conduit destination is indicated and routing is not shown, determine exact routing required.
 3. Conceal all conduits unless specifically indicated to be exposed.
 4. Conduits in the following areas may be exposed, unless otherwise indicated:
 - a. Electrical rooms.
 - b. Mechanical equipment rooms.
 - c. Within joists in areas with no ceiling.
 5. Unless otherwise approved, do not route conduits exposed:
 - a. Across floors.
 - b. Across roofs.
 - c. Across top of parapet walls.
 6. Conduits installed underground or embedded in concrete may be routed in the shortest possible manner unless otherwise indicated. Route all other conduits parallel or perpendicular to building structure and surfaces, following surface contours where practical.
 7. Arrange conduit to maintain adequate headroom, clearances, and access.
 8. Arrange conduit to provide no more than the equivalent of four 90 degree bends between pull points.
 9. Arrange conduit to provide no more than 150 feet between pull points.
 10. Arrange conduit to prevent moisture traps. Provide drain fittings at low points and at sealing fittings where moisture may collect.
 11. Maintain minimum clearance of 6 inches between conduits and piping for other systems.
 12. Maintain minimum clearance of 12 inches between conduits and hot surfaces. This includes, but is not limited to:
 - a. Heaters.
 - b. Hot water piping.
- F. Conduit Support:
 1. Secure and support conduits in accordance with NFPA 70 and Section 26 0529 using suitable supports and methods approved by the authority having jurisdiction.

2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
 3. Use of spring steel conduit clips for support of conduits is not permitted.
 4. Use of wire for support of conduits is not permitted.
 5. Where conduit support intervals specified in NFPA 70 and NECA standards differ, comply with the most stringent requirements.
- G. Connections and Terminations:
1. Use suitable adapters where required to transition from one type of conduit to another.
 2. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
 3. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- H. Penetrations:
1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 2. Make penetrations perpendicular to surfaces unless otherwise indicated.
 3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
 4. Conceal bends for conduit risers emerging above ground.
 5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
 6. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
- I. Provide pull string in all empty conduits and in conduits where conductors and cables are to be installed by others. Leave minimum slack of 12 inches at each end.
- J. Provide grounding and bonding in accordance with Section 26 0526.
- K. Identify conduits in accordance with Section 26 0553.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Correct deficiencies and replace damaged or defective conduits.

3.04 CLEANING

- A. Clean interior of conduits to remove moisture and foreign matter.

3.05 PROTECTION

- A. Immediately after installation of conduit, use suitable manufactured plugs to provide protection from entry of moisture and foreign material and do not remove until ready for installation of conductors.
- B. Maintain 6" clearance between conduit and other piping system. Maintain 12 inch clearance between conduit and surfaces with temperatures exceeding 104 degrees F.
- C. Use hydraulic one-shot conduit bender or factory elbows for bends in conduit larger than 1-1/2 inch size.

- D. For terminating threaded conduit into a device or box without a threaded opening, use a locknut on both sides of the device, box, or enclosure with the conduit end fitted with an insulating bushing.
- E. Use flexible metal conduit in short runs where the installation of non flexible conduit is not possible or recommended, for final connection to vibrating equipment and transformers, and from outlet boxes to recessed lighting fixtures. Slack shall be included as required. Furnish with ground conductor for line and load connections. Minimum size shall be 1/2" with the exception of 3/8" light fixture whips no more than 6' long.
- F. Liquid tight flexible conduit shall be used for connections to motors, and for final connection to all kitchen equipment. Furnish with ground conductor for line and load connections.
- G. If obstructions are encountered which prevent installation of the pull wire and/or conductors, the blocked section of raceway shall be removed and replaced. Any cutting or patching involved in such replacement will be included as a part of the electrical scope of work and included in the contract.
- H. Install a ground wire in all conduit sized where noted on the drawings and where not noted sized per the applicable requirements of the NEC.

3.06 CONDUIT SIZES

- A. Size conduit for conductor type installed; 1/2 inch minimum size except all voice and data conduit shall be minimum 3/4".
- B. For all sizes of conduit larger than 1-1/2 inches, use factory elbows, unless otherwise specified herein. In smaller sizes, field bends will be permitted but care must be taken not to damage the conduit. The radius of the inner curve of any bend shall not be less than that permitted by the NEC.
- C. Where conduit sizes are not shown on the drawings, provide conduit sizes in accordance with the 2011 National Electric Code and equipment manufacturers' recommendations.
- D. Minimum sizes of conduits where size is not shown on the plans shall be as follows:

1. Area Of Installation	Minimum Size
a. In grade	3/4"
b. Exposed	3/4"
c. Flexible conduit	1/2"
- E. The outside diameter of any conduit buried in concrete shall not exceed one-third the thickness of the structural slab, wall or beam in which it is placed. Conduit shall be located within the middle of the member.

3.07 CONDUIT SUPPORTS

- A. Arrange supports to prevent misalignment during wiring installation.
- B. Fasten conduit supports to building structure and surfaces under provisions of Section 26 0529.
- C. Do not support conduit with wire or perforated pipe straps. Remove wire used for temporary supports.
- D. Do not attach conduit to ceiling support wires.

- E. Support conduit maximum 5' on center.

END OF SECTION

SECTION 26 0537 - BOXES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches, including those used as junction and pull boxes.

1.02 RELATED REQUIREMENTS

- A. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- B. Section 26 0534 - Conduit:
 - 1. Conduit bodies and other fittings.
 - 2. Additional requirements for locating boxes to limit conduit length and/or number of bends between pulling points.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; National Electrical Contractors Association; 2010.
- C. NEMA OS 2 - Nonmetallic Outlet Boxes, Device Boxes, Covers and Box Supports; National Electrical Manufacturers Association; 2013 (ANSI/NEMA OS 2).
- D. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); National Electrical Manufacturers Association; 2014.
- E. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 514C - Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 - 3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
 - 4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
 - 5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
 - 6. Coordinate the work with other trades to preserve insulation integrity.

7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for outlet and device boxes, junction and pull boxes, and floor boxes.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- D. Project Record Documents: Record actual dimensioned locations for outlet and device boxes, junction boxes, pull boxes, cabinets and enclosures, and floor boxes.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 3. Provide products listed, classified, and labeled as suitable for the purpose intended.
 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches, Including Those Used as Junction and Pull Boxes:
 1. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 2. Use nonmetallic boxes where exposed rigid PVC conduit is used.
 3. Nonmetallic Boxes: Comply with NEMA OS 2, and list and label as complying with UL 514C.
 4. Minimum Box Size, Unless Otherwise Indicated:
 - a. Wiring Devices (Other Than Communications Systems Outlets): 4 inch square by 1-1/2 inch deep (100 by 38 mm) trade size.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.

- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Unless otherwise indicated, provide separate boxes for line voltage and low voltage systems.
- E. Box Locations:
 - 1. Locate junction and pull boxes as indicated, as required to facilitate installation of conductors, and to limit conduit length and/or number of bends between pulling points.
- F. Box Supports:
 - 1. Secure and support boxes in accordance with NFPA 70 and Section 26 0529 using suitable supports and methods approved by the authority having jurisdiction.
- G. Install boxes plumb and level.
- H. Install boxes as required to preserve insulation integrity.
- I. Provide grounding and bonding in accordance with Section 26 0526.
- J. Identify boxes in accordance with Section 26 0553.
- K. Junctions and pull boxes are not generally shown on the plans. Install in locations as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and as required by NFPA 70.
 - 1. Adjust box locations up to 10 feet if required to accommodate intended purpose. Review the Contract Documents, especially Architectural Elevations and millwork shop drawings to determine appropriate locations for boxes.
- L. Use gang box where more than one device is mounted together. Do not use sectional box. Use barriers to separate wiring of different voltages.
- M. Install plugs, and other inserts to cover all unused conduit openings.
- N. Mark all boxes on the outside as to the circuit/system they serve.

3.03 CLEANING

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.

3.04 PROTECTION

- A. Immediately after installation, protect boxes from entry of moisture and foreign material until ready for installation of conductors.

END OF SECTION

SECTION 26 0553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Wire and cable markers.
- D. Voltage markers.
- E. Underground warning tape.
- F. Warning signs and labels.

1.02 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs; 2011.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels; 2011.
- C. NFPA 70E - Standard for Electrical Safety in the Workplace; 2012.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
 - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
 - 2. Do not install identification products until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. Shop Drawings: Provide schedule of items to be identified indicating proposed designations, materials, legends, and formats.
- B. Samples:
 - 1. Identification Nameplates: One of each type and color specified.
 - 2. Warning Signs and Labels: One of each type and legend specified.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation and installation of product.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.07 FIELD CONDITIONS

- A. Do not install adhesive products when ambient temperature is lower than recommended by manufacturer.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
 - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
 - a. Enclosed switches:
 - 1) Identify voltage and phase.
 - 2) Identify power source and circuit number. Include location when not within sight of equipment.
 - 3) Identify load(s) served. Include location when not within sight of equipment.
- B. Identification for Conductors and Cables:
 - 1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 0519.
 - 2. Use identification nameplate or identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.
 - 3. Use wire and cable markers to identify circuit number or other designation indicated for power, control, and instrumentation conductors and cables at the following locations:
 - a. At each source and load connection.
 - b. Within boxes when more than one circuit is present.
 - c. Within equipment enclosures when conductors and cables enter or leave the enclosure.
- C. Identification for Boxes:
 - 1. Use voltage markers to identify highest voltage present.
 - 2. Use voltage markers or color coded boxes to identify systems other than normal power system.
 - a. For exposed boxes in public areas, do not color code.
 - 3. Use identification labels or handwritten text using indelible marker to identify circuits enclosed.

2.02 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
 - 1. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch high; Four, located at corners for larger sizes.
- B. Identification Labels:
 - 1. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 - a. Use only for indoor locations.
 - 2. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.

2.03 WIRE AND CABLE MARKERS

- A. Markers for Conductors and Cables: Use wrap-around self-adhesive vinyl cloth or wrap-around self-adhesive vinyl self-laminating type markers suitable for the conductor or cable to be identified.
- B. Legend: Power source and circuit number or other designation indicated.
- C. Text: Use factory pre-printed or machine-printed text, all capitalized unless otherwise indicated.
- D. Minimum Text Height: 1/8 inch.
- E. Color: Black text on white background unless otherwise indicated.

2.04 WIRE PHASE MARKING

- A. Description: Plastic colored tape or integrally pigmented colored wire.
- B. Locations: Each conductor at panelboard gutters, pull boxes, Starters, and outlet boxes and each load or supply connection where a feeder terminates.
- C. Legend
 - 1. Feeders and Branch Circuits: Color code for the respective voltage system as described in Section 26 0519 - Low Voltage Electrical Power Conductors and Cables.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
 - 1. Surface-Mounted Equipment: Enclosure front.
 - 2. Flush-Mounted Equipment: Inside of equipment door.
 - 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
 - 4. Elevated Equipment: Legible from the floor or working platform.
 - 5. Branch Devices: Adjacent to device.
 - 6. Interior Components: Legible from the point of access.
 - 7. Conduits: Legible from the floor.
 - 8. Boxes: Outside face of cover.
 - 9. Conductors and Cables: Legible from the point of access.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.
- F. Mark all handwritten text, where permitted, to be neat and legible.

3.03 FIELD QUALITY CONTROL

- A. Replace self-adhesive labels and markers that exhibit bubbles, wrinkles, curling or other signs of improper adhesion.

END OF SECTION

SECTION 26 2416 - PANELBOARDS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Overcurrent protective devices for panelboards.

1.02 RELATED REQUIREMENTS

- A. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- B. Section 26 0529 - Hangers and Supports for Electrical Systems.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. FS W-C-375 - Circuit Breakers, Molded Case; Branch Circuit and Service; Federal Specification; Revision E, 2013.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- C. NECA 407 - Standard for Installing and Maintaining Panelboards; National Electrical Contractors Association; 2009.
- D. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2014.
- E. NEMA KS 1 - Heavy Duty Enclosed and Dead-Front Switches (600 Volts Maximum); National Electrical Manufacturers Association; 2013.
- F. NEMA PB 1 - Panelboards; National Electrical Manufacturers Association; 2011.
- G. NEMA PB 1.1 - General Instructions for Proper Installation, Operation and Maintenance of Panelboards Rated 600 Volts or Less; National Electrical Manufacturers Association; 2013 (ANSI/NEMA PB 1.1).
- H. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; International Electrical Testing Association; 2013 (ANSI/NETA ATS).
- I. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- J. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations; Current Edition, Including All Revisions.
- K. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations; Current Edition, Including All Revisions.
- L. UL 67 - Panelboards; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.

2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
3. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted panelboards where indicated.
4. Verify with manufacturer that conductor terminations are suitable for use with the conductors to be installed.
5. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures and Section 26 0500 - General Electrical Requirements.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for panelboards, enclosures, overcurrent protective devices, and other installed components and accessories.
- C. Shop Drawings: Indicate outline and support point dimensions, voltage, main bus ampacity, overcurrent protective device arrangement and sizes, short circuit current ratings, conduit entry locations, conductor terminal information, and installed features and accessories.
- D. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- E. Project Record Documents: Record actual installed locations of panelboards and actual installed circuiting arrangements.
- F. Maintenance Data: Include information on replacement parts and recommended maintenance procedures and intervals.
- G. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 1. See Section 01 6000 - Product Requirements, for additional provisions.
 2. Panelboard Keys: Two of each different key.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store panelboards in accordance with manufacturer's instructions and NECA 407.
- B. Store in a clean, dry space. Maintain factory wrapping or provide an additional heavy canvas or heavy plastic cover to protect units from dirt, water, construction debris, and traffic.
- C. Handle carefully in accordance with manufacturer's written instructions to avoid damage to panelboard internal components, enclosure, and finish.

1.08 FIELD CONDITIONS

- A. Maintain ambient temperature within the following limits during and after installation of panelboards:
 1. Panelboards Containing Circuit Breakers: Between 23 degrees F and 104 degrees F.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Eaton Corporation; Cutler-Hammer Products: www.eaton.com.
- B. General Electric Company: www.geindustrial.com.
- C. Schneider Electric; Square D Products: www.schneider-electric.us.
- D. Substitutions: See Section 01 6000 - Product Requirements.

2.02 LIGHTING AND APPLIANCE PANELBOARDS

- A. Conductor Terminations:
 - 1. Main and Neutral Lug Material: Copper, suitable for terminating copper conductors only.
 - 2. Main and Neutral Lug Type: Mechanical.
- B. Circuit Breakers: Thermal magnetic bolt-on type unless otherwise indicated.
- C. Molded Case Circuit Breakers: Thermal magnetic trip circuit breakers, bolt-on type, with common trip handle for all poles; UL listed.
 - 1. Do not use tandem circuit breakers.

2.03 OVERCURRENT PROTECTIVE DEVICES

- A. Molded Case Circuit Breakers:
 - 1. Description: Quick-make, quick-break, over center toggle, trip-free, trip-indicating circuit breakers listed and labeled as complying with UL 489, and complying with FS W-C-375 where applicable; ratings, configurations, and features as indicated on the drawings.
 - 2. Interrupting Capacity:
 - a. Provide circuit breakers with interrupting capacity as required to provide the short circuit current rating indicated, but not less than:
 - 1) 10,000 rms symmetrical amperes at 240 VAC or 208 VAC.
 - 2) 14,000 rms symmetrical amperes at 480 VAC.
 - b. Fully Rated Systems: Provide circuit breakers with interrupting capacity not less than the short circuit current rating indicated.
 - 3. Conductor Terminations:
 - a. Provide compression lugs where indicated.
 - b. Lug Material: Copper, suitable for terminating copper conductors only.
 - 4. Do not use tandem circuit breakers.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that the ratings and configurations of the panelboards and associated components are consistent with the indicated requirements.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide required supports in accordance with Section 26 0529.

- C. Provide grounding and bonding in accordance with Section 26 0526.
- D. Install all field-installed branch devices, components, and accessories.
- E. Provide typed or neatly handwritten circuit directory for each branch circuit panelboard. Revise directory to reflect circuiting changes required to balance phase loads.

3.03 PANELBOARD DIRECTORIES

- A. Provide typed circuit directory for each circuit breaker in each panelboard.
- B. The typed directory shall include the room number location of the load served. (EXAMPLE: 36 - Lights:204,206.....14 - Receptacles:RM 115.....6 - Electric Unit Heater:173) Room numbers shall be the room numbers as on the room door, not the space numbers as shown on the plans.

3.04 FIELD QUALITY CONTROL

- A. Perform inspection, testing, and adjusting in accordance with Section 01 4000.
- B. Visual and Mechanical Inspection: Inspect for physical damage, proper alignment, anchorage, and grounding. Check proper installation and tightness of connections for circuit breakers, fusible switches, and fuses.
- C. Perform field inspection and testing in accordance with Section 01 4000.
- D. Inspect and test in accordance with NETA ATS, except Section 4.
- E. Correct deficiencies and replace damaged or defective panelboards or associated components.
- F. Perform inspections and tests listed in NETA STD ATS, Section 7.5 for switches, Section 7.6 for circuit breakers.

3.05 ADJUSTING

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings.
- B. Adjust alignment of panelboard fronts.

3.06 CLEANING

- A. Clean dirt and debris from panelboard enclosures and components according to manufacturer's instructions.

END OF SECTION

SECTION 26 2726 - WIRING DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall switches.
- B. Wall dimmers.

1.02 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables : Manufactured wiring systems for use with access floor boxes with compatible pre-wired connectors .
- B. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- C. Section 26 0537 - Boxes.
- D. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; National Electrical Contractors Association; 2010.
- C. NEMA WD 1 - General Color Requirements for Wiring Devices; National Electrical Manufacturers Association; 1999 (R 2010).
- D. NEMA WD 5 - Specific-Purpose Wiring Devices.
- E. NEMA WD 6 - Wiring Device -- Dimensional Specifications; National Electrical Manufacturers Association; 2002 (R2008).
- F. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 514D - Cover Plates for Flush-Mounted Wiring Devices; Current Edition, Including All Revisions.
- H. UL 1472 - Solid-State Dimming Controls; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate wiring device ratings and configurations with the electrical requirements of actual equipment to be installed.
 - 2. Notify Architect of any conflicts or deviations from the contract documents to obtain direction prior to proceeding with work.
- B. Sequencing:
 - 1. Do not install wiring devices until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

- B. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in original manufacturer's packaging until ready for installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Leviton Manufacturing Company, Inc: www.leviton.com.
- B. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us
- C. Substitutions: See Section 01 6000 - Product Requirements.
- D. Source Limitations: Where possible, for each type of wiring device furnish products produced by a single manufacturer and obtained from a single supplier.

2.02 WIRING DEVICE APPLICATIONS

- A. Provide wiring devices suitable for intended use and with ratings adequate for load served.
- B. Unless noted otherwise, do not use combination switch/receptacle devices.

2.03 WIRING DEVICE FINISHES:

- A. Provide wiring device finishes as described below unless otherwise indicated.
- B. Wiring Devices, Unless Otherwise Indicated: Black with stainless steel wall plate.

2.04 WALL SWITCHES

- A. Manufacturers:
 - 1. Leviton Manufacturing Company, Inc; : www.leviton.com.
 - 2. Pass & Seymour, a brand of Legrand North America, Inc; : www.legrand.us
- B. Standard Wall Switches: Commercial specification grade, 20 A, 120 V with standard toggle type switch actuator and maintained contacts; single pole single throw, double pole single throw, three way, or four way as indicated on the drawings.
 - 1. Products:
 - a. P&S 20AC1.

2.05 WALL DIMMERS

- A. Manufacturers:
 - 1. Leviton Manufacturing Company, Inc; _____: www.leviton.com.
 - 2. Lutron Electronics Company, Inc; Maestro Series: www.lutron.com.
 - 3. Pass & Seymour, a brand of Legrand North America, Inc; _____: www.legrand.us

- B. All Wall Dimmers: Solid-state with continuous full-range even control following square law dimming curve, integral radio frequency interference filtering, power failure preset memory, air gap switch accessible without removing wall plate, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 1472; types and ratings suitable for load controlled as indicated on the drawings.
- C. Control: Slide control type with separate on/off switch.
- D. Electronic Low-Voltage Wall Dimmers: 120 V AC, slide control type with separate on/off switch; single pole or three way as indicated on the drawings.
 - 1. Power Rating: 400 VA unless otherwise indicated or required to control the load indicated on the drawings.
- E. Fluorescent Wall Dimmers: 120 V AC, slide control type with separate on/off switch, compatible with the dimming ballast controlled; single pole or three way as indicated on the drawings.
 - 1. Power Rating: 5 to 16 amps but as a minimum for the rated load to which the are shown connected.
 - 2. Make compatible with the dimming ballast used. Provide a dimming ballast for all the light fixtures shown controlled by a dimming switch.
 - 3. Luminaires: Furnish a dimming ballast for all luminaires shown controlled with a wall dimmer.
 - 4. Dimming Range: 1% to 100%.
 - 5. Lamps: Compatible with dimming ballasts and controls.

2.06 WALL PLATES

- A. Manufacturers:
 - 1. Leviton Manufacturing Company, Inc; : www.leviton.com.
 - 2. Lutron Electronics Company, Inc: www.lutron.com.
 - 3. Pass & Seymour, a brand of Legrand North America, Inc; www.legrand.us
- B. All Wall Plates: Comply with UL 514D.
 - 1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 - 2. Size: Standard; Use jumbo size for brick or block construction.
 - 3. Screws: Metal with slotted heads finished to match wall plate finish.
- C. Stainless Steel Wall Plates: Brushed satin finish, Type 302 stainless steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.
- E. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.

- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.
- B. Coordinate locations of outlet boxes provided under Section 26 0537 as required for installation of wiring devices provided under this section.
 - 1. Mounting Heights: Unless otherwise indicated, as follows:
 - a. Wall Switches: 48 inches above finished floor.
 - b. Wall Dimmers: 48 inches above finished floor.
 - 2. Locate wall switches on strike side of door with edge of wall plate 3 inches from edge of door frame. Where locations are indicated otherwise, notify Architect to obtain direction prior to proceeding with work.
- C. Install wiring devices in accordance with manufacturer's instructions.
- D. Where required, connect wiring devices using pigtails not less than 6 inches long. Do not connect more than one conductor to wiring device terminals.
- E. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- F. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- G. Install wiring devices plumb and level with mounting yoke held rigidly in place.
- H. Do not share neutral conductor on branch circuits utilizing wall dimmers.
- I. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.
- J. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.
- K. Identify wiring devices in accordance with Section 26 0553.

3.03 INTERFACE WITH OTHER PRODUCTS

- A. Coordinate locations of outlet boxes provided under Section 26 0537 to obtain mounting heights specified.

3.04 FIELD QUALITY CONTROL

- A. Perform field inspection, testing, and adjusting in accordance with Section 01 4000.
- B. Inspect each wiring device for damage and defects.
- C. Operate each wall switch with circuit energized to verify proper operation.
- D. Correct wiring deficiencies and replace damaged or defective wiring devices.

3.05 ADJUSTING

- A. Adjust devices and wall plates to be flush and level.
- B. Adjust presets for wall dimmers according to manufacturer's instructions as directed by Architect.

END OF SECTION

SECTION 26 5100 - INTERIOR LIGHTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Interior luminaires.
- B. Exit signs.
- C. Fluorescent dimming ballasts and controls.
- D. Lamps.
- E. Luminaire accessories.

1.02 RELATED REQUIREMENTS

- A. Section 26 0537 - Boxes.
- B. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- C. Section 26 2726 - Wiring Devices: Manual wall switches and wall dimmers.

1.03 REFERENCE STANDARDS

- A. ANSI C78.379 - American National Standard for Electric Lamps -- Reflector Lamps -- Classification of Beam Patterns; 2006.
- B. ANSI C82.11 - American National Standard for Lamp Ballasts - High Frequency Fluorescent Lamp Ballasts - Supplements; 2011.
- C. NECA/IESNA 500 - Standard for Installing Indoor Commercial Lighting Systems; National Electrical Contractors Association; 2006.
- D. NEMA WD 6 - Wiring Devices - Dimensional Requirements; National Electrical Manufacturers Association; 2002 (R2008).
- E. FS W-F-414 - Fixture, Lighting.
- F. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. NFPA 101 - Life Safety Code; National Fire Protection Association; 2012.
- H. UL 935 - Fluorescent-Lamp Ballasts; Current Edition, Including All Revisions.
- I. UL 1598 - Luminaires; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the installation of luminaires with mounting surfaces installed under other sections or by others. Coordinate the work with placement of supports, anchors, etc. required for mounting. Coordinate compatibility of luminaires and associated trims with mounting surfaces at installed locations. Do not rely on catalog numbers for such information.
 - 2. Coordinate the placement of luminaires with structural members, ductwork, piping, equipment, diffusers, fire suppression system components, and other potential conflicts installed under other sections or by others.

3. Coordinate the placement of exit signs with furniture, equipment, signage or other potential obstructions to visibility installed under other sections or by others.
4. If only one fixture shown on the plans in a room or within a group of fixtures is labeled the remainder of the fixtures in the room or within the group shall be considered to be the same except where obvious to the contrary.
5. Notify Architect of any conflicts or deviations from the contract documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings:
 1. Indicate dimensions and components for each luminaire that is not a standard product of the manufacturer.
- C. Product Data: Provide manufacturer's standard catalog pages and data sheets including detailed information on luminaire construction, dimensions, ratings, finishes, mounting requirements, listings, service conditions, photometric performance, installed accessories, and ceiling compatibility; include model number nomenclature clearly marked with all proposed features.
- D. Additional information required on submitted data sheet:
 1. Fixture Type
 2. Catalog Number
 3. Ballast Type
 4. Lamp Type
 5. Coefficients of Utilization
 6. Candle power distribution charts
 7. Zonal Lumen Summary charts
 8. Options selected
 9. Description of fixture construction

In addition to a paper copy of the data or specification sheet provide on a PDF of the technical specification sheet and the product brochure for each light fixture.

- E. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- F. Operation and Maintenance Data: Instructions for each product including information on replacement parts.
- G. Project Record Documents: Record actual connections and locations of luminaires and any associated remote components.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Receive, handle, and store products according to NECA/IESNA 500 (commercial lighting) and manufacturer's written instructions.
- B. Keep products in original manufacturer's packaging and protect from damage until ready for installation.

1.08 FIELD CONDITIONS

- A. Maintain field conditions within manufacturer's required service conditions during and after installation.

1.09 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Provide two year manufacturer warranty for all linear fluorescent ballasts.
- C. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Light Fixtures:
 - 1. As scheduled on the drawings.
- B. Lamps:
 - 1. General Electric
 - 2. Sylvania
 - 3. Phillips Lighting
- C. Substitutions: See Section 01 6000 - Product Requirements.

2.02 LUMINAIRE TYPES

- A. Furnish products as indicated in luminaire schedule included on the drawings.
- B. Catalog numbers are for general identification of fixtures only. It is the responsibility of the Contractor to provide complete catalog numbers and to provide all accessories for installation as implied by the accompanying description of the fixture, the demonstrated use on the drawings, and the specifications contained herein.

2.03 LUMINAIRES

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products that are listed and labeled as complying with UL 1598, where applicable.
- C. Provide products listed, classified, and labeled as suitable for the purpose intended.
- D. Unless otherwise indicated, provide complete luminaires including lamp(s) and all sockets, ballasts, reflectors, lenses, housings and other components required to position, energize and protect the lamp and distribute the light.
- E. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, hardware, supports, trims, accessories, etc. as necessary for a complete operating system.

- F. The voltages of all light fixtures shall be determined by the circuit to which each light fixture is connected. Refer to the circuiting requirements shown on the drawings, in particular the lighting plans and panelboard schedules, to determine the voltage required. While in most cases light fixtures require only one voltage, there are cases where a light fixture must be provided in multiple voltages. It is the responsibility of the Contractor to determine where this occurs and provide fixtures in the voltages required.
- G. Provide products suitable to withstand normal handling, installation, and service without any damage, distortion, corrosion, fading, discoloring, etc.
- H. Lamp Sockets:
 - 1. Fluorescent sockets shall be the biting edge type or phosphorous-bronze with silver flash contact surface type and shall conform to the applicable requirements of UL 542 and ANSI C-81. Lamp holders for bi-pin lamps, with the exception of those for "U" type lamps, shall be of the telescoping compression type, or of the single slot entry type requiring a one-quarter turn of the lamp after insertion.
- I. Recessed Luminaires:
 - 1. Ceiling Compatibility: Comply with NEMA LE 4.
 - 2. Luminaires Recessed in Insulated Ceilings: Listed and labeled as IC-rated, suitable for direct contact with insulation and combustible materials.
- J. Fluorescent Luminaires:
 - 1. Provide ballast disconnecting means complying with NFPA 70 where required.
 - 2. Fluorescent Luminaires Controlled by Dual-Level Switching: Provide with stepped-dimming ballast.
 - a. Luminaires with Four Lamps: One ballast controls two outer lamps and one ballast controls two inner lamps.
- K. Luminaires Mounted in Continuous Rows: Provide quantity of units required for length indicated, with all accessories required for joining and aligning.

2.04 EXIT SIGNS

- A. All Exit Signs: Internally illuminated with LEDs unless otherwise indicated; complying with NFPA 101 and all applicable state and local codes, and listed and labeled as complying with UL 924.
 - 1. Number of Faces: Single or double as indicated or as required for the installed location.
 - 2. Directional Arrows: As indicated or as required for the installed location.
- B. Accessories:
 - 1. Provide compatible accessory high impact polycarbonate vandal shields where indicated.
 - 2. Provide compatible accessory wire guards where indicated.
- C. Exit Signs: Exit sign fixture suitable for use as emergency lighting unit.
 - 1. Provide fixtures complying with NFPA 101.
 - 2. Lamps: LED.
 - 3. Mounting: As indicated.

2.05 BALLASTS AND DRIVERS

- A. Manufacturers:

1. Manufacturer Limitations: Where possible, for each type of luminaire provide ballasts produced by a single manufacturer.
 2. Where a specific manufacturer or model is indicated elsewhere in the luminaire schedule or on the drawings, substitutions are not permitted unless explicitly indicated.
- B. All Ballasts:
1. Provide ballasts containing no polychlorinated biphenyls (PCBs).
 2. Minimum Efficiency/Efficacy: Provide ballasts complying with all current applicable federal and state ballast efficiency/efficacy standards.
 3. Ballasts shall be accessible for servicing without removing or dismantling the fixtures. Each fluorescent ballast serving lamps 30 watts and larger shall be bolted to the fixture body or housing with four studs or captive screws.
 4. Ballasts shall be equipped with color coded QUICK-CONNECT horizontal wiretap connectors on each end of the ballast housing for ease of installation. Ballasts shall be serviceable while the fixture is in its normally installed position, and shall not be mounted to removable reflectors or wireway covers unless so specified.
- C. Fluorescent Ballasts:
1. All Fluorescent Ballasts: Unless otherwise indicated, provide high frequency electronic ballasts complying with ANSI C82.11 and listed and labeled as complying with UL 935.
 - a. Input Voltage: Suitable for operation at voltage of connected source, with variation tolerance of plus or minus 10 percent.
 - b. Total Harmonic Distortion: Not greater than 20 percent.
 - c. Power Factor: Not less than 0.95.
 - d. Ballast Factor: Normal ballast factor between 0.85 and 1.15, unless otherwise indicated.
 - e. Thermal Protection: Listed and labeled as UL Class P, with automatic reset for integral thermal protectors.
 - f. Sound Rating: Class A, suitable for average ambient noise level of 20 to 24 decibels.
 - g. Lamp Compatibility: Specifically designed for use with the specified lamp, with no visible flicker.
 - h. Lamp Operating Frequency: Greater than 20 kHz, except as specified below.
 - 1) Do not operate lamp(s) within the frequencies from 30 kHz through 40 kHz in order to avoid interference with infrared devices.
 - i. Lamp Wiring Method:
 - 1) Instant Start Ballasts: Parallel wired. (All fixtures except where not available or compatible with installation requirements.)
 - 2) Rapid Start Ballasts: Series wired.
 - 3) Programmed Start Ballasts: Provide parallel or series/parallel wired where available; otherwise series wired is acceptable.
 - j. Provide automatic restart capability to restart replaced lamp(s) without requiring resetting of power.
 - k. Provide high efficiency T8 lamp ballasts certified as NEMA premium.
 - l. Ballast Marking: Include wiring diagrams with lamp connections.
 2. Non-Dimming Fluorescent Ballasts:
 - a. Lamp Starting Method:
 - 1) T8 Lamp Ballasts: Instant start unless otherwise indicated.

- b. Lamp Starting Temperature: Capable of starting standard lamp(s) at a minimum of 0 degrees F, and energy saving lamp(s) at a minimum of 60 degrees F unless otherwise indicated.
3. Dimming Fluorescent Ballasts:
 - a. Provide a dimming ballast for all light fixtures for which a dimming control is shown or where shown as part of a dimming system.
 - b. Dimming Range: Continuous dimming from 100 percent to one percent relative light output unless dimming capability to lower level is indicated, without flicker and with even tracking across multiple lamps.
 - c. Control Compatibility: Fully compatible with the dimming controls to be installed.
 - 1) Wall Dimmers: See Section 26 2726.
 - d. Lamp Starting Method: Programmed start unless otherwise indicated.
 - e. Lamp Starting Temperature: Capable of starting lamp(s) at a minimum of 50 degrees F.
 - f. Dimmed Lamp Starting: Capable of starting lamp(s) at any dimmed preset without transitioning first to full light output.

2.06 LAMPS

- A. Manufacturers:
 1. Manufacturer Limitations: Where possible, provide lamps produced by a single manufacturer.
- B. Lamps - General Requirements:
 1. Unless explicitly excluded, provide new, compatible, operable lamps in each luminaire.
 2. Verify compatibility of specified lamps with luminaires to be installed. Where lamps are not specified, provide lamps per luminaire manufacturer's recommendations.
 3. Minimum Efficiency: Provide lamps complying with all current applicable federal and state lamp efficiency standards.
 4. Color Temperature Consistency: Unless otherwise indicated, for each type of lamp furnish products which are consistent in perceived color temperature. Replace lamps that are determined by the Architect to be inconsistent in perceived color temperature.
- C. Linear Fluorescent Lamps: Wattage and bulb type as indicated, with base type as required for luminaire.
 1. Low Mercury Content: Provide lamps that pass the EPA Toxicity Characteristic Leaching Procedure (TCLP) test for characteristic hazardous waste.
 2. T8 Linear Fluorescent Lamps:
 - a. Correlated Color Temperature (CCT): 4,100 K unless otherwise indicated.
 - b. Color Rendering Index (CRI): Not less than 80.
 - c. Average Rated Life: Not less than 20,000 hours for an operating cycle of three hours per start.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate conductors in accordance with NFPA 70.

- C. Verify that suitable support frames are installed where required.
- D. Verify that branch circuit wiring installation is completed, tested, and ready for connection to luminaires.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Coordinate locations of outlet boxes provided under Section 26 0537 as required for installation of luminaires provided under this section.
- B. Install products according to manufacturer's instructions.
- C. Install luminaires securely, in a neat and workmanlike manner, as specified in NECA 1 (general workmanship) and NECA 500 (commercial lighting).
- D. Install luminaires plumb and square and aligned with building lines and with adjacent luminaires.
- E. Suspended Ceiling Mounted Luminaires:
 - 1. Do not use ceiling tiles to bear weight of luminaires.
 - 2. Do not use ceiling support system to bear weight of luminaires unless ceiling support system is certified as suitable to do so.
 - 3. Secure surface-mounted and recessed luminaires to ceiling support channels or framing members or to building structure.
 - 4. Secure lay-in luminaires to ceiling support channels using listed safety clips at four corners.
 - 5. In addition to ceiling support wires, provide two galvanized steel safety wire(s), minimum 12 gage, connected from opposing corners of each recessed luminaire to building structure.
- F. Recessed Luminaires:
 - 1. Install trims tight to mounting surface with no visible light leakage.
 - 2. Non-IC Rated Luminaires: Maintain required separation from insulation and combustible materials according to listing.
 - 3. Luminaires Recessed in Fire-Rated Ceilings: Install using accessories and firestopping materials to meet regulatory requirements for fire rating.
- G. Additional Support Requirements:
 - 1. Anchoring: Anchor light fixtures to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
 - 2. Supports or anchors shall maintain the fixture positions after cleaning and relamping.
 - 3. Support the lighting fixtures without causing the ceiling or partition to deflect.
 - 4. All light fixtures shall be attached to suspended ceiling grid systems at two opposing ends using screws and/or clips approved for the seismic rating of the ceiling. Follow state and local codes that may require fixtures to be screwed to the ceiling supports instead of using clips.
 - 5. Fixtures weighing less than 10 pounds shall be directly supported with a minimum of one #12 gage hanger wire to the structure above. This wire may be slack.
 - 6. Fixtures weighing between 11 to 55 pounds shall be directly supported with a minimum of two #12 gage hanger wires connected from the fixture housing to the structure above.

- Connect the hangers at diagonal opposite corners of the light fixtures. These wires may be slack.
7. Where fixtures weigh over 56 pounds they shall be independently supported from the building structure by approved hangers. Two-way angular bracing of hangers shall be provided to prevent lateral motion.
 8. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
 9. Outlet boxes for support of lighting fixtures where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gage wire hanger, and secured by approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.
- H. Install accessories furnished with each luminaire.
- I. Make wiring connections to branch circuit using building wire with insulation suitable for temperature conditions within fixture; use flexible conduit.
- J. Connect luminaires and exit signs to branch circuit outlets provided under Section 26 0537 using flexible conduit.
- K. Bond products and metal accessories to branch circuit equipment grounding conductor.
- L. Exit Signs:
 1. Unless otherwise indicated, connect unit to unswitched power from circuit indicated. Bypass local switches, contactors, or other lighting controls.
 2. Install lock-on device on branch circuit breaker serving units.
- M. Install lamps in each luminaire.
- N. Lamp Burn-In: Operate lamps at full output for prescribed period per manufacturer's recommendations prior to use with any dimming controls. Replace lamps that fail prematurely due to improper lamp burn-in.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect each product for damage and defects.
- C. Mask the trims and bottoms of all lighting fixtures if necessary to protect the fixture during construction.
- D. Operate each luminaire after installation and connection to verify proper operation.
- E. Correct wiring deficiencies and repair or replace damaged or defective products. Repair or replace excessively noisy ballasts as determined by Architect.

3.04 ADJUSTING

- A. Exit Signs with Field-Selectable Directional Arrows: Set as indicated or as required to properly designate egress path as directed by Architect or authority having jurisdiction.

3.05 CLEANING

- A. Clean electrical parts to remove conductive and deleterious materials. This shall include but not necessarily be limited to fixture bottoms, trims, lenses, baffles, reflector cones and lamps.

- B. Remove dirt and debris from enclosures.
- C. Clean finishes and touch up damage.

3.06 CLOSEOUT ACTIVITIES


- A. See Section 01 7800 - Closeout Submittals, for closeout submittals.
- B. See Section 01 7900 - Demonstration and Training, for additional requirements.
- C. Demonstration: Demonstrate proper operation of luminaires to Architect, and correct deficiencies or make adjustments as directed.
- D. Just prior to Substantial Completion, replace all lamps that have failed.

3.07 PROTECTION

- A. Protect installed luminaires from subsequent construction operations.


END OF SECTION

ELECTRICAL SYMBOL SCHEDULE	
SYMBOL	DESCRIPTION
LP1-2,4	BRANCH CIRCUIT RACEWAY. RUN CONCEALED IN CEILING, WALLS OR OTHER BUILDING ELEMENTS. ARROWHEAD DENOTES HOMERUN TO PANEL. INSTALL GROUND WIRE IN ALL RACEWAYS. UNLESS OTHERWISE NOTED, INSTALL #12 WIRING FOR THE NUMBER OF CIRCUITS INDICATED. WHERE A CIRCUIT BREAKER IS SHOWN FOR THE EQUIPMENT, WIRING SHALL MATCH CIRCUIT BREAKER RATING AS A MINIMUM AND MEET APPLICABLE CODES.
LP1-2,4	BRANCH CIRCUIT RACEWAY. RUN IN AND UNDER FLOOR SLAB. ARROWHEAD DENOTES HOMERUN TO PANEL. INSTALL GROUND WIRE IN ALL RACEWAYS. UNLESS OTHERWISE NOTED, INSTALL #12 WIRING FOR THE NUMBER OF CIRCUITS INDICATED. WHERE A CIRCUIT BREAKER IS SHOWN FOR THE EQUIPMENT, WIRING SHALL MATCH CIRCUIT BREAKER RATING AS A MINIMUM AND MEET APPLICABLE CODES.
10,0	CEILING MOUNTED FLUORESCENT LIGHT FIXTURE. LETTER DENOTES TYPE OF FIXTURE. SEE FIXTURE SCHEDULE. NUMBER DENOTES CIRCUIT NUMBER. SEE REFLECTED CEILING PLAN. "cb" IDENTIFIES THE SWITCH(ES) WHICH CONTROL THE FIXTURE. TWO LETTERS INDICATE MULTIPLE BALLASTS/LAMPS AND MULTIPLE CONTROL FOR MULTI-LEVEL SWITCHING. WIRE SUCH FIXTURES TO ACCOMMODATE THE SWITCHING.
04	EXIT SIGN. REFER TO FIXTURE SCHEDULE. DARKENED AREA DENOTES SIGN FACE. NUMBER DENOTES CIRCUIT NUMBER. STEM DESIGNATES WALL MOUNTING. NO STEM DENOTES CEILING MOUNTED.
20A	LIGHT SWITCH, SPST, 20A.
3-WAY 20A	LIGHT SWITCH, 3-WAY, 20A.
1500 WATT, SLIDER TYPE 20A	DIMMER SWITCH, 48" AFF, 1500 WATT, SLIDER TYPE, 20A.
	ELECTRICAL CIRCUIT BREAKER PANELBOARD.
ABBREVIATIONS	
AF	AMPERE.
AFT	ABOVE FINISHED FLOOR.
BKR	BREAKER.
CD	CONDUIT.
CKT	CIRCUIT.
EC	ELECTRICAL CONTRACTOR, DIVISION 26.
JB or J-BOX	JUNCTION BOX.
KVA	KILOVOLT AMPERES.
KL	KILOHOUR.
MC	MECHANICAL CONTRACTOR, DIVISION 23.
MDP	MAIN DISTRIBUTION PANEL.
NFPA	2011 NATIONAL ELECTRICAL CODE (NFPA 70).

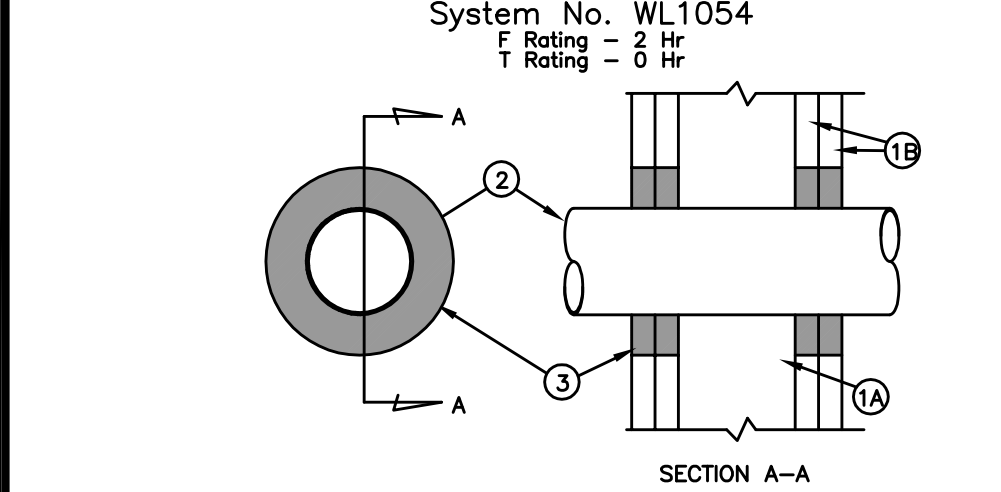


- Wall Assembly - The fire-rated gypsum wallboard/ceiling assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs - Wall framing may consist of either wood or steel channel studs. Wood studs to consist of nominal 2 in. x 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC.
 - Wallboard, Gypsum - Two layers of 5/8 in. thick gypsum wallboard, as specified in the individual Wall and Partition Design. Max depth of opening is 12-1/2 in. One metallic pipe, conduit or tubing to be centered within the firestop system. An annular space of min 1/2 in. to max 7/8 in. is required within firestop system. Pipe conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipe, conduit or tubing may be used:
 - Steel Pipe - Nom 10 in. diam (or smaller) Schedule 10 or heavier steel pipe.
 - Conduit - Nom 4 in. diam (or smaller) electrical metallic tubing or steel conduit.
 - Copper Tubing - Nom 4 in. diam (or smaller) Type L or heavier copper tubing.
 - Copper Pipe - Nom 4 in. diam (or smaller) Regular (or heavier) copper pipe.
 - Fill Void or Gully Material - Sealed - Min 1-1/4 in. thickness of fire-rated material applied within the annulus, flush with both surfaces of wall. IB Construction Chemicals, Inc. - FS01 Sealant.

1 TWO HOUR WALL PENETRATION

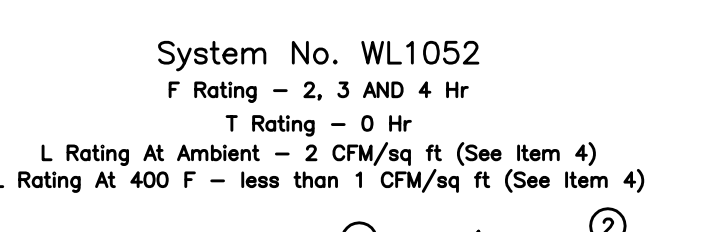


- Wall Assembly - Light weight or normal weight (100-150 pcf) concrete. Min. thickness of concrete floor or wall assembly is 4-1/2 in. for 2 hr F Rating and 1-1/2 in. for 1 hr F Rating. Wall may also be constructed of any UL Classified Concrete Block. Max depth of circular opening is 13-1/2 in. See Concrete Blocks (Tables) in the Fire Resistance Directory for names of manufacturers.
 - Steel Pipe or Conduit - Nom 12 in. diam (or smaller) Schedule 10 or heavier steel pipe, nom 6 in. diam (or smaller) steel conduit or nom 4 in. diam (or smaller) steel DMF. Min one pipe or conduit per opening, centered in opening. Min clearance between pipe or conduit and side of opening is 1/4 in. Min clearance between pipe or conduit and side of through opening is 1-1/4 in. for 2 hr F Rating and 3/4 in. for 1 hr F Rating. Pipe or conduit to be rigidly supported on both sides of floor or wall assembly.
 - Fill Void or Gully Material - Wrap Strip - Nom 1/4 in. thick, high modulus, elastomeric material faced on one side with aluminum foil, supplied in 2 in. wide strips. For the 2 and 3 hr F Ratings, min 1 in. wide strip(s) wrapped around pipe/conduit (full side exposed) until OD of wrap strip is equal to or max 3/16 in. less than ID of circular through opening. Wrap strip tightly bound with steel wire or pressure sensitive tape and slit into through opening such that the top edge of the wrap strip(s) is recessed 1/4 in. from the top surface of floor or, in wall assemblies, such that the wrap strip(s) is centered in the wall thickness. For the 1 hr F Rating, nom 2 in. wide strip(s) wrapped around pipe/conduit (full side exposed) on each side of the floor or wall assembly until OD of wrap strip is equal to or max 3/16 in. less than ID of circular through opening. Wrap strip tightly bound with steel wire or pressure sensitive tape and slit into through opening on each side of floor or wall assembly such that the exposed edges are recessed 1/4 in. from the floor or wall surfaces. Minnesota Mining & Mfg. Co. - Types PS-195, PS-195A
 - Fill Void or Gully Material - Caulk - Nom 1/4 in. thickness of caulk to be applied to the exposed edges of the wrap strip and to fill all voids between the pipe/conduit and the periphery of the through opening. For 2 or 3 hour F rating in floor assemblies, caulk to be installed flush with top surface of floor. For wall assemblies and for the 4 hour F Rating in floor assemblies, caulk to be applied to both sides of assembly. Minnesota Mining & Mfg. Co. - Types CP-25 S/L, CP-25 N/S, CP-25 WB, CP-25 WB+. (Note: L Ratings apply only when "bearing" the UL Classification Marking.)

2 3 & 4 HOUR WALL PENETRATION

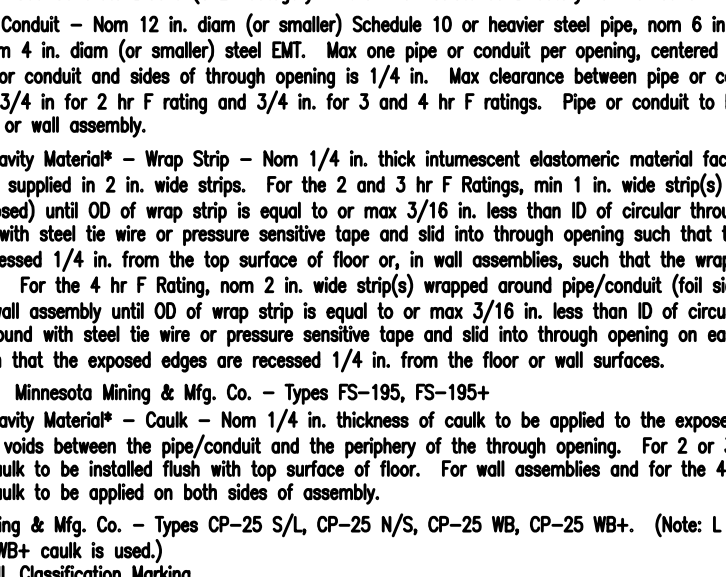


- Wall Assembly - The fire-rated gypsum wallboard/ceiling assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs - Wall framing may consist of either wood or steel channel studs. Wood studs to consist of nominal 2 in. x 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC.
 - Wallboard, Gypsum - Two layers of 5/8 in. thick gypsum wallboard, as specified in the individual Wall and Partition Design. Max depth of opening is 12 in. One metallic pipe, conduit or tubing to be centered within the firestop system. Pipe conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipe, conduit or tubing may be used:
 - Steel Pipe - Nom 10 in. diam (or smaller) Schedule 10 or heavier steel pipe.
 - Conduit - Nom 4 in. diam (or smaller) electrical metallic tubing or steel conduit.
 - Copper Tubing - Nom 4 in. diam (or smaller) Type L or heavier copper tubing.
 - Copper Pipe - Nom 4 in. diam (or smaller) Regular (or heavier) copper pipe.
 - Fill Void or Gully Material - Sealed - Min 5/8 in. thickness of fire-rated material applied within the annulus, flush with both surfaces of wall.

ONE HOUR WALL PENETRATION

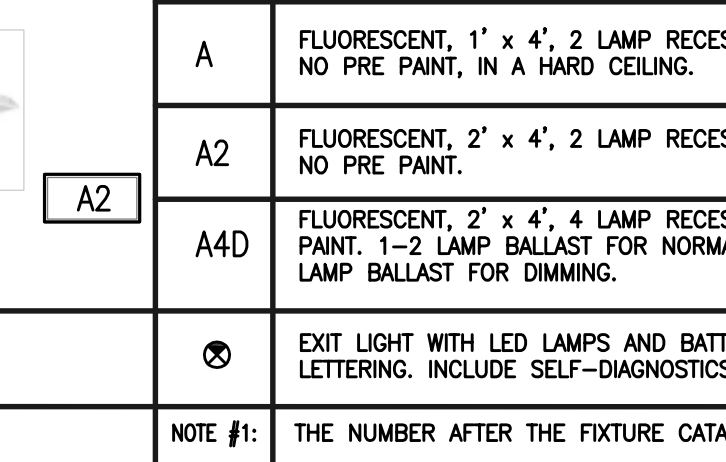


- Wall Assembly - The fire-rated gypsum wallboard/ceiling assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs - Wall framing may consist of either wood or steel channel studs. Wood studs to consist of nominal 2 in. x 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC.
 - Wallboard, Gypsum - Two layers of 5/8 in. thick gypsum wallboard, as specified in the individual Wall and Partition Design. Max depth of opening is 12 in. One metallic pipe, conduit or tubing to be centered within the firestop system. Pipe conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipe, conduit or tubing may be used:
 - Steel Pipe - Nom 10 in. diam (or smaller) Schedule 10 or heavier steel pipe.
 - Conduit - Nom 4 in. diam (or smaller) electrical metallic tubing or steel conduit.
 - Copper Tubing - Nom 4 in. diam (or smaller) Type L or heavier copper tubing.
 - Copper Pipe - Nom 4 in. diam (or smaller) Regular (or heavier) copper pipe.
 - Fill Void or Gully Material - Sealed - Min 5/8 in. thickness of fire-rated material applied within the annulus, flush with both surfaces of wall.

RECESSED LIGHTING FIXTURE DETAIL

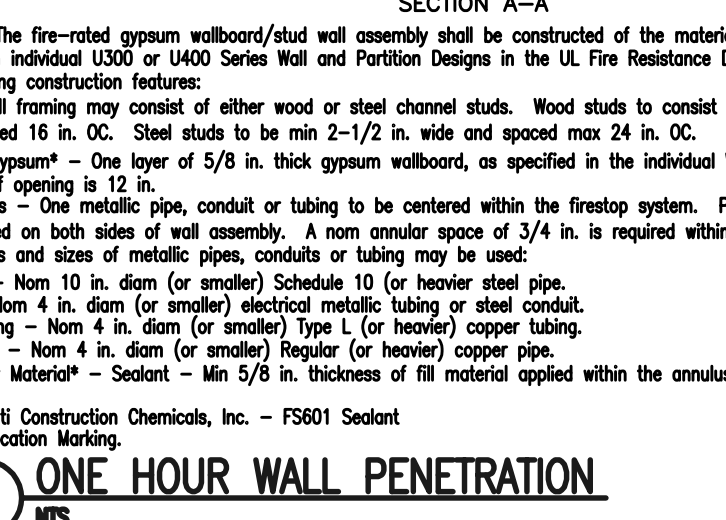


- Wall Assembly - The fire-rated gypsum wallboard/ceiling assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:
 - Studs - Wall framing may consist of either wood or steel channel studs. Wood studs to consist of nominal 2 in. x 4 in. lumber spaced 16 in. OC. Steel studs to be min 2-1/2 in. wide and spaced max 24 in. OC.
 - Wallboard, Gypsum - Two layers of 5/8 in. thick gypsum wallboard, as specified in the individual Wall and Partition Design. Max depth of opening is 12 in. One metallic pipe, conduit or tubing to be centered within the firestop system. Pipe conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipe, conduit or tubing may be used:
 - Steel Pipe - Nom 10 in. diam (or smaller) Schedule 10 or heavier steel pipe.
 - Conduit - Nom 4 in. diam (or smaller) electrical metallic tubing or steel conduit.
 - Copper Tubing - Nom 4 in. diam (or smaller) Type L or heavier copper tubing.
 - Copper Pipe - Nom 4 in. diam (or smaller) Regular (or heavier) copper pipe.
 - Fill Void or Gully Material - Sealed - Min 5/8 in. thickness of fire-rated material applied within the annulus, flush with both surfaces of wall.

PROJECT AREA

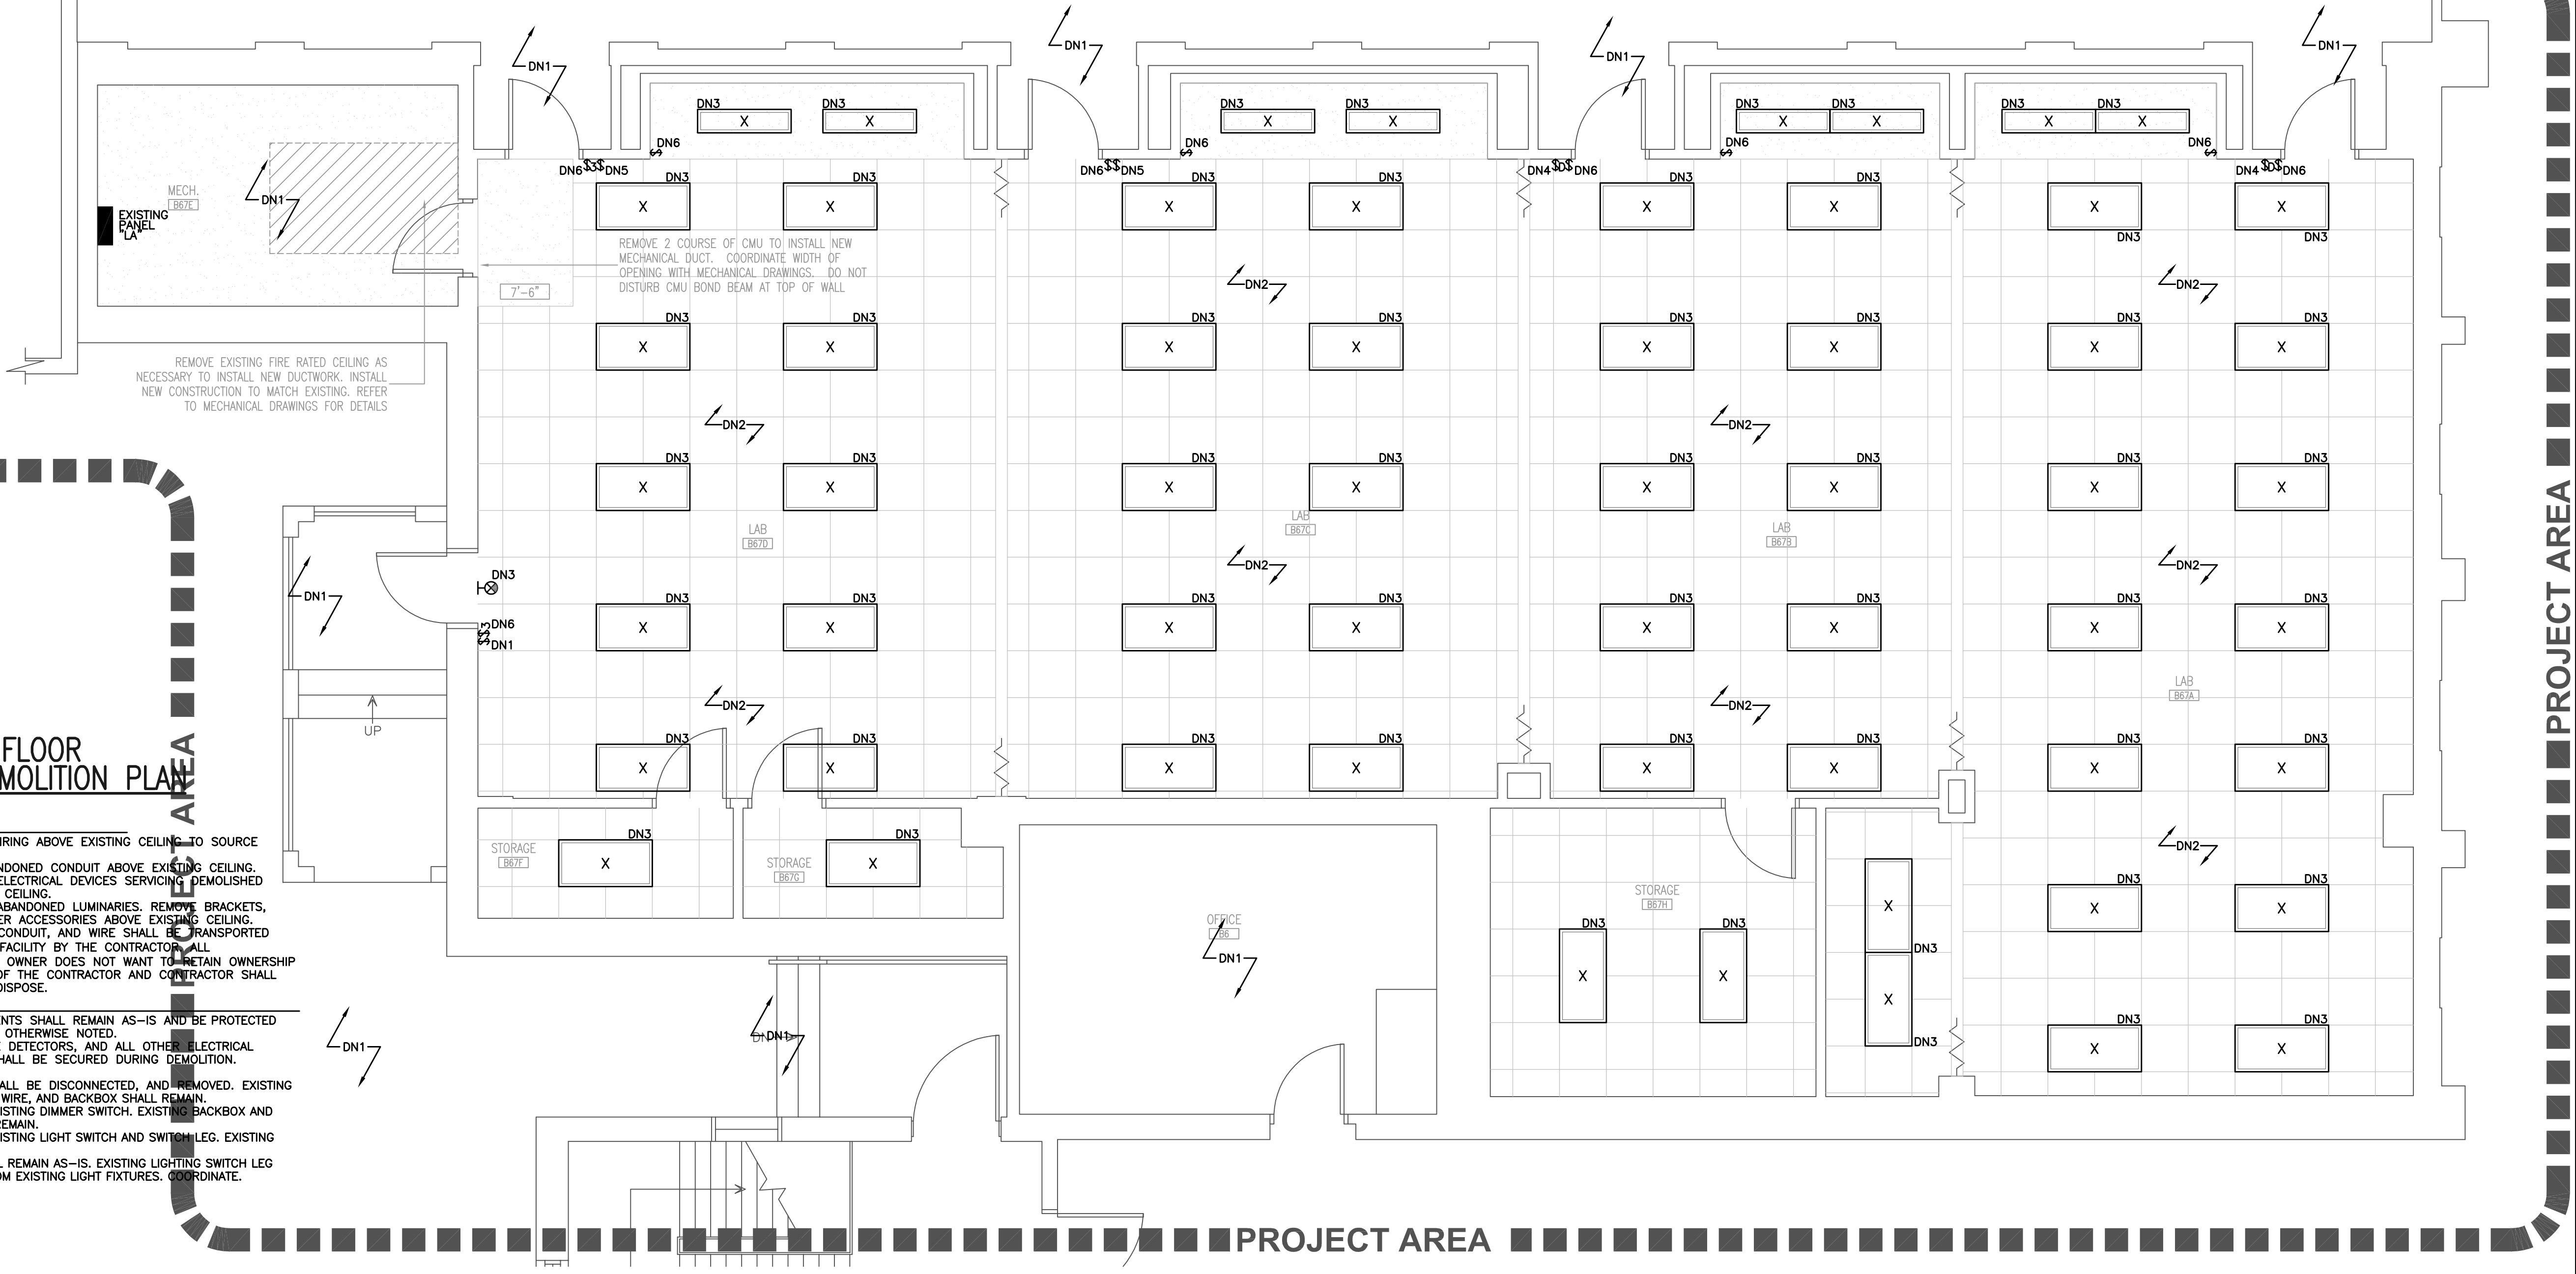

PROJECT AREA

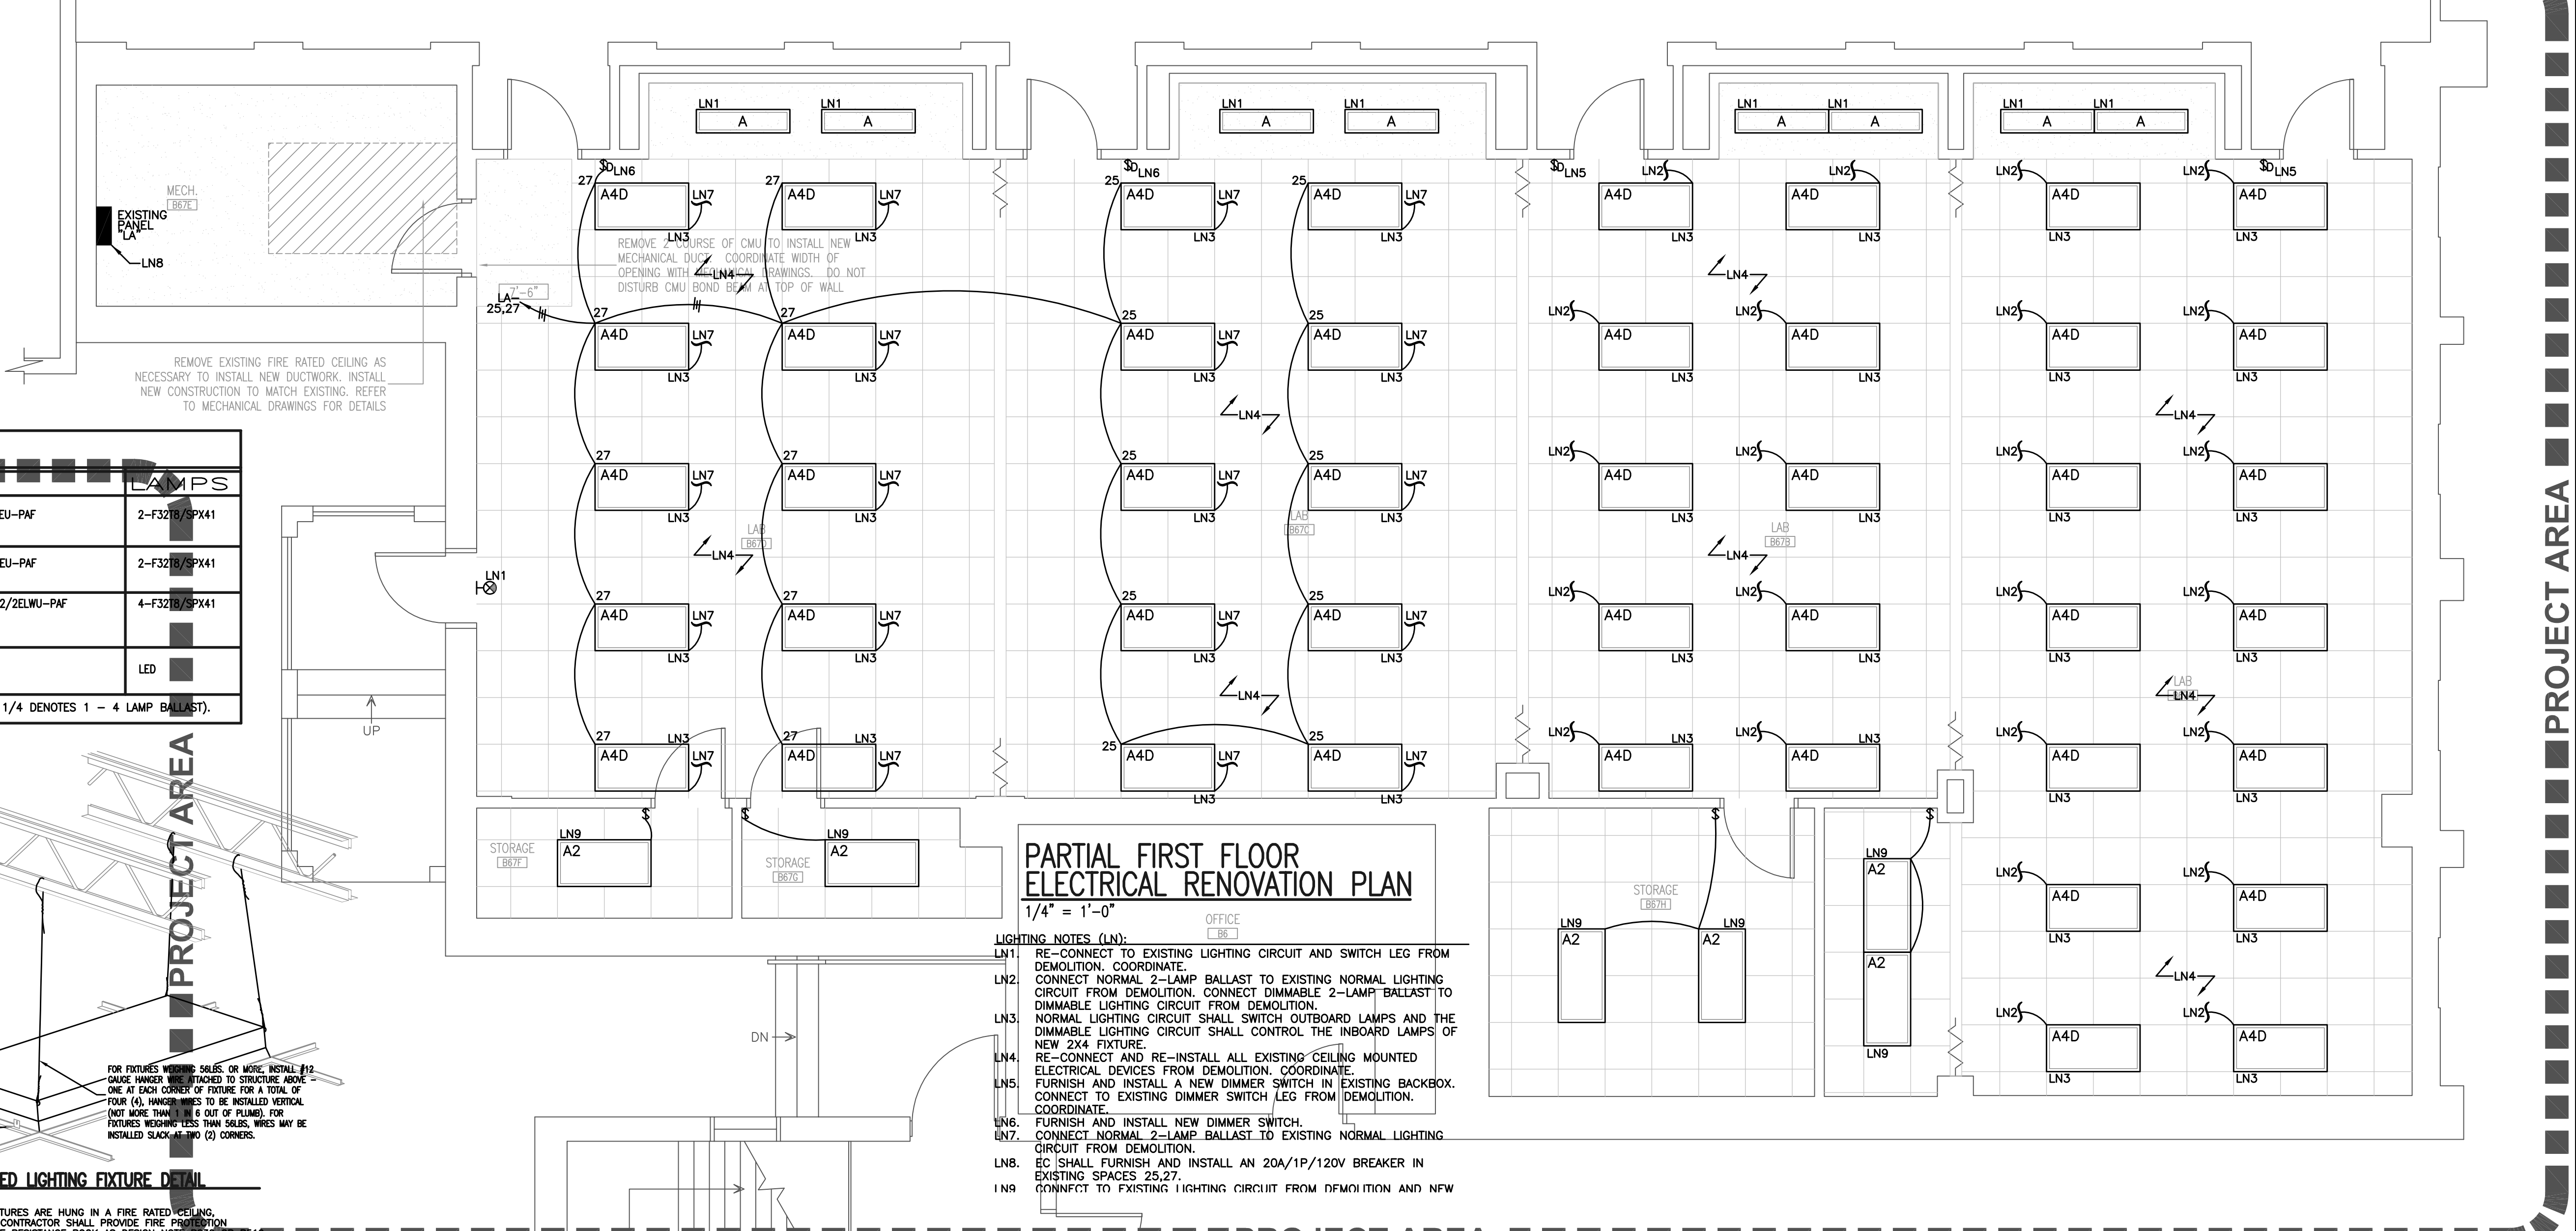

PROJECT AREA

ALL RIGHTS RESERVED. THIS DRAWING AND THE DESIGN SHOWN THEREON ARE COPYRIGHTED AS PROVIDED BY THE LAWS OF THE UNITED STATES AND ARE THE PROPERTY OF GMK ASSOCIATES ARCHITECTURAL DIVISION. ANY DUPLICATION, REPRODUCTION OR CAUSING TO BE REPRODUCED THE WHOLE OR PART OF THESE DRAWINGS OR THE DESIGN THEREON WITHOUT PERMISSION OF THE ARCHITECT WILL BE SUBJECT TO LEGAL ACTION.

consultants



project name
University of South Carolina
School of Medicine - Microscopy Lab
Upgrades
State Project # H27-6106
A/E project number
14054.01

seals/signature


ISSUED FOR CONSTRUCTION

date
MAY 12, 2015

number
ADENDUM #1
DATE
5/21/15

NO.	DATE	REVISION

key plan

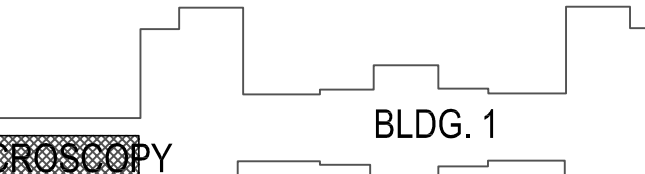

sheet title
**PARTIAL FIRST FLOOR
ELECTRICAL DEMOLITION
AND RENOVATION PLAN
ALTERNATE #1**

sheet number

E2.1

drawn by TLK
checked by JBF