



DRAWING INDEX	
R-001	COVER SHEET
R-101	ROOF PLAN
R-201	ROOF DETAILS

ABBREVIATION LIST	
MAX.	MAXIMUM
MIN.	MINIMUM
N.I.C.	NOT IN CONTRACT
N.T.S.	NOT TO SCALE
O.C.	ON CENTER
S.S.	STAINLESS STEEL
SIM.	SIMILAR
TERM.	TERMINATION
TYP.	TYPICAL

COLISEUM ROOF REPAIR

UNIVERSITY OF SOUTH CAROLINA
 701 ASSEMBLY STREET
 COLUMBIA, SC 29201
 STATE PROJECT NO. H27-Z232

ROOFING, WATERPROOFING & BUILDING
 ENVELOPE ENGINEERS & CONSULTANTS
 www.reiengineers.com

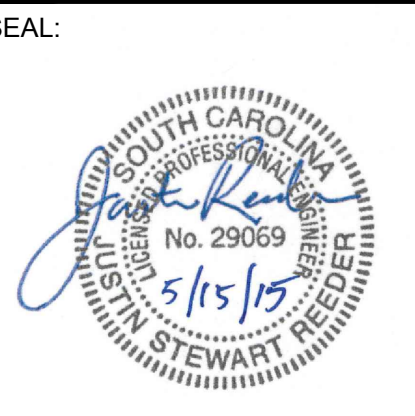

COLISEUM ROOF REPAIR
 UNIVERSITY OF SOUTH CAROLINA
 COLUMBIA, SC
 REI PROJECT #: 15CHS-030

REVISION #	REVISION DATE
1	
2	
3	
4	


DRAWN BY: CGB
 SCALE: N.T.S.
 DATE: 05/15/2015

DRAWING:
R-001
 SHEET 1 OF 3
 COVER SHEET

These documents are the property of REI Engineers, Inc. (REI) and retains all rights therein, including copyrights. It may only be used in a manner consistent with REI's rights while REI is providing service for the specific project identified or referred to herein or extensions thereto. It may not be used for any other purpose except with the express written agreement of, and compensation to, REI Engineers, Inc.

SECTOR	AREA (SQUARE FEET)
A	±89,100
TOTAL	±89,100

CONTRACTOR TO VERIFY ALL QUANTITIES PRIOR TO BIDDING

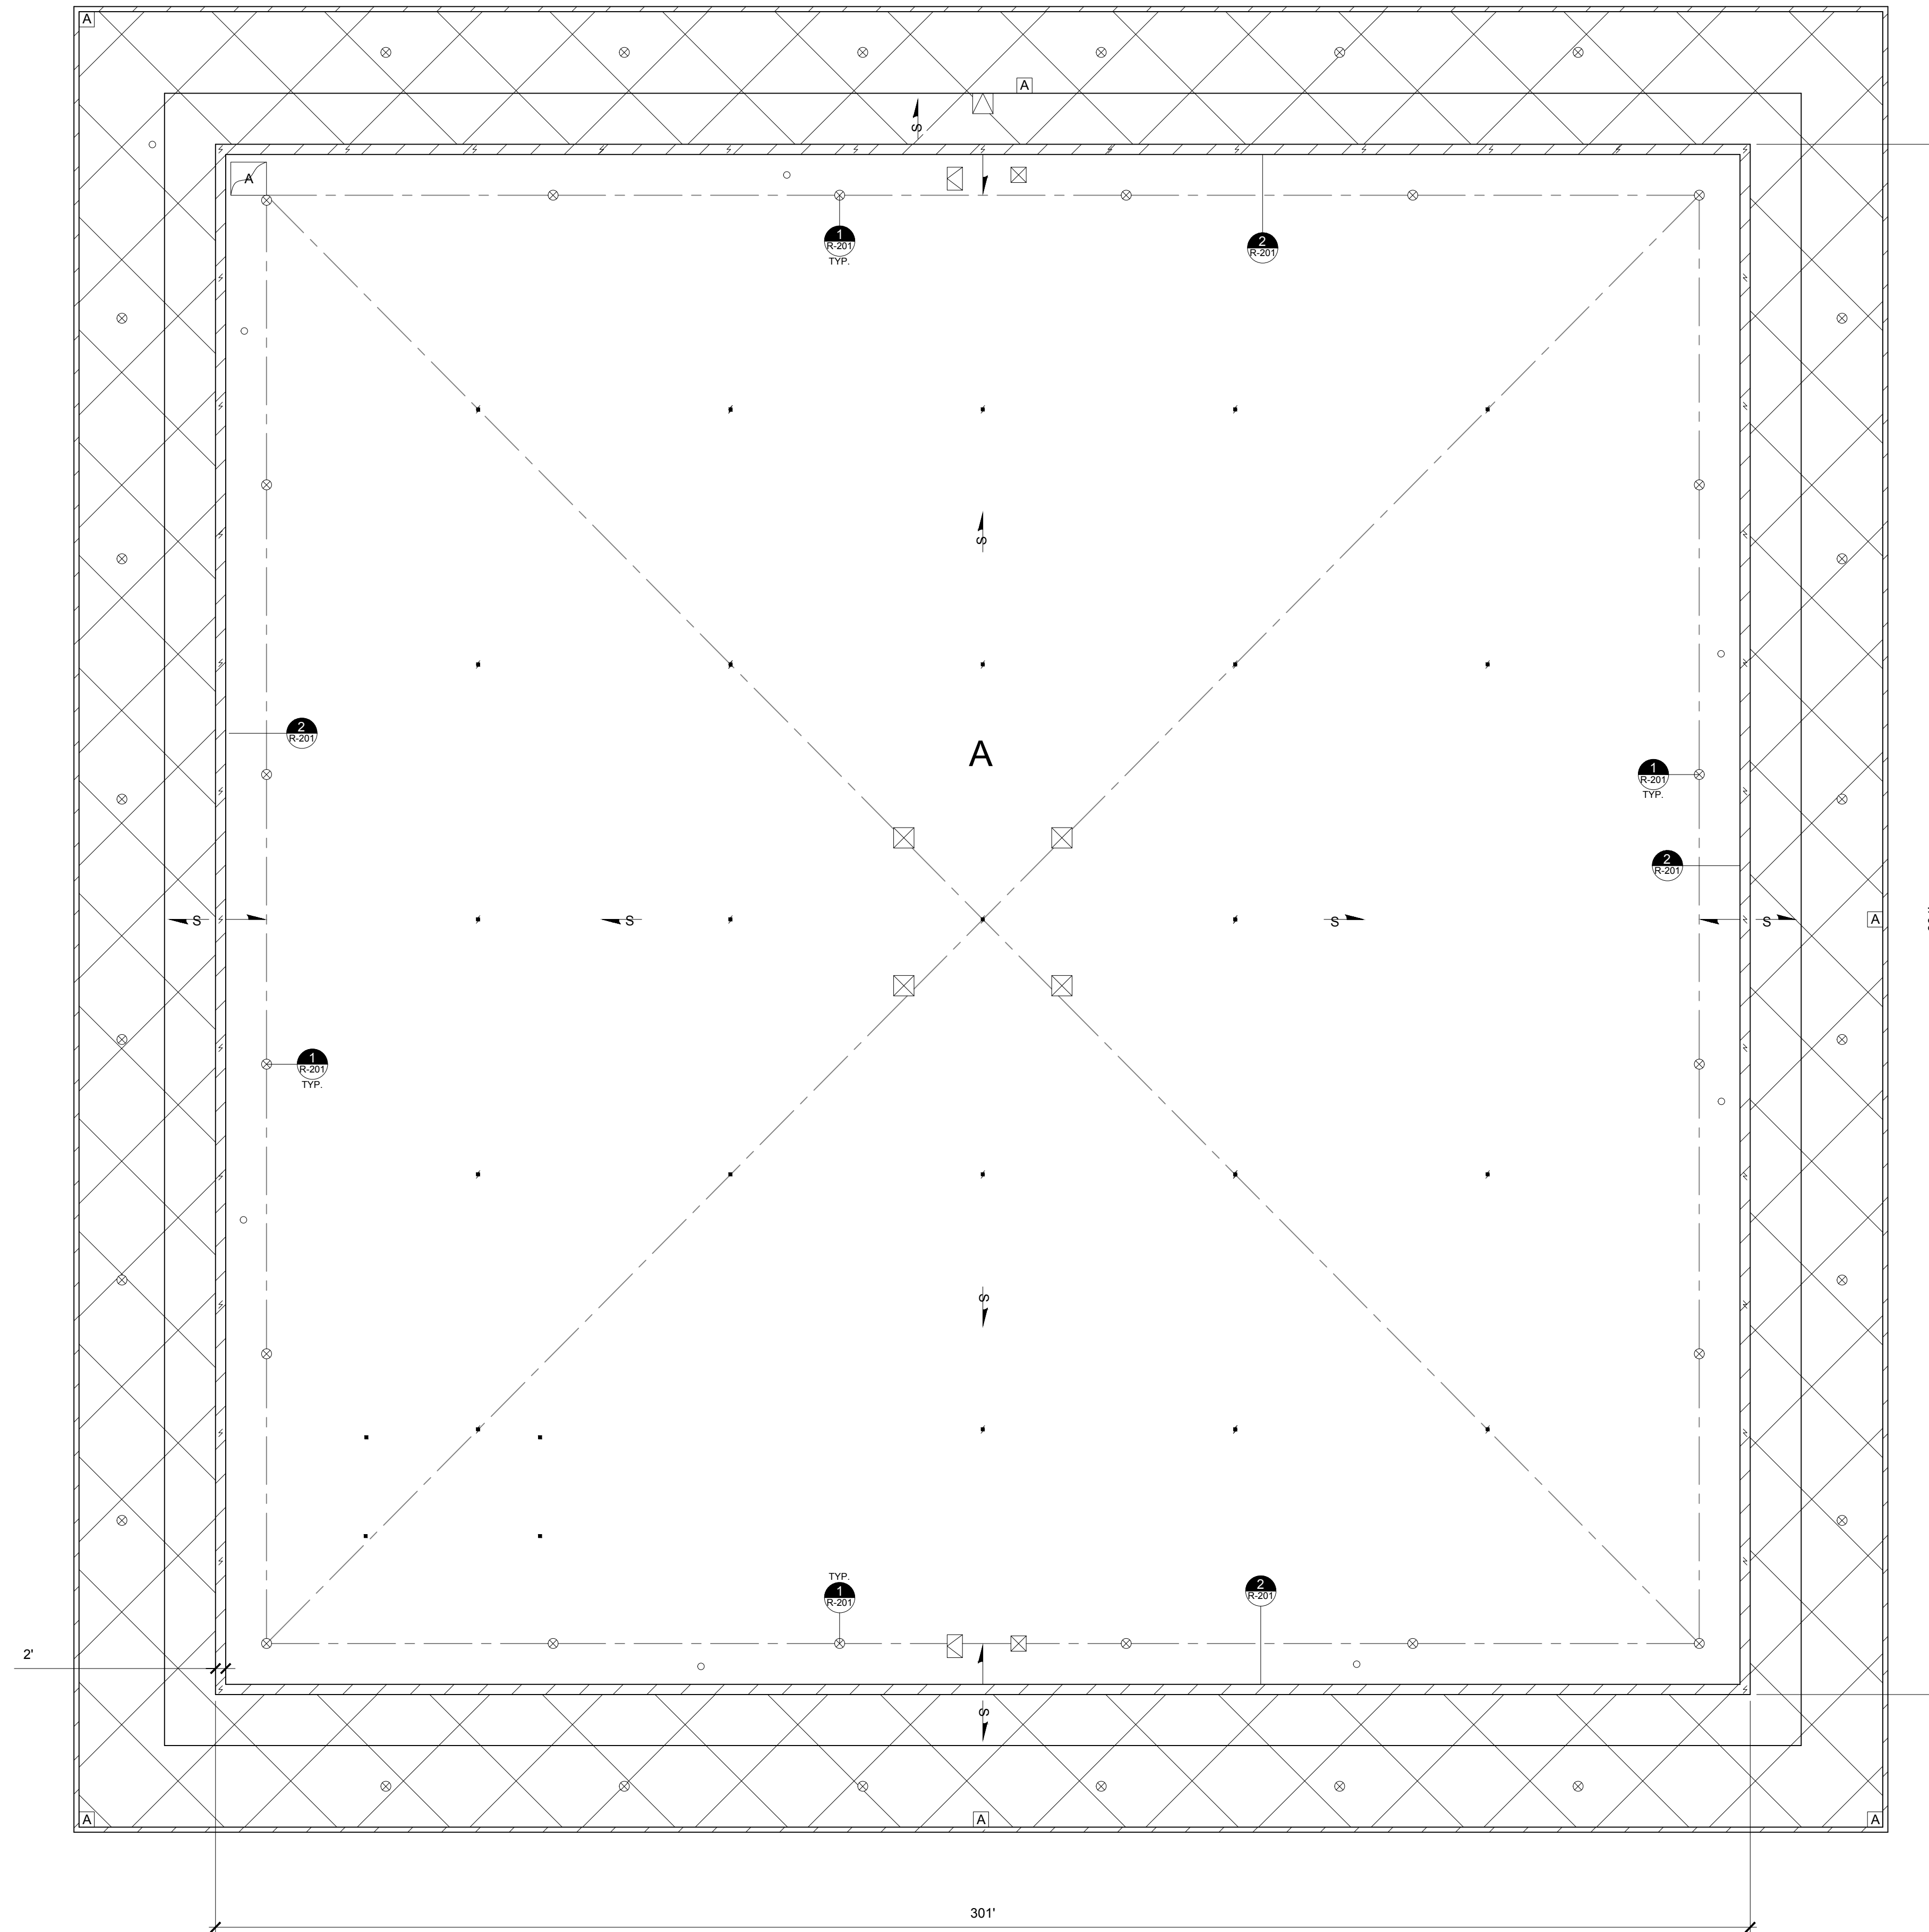


NOT IN CONTRACT



KEY

- PARAPET WALL
- ROOF EDGE
- RIDGE-HIP VALLEY
- STRUCTURAL SLOPE
- TAPERED SLOPE
- ROOF DRAIN
- EQUIPMENT CURB
- ROOF HATCH
- ANTENNA
- PIPE PENETRATION
- PITCH POCKET
- DETAIL NUMBER

NOTES: #
1. REFER TO SECTION 01 11 00 FOR SUMMARY OF WORK.



ROOFING, WATERPROOFING & BUILDING
ENVELOPE ENGINEERS & CONSULTANTS
www.reiengineers.com

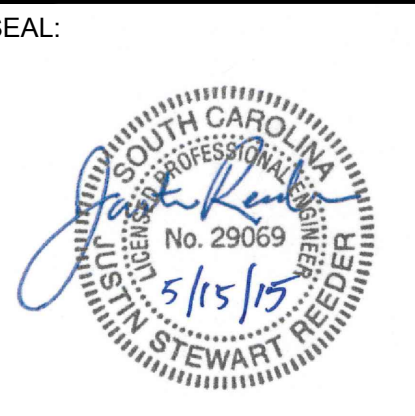

COLISEUM ROOF REPAIR
UNIVERSITY OF SOUTH CAROLINA
COLUMBIA, SC
REI PROJECT #: 15CHS-030

REVISION #	REVISION DATE
1	
2	
3	
4	

DRAWN BY: CGB

SCALE: 1"=20'-0"


DATE: 05/15/2015

DRAWING:


R-101

SHEET 2 OF 3

ROOF PLAN


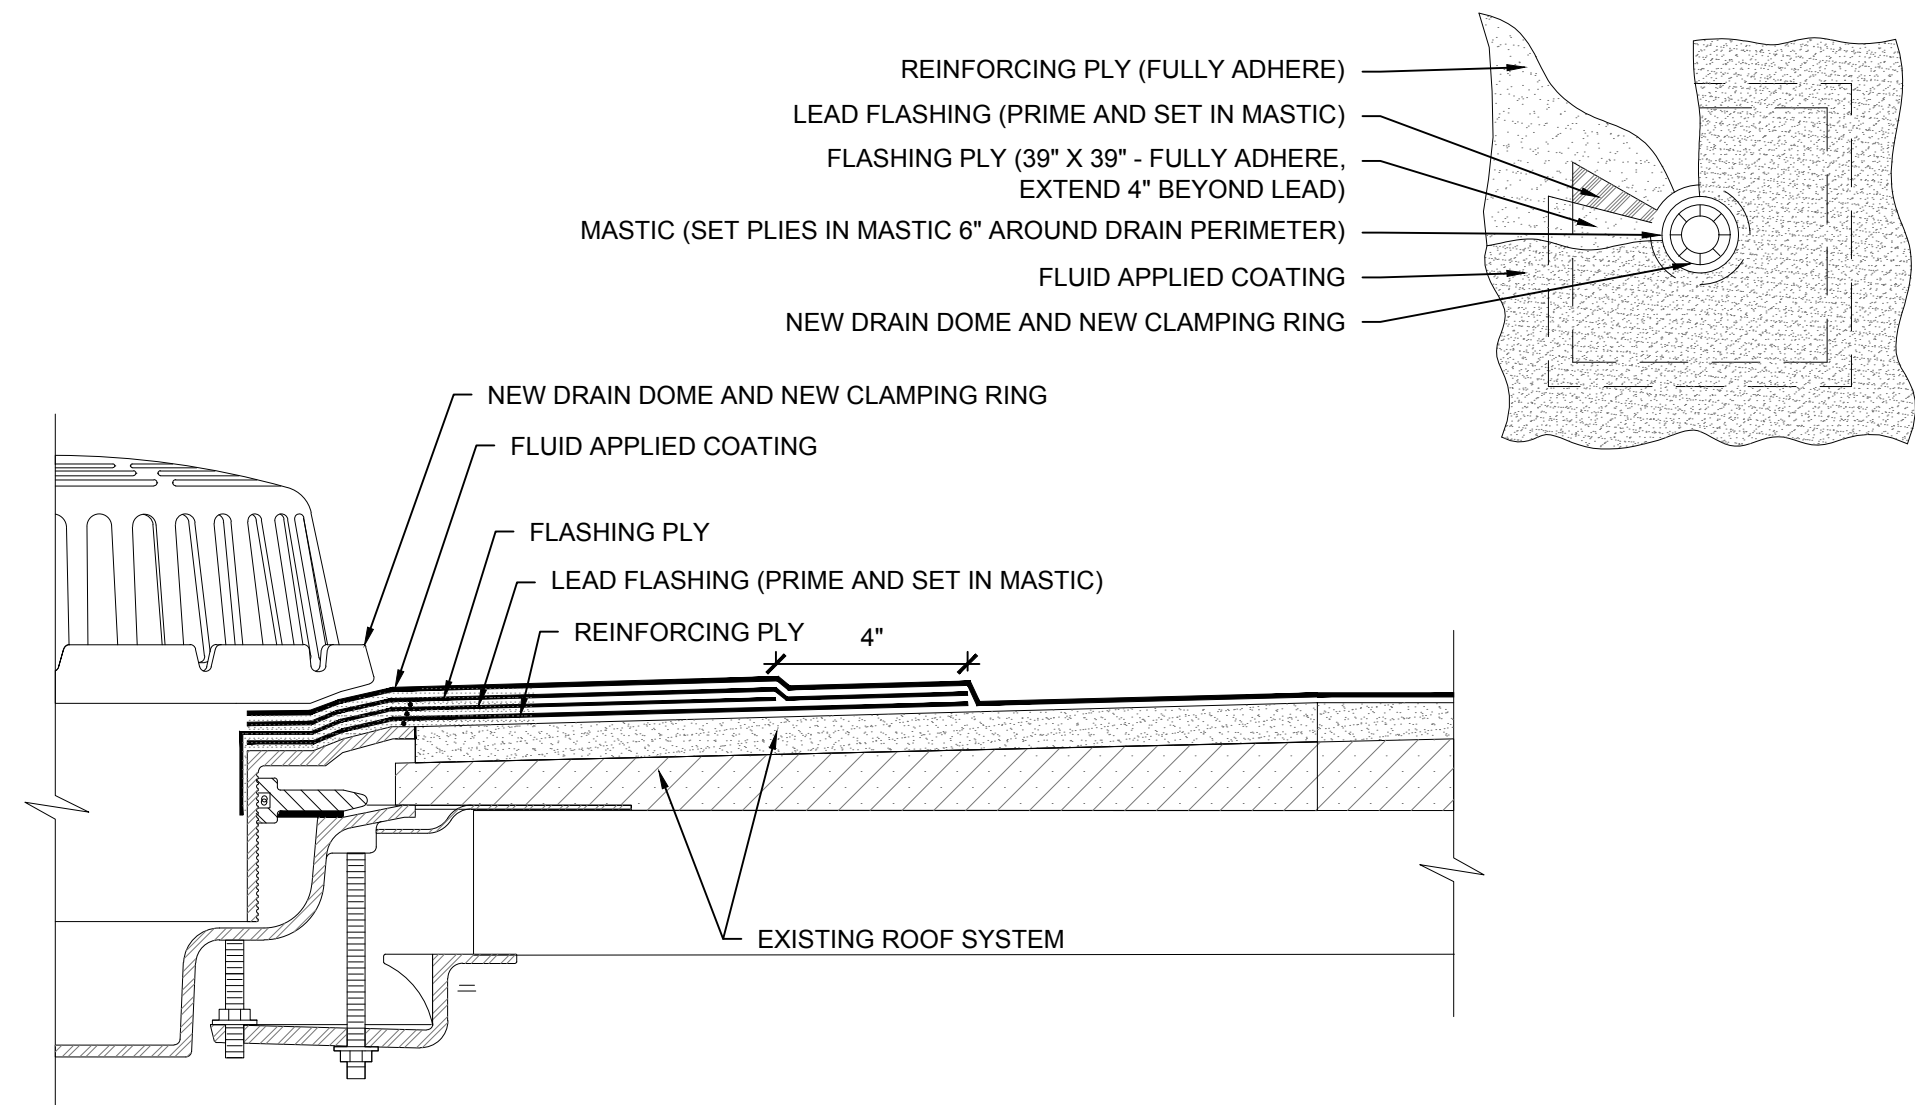


NOTES:
 1. REFER TO SECTION 07 52 16 FOR DRAIN FLASHING INSTALLATION.

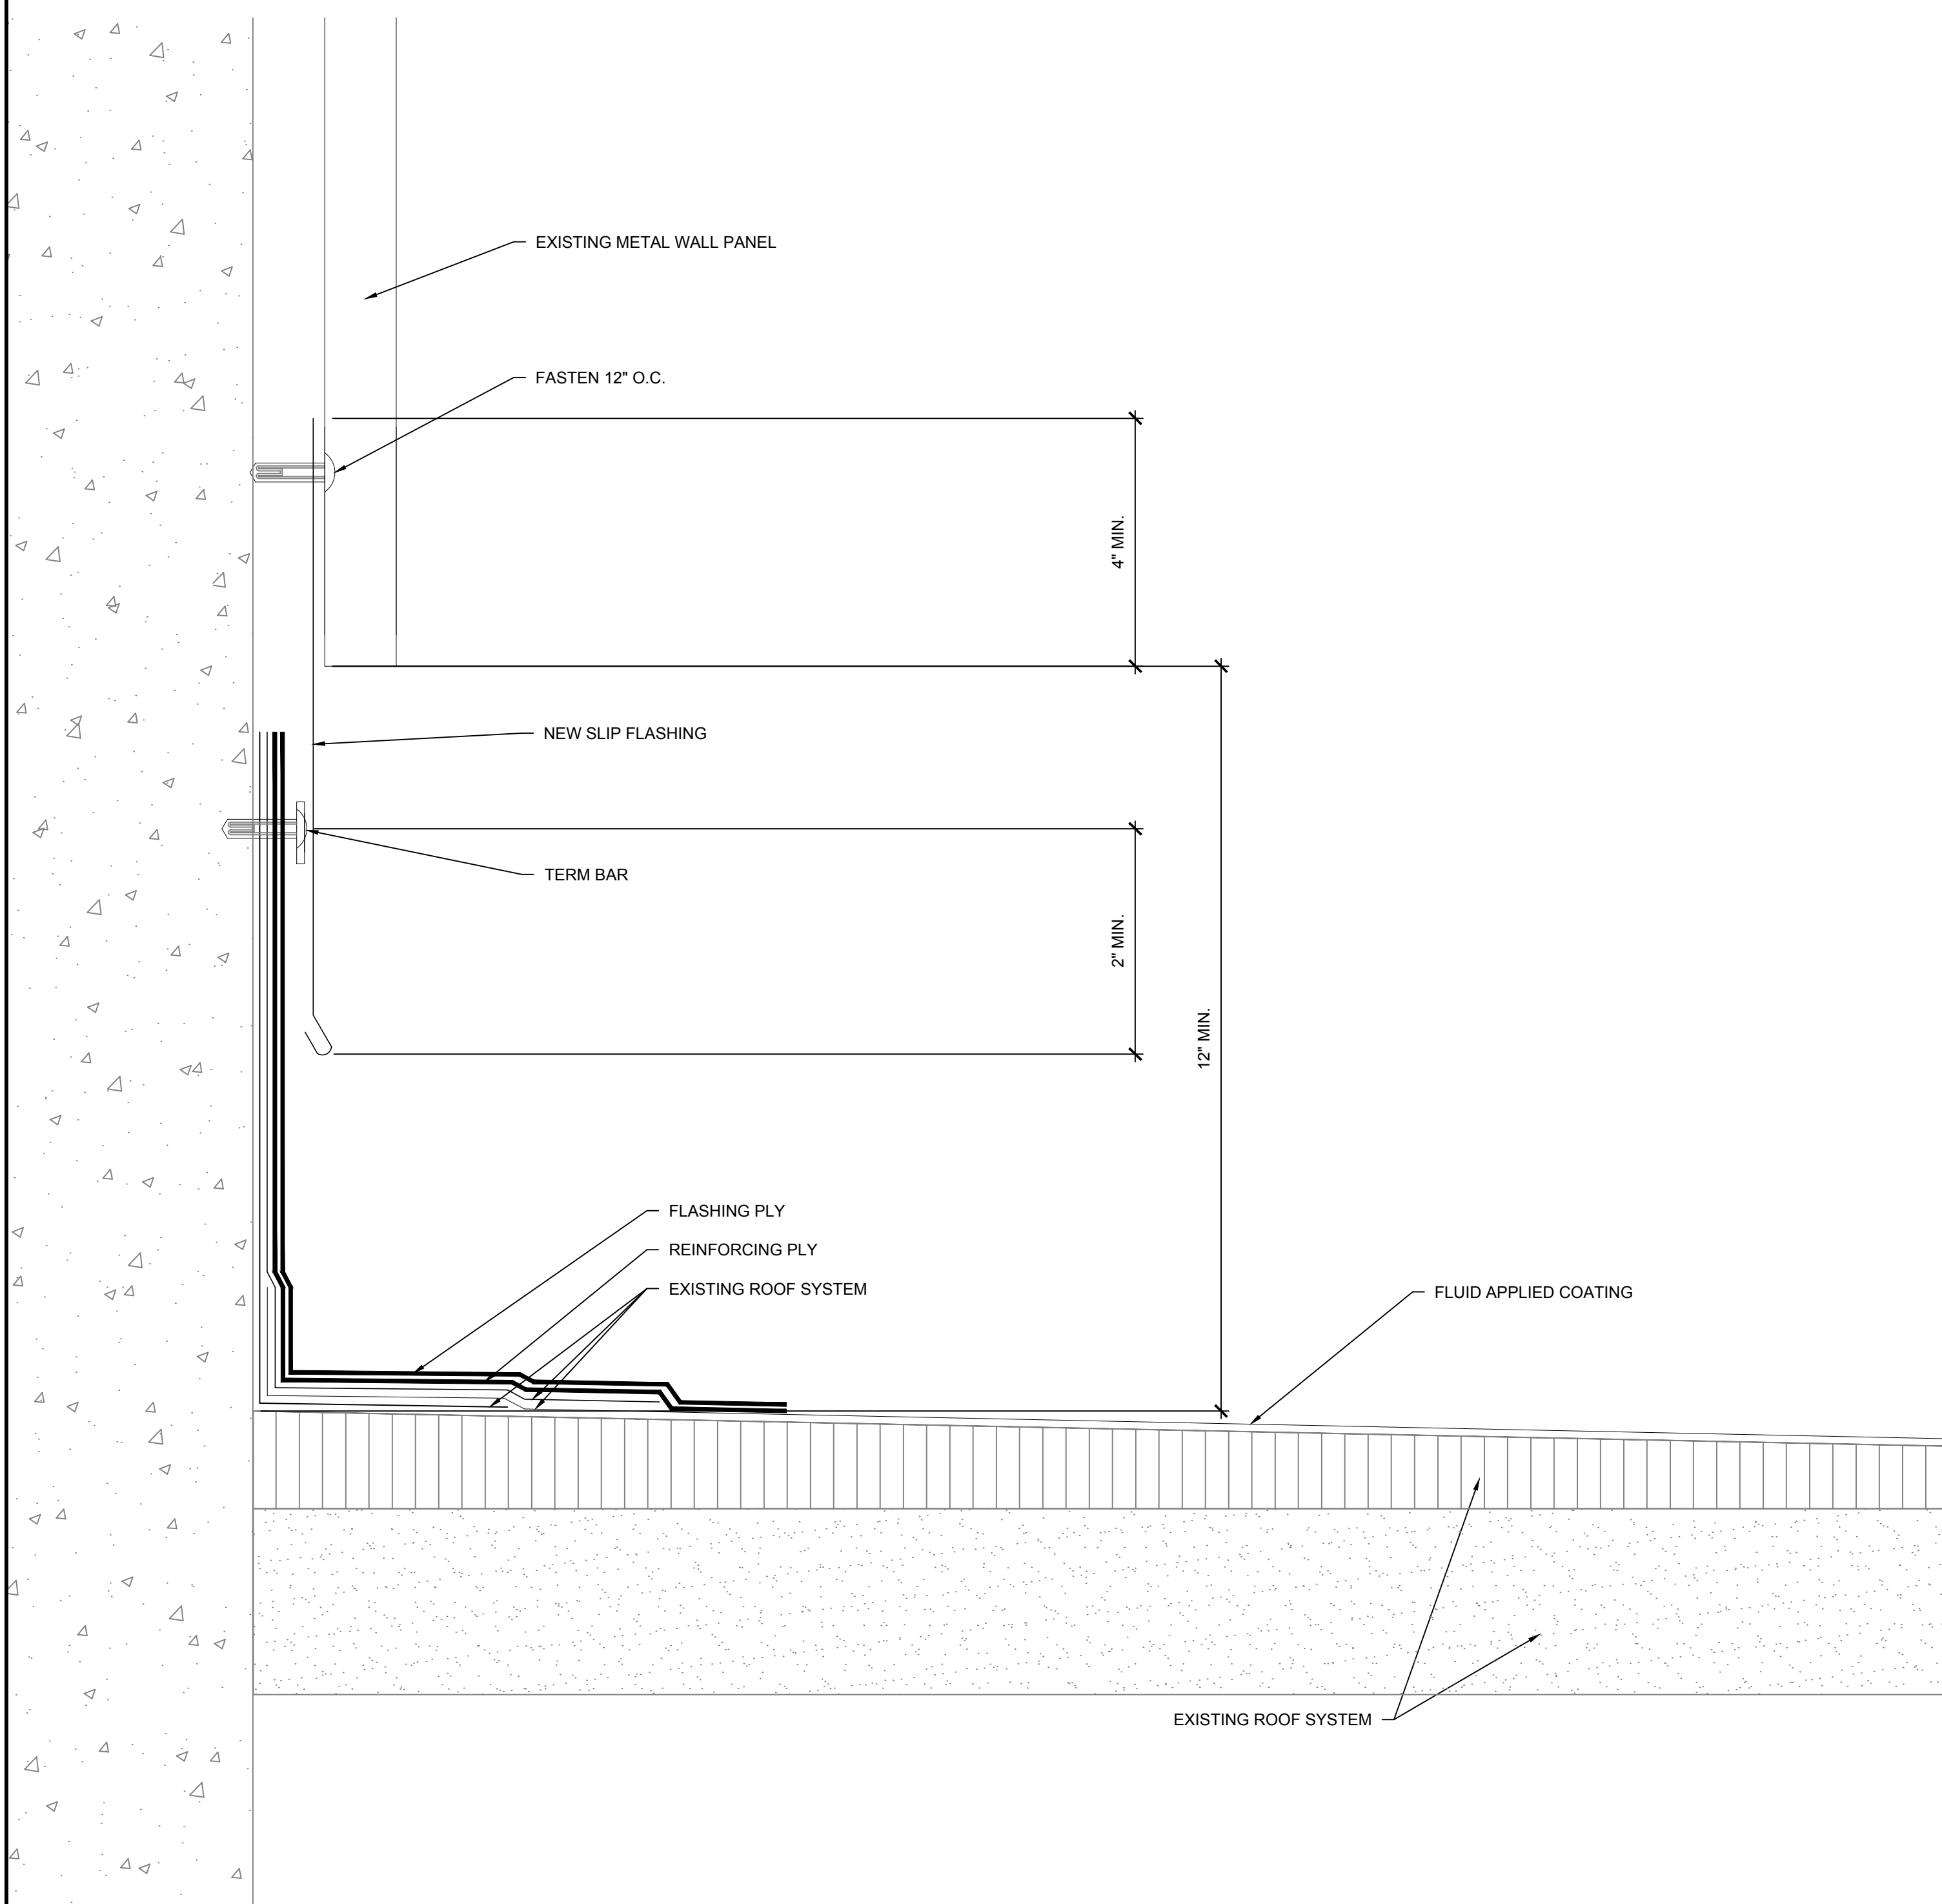

NOTES:
 1. MODIFY EXISTING METAL WALL PANELS TO ACHIEVE NEW 12 INCH CLEARANCE FROM EXISTING ROOF SURFACE TO BOTTOM OF MODIFIED WALL PANEL.
 2. EXTEND NEW SLIP FLASHING A MIN. OF 4 INCHES BEHIND MODIFIED METAL WALL PANEL AND SECURE WITH FASTENERS SPACED 12 INCHES ON CENTER. BOTTOM HEM OF SLIP FLASHING SHALL EXTEND A MIN. OF 2 INCHES BELOW BASE FLASHING TERMINATION BAR.

ROOFING, WATERPROOFING & BUILDING
 ENVELOPE ENGINEERS & CONSULTANTS
 www.reiengineers.com

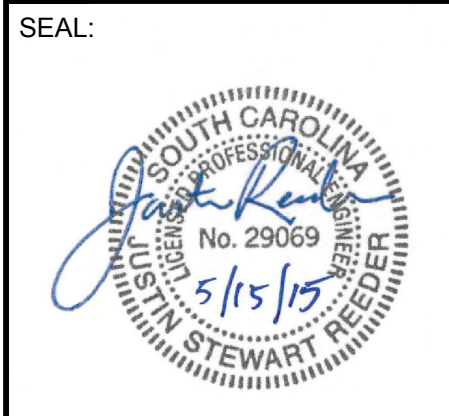

COLISEUM ROOF REPAIR

UNIVERSITY OF SOUTH CAROLINA
 COLUMBIA, SC
 REI PROJECT #: 15CHS-030

REVISION #	REVISION DATE
1	
2	
3	
4	

DRAWN BY: CGB
 SCALE: N.T.S.
 DATE: 05/15/2015

DRAWING:
R-201
 SHEET 3 OF 3
 ROOF DETAILS

1 ROOF DRAIN
 SCALE: N.T.S.

2 ROOF TO WALL
 SCALE: N.T.S.