

JUMPER CARTER SEASE/ARCHITECTS, P.A.
412 MEETING STREET, WEST COLUMBIA, SOUTH CAROLINA 29169
(803) 791-1020 (803) 791-1022 FAX

**UNIVERSITY OF SOUTH CAROLINA
CAPSTONE CAMPUS ROOM UPGRADES**

PROJECT NO: 11103

**ADDENDUM 03
March 16, 2012**


GENERAL:

SPECIFICATIONS:


DRAWINGS:

Lighting Controls Riser Diagram (attached) was inadvertently left off of Addendum #2

END OF ADDENDUM


 Lutron cable GRX-CBL-46L (Non-Plenum) or GRX-PCBL-46L (Plenum rated). Otherwise use 2 #12AWG (2.5mm²), 1 Belden #9461 (or equivalent), and between panels add 1 #18AWG (1.0mm²) for emergency sensing.


 Main Feed

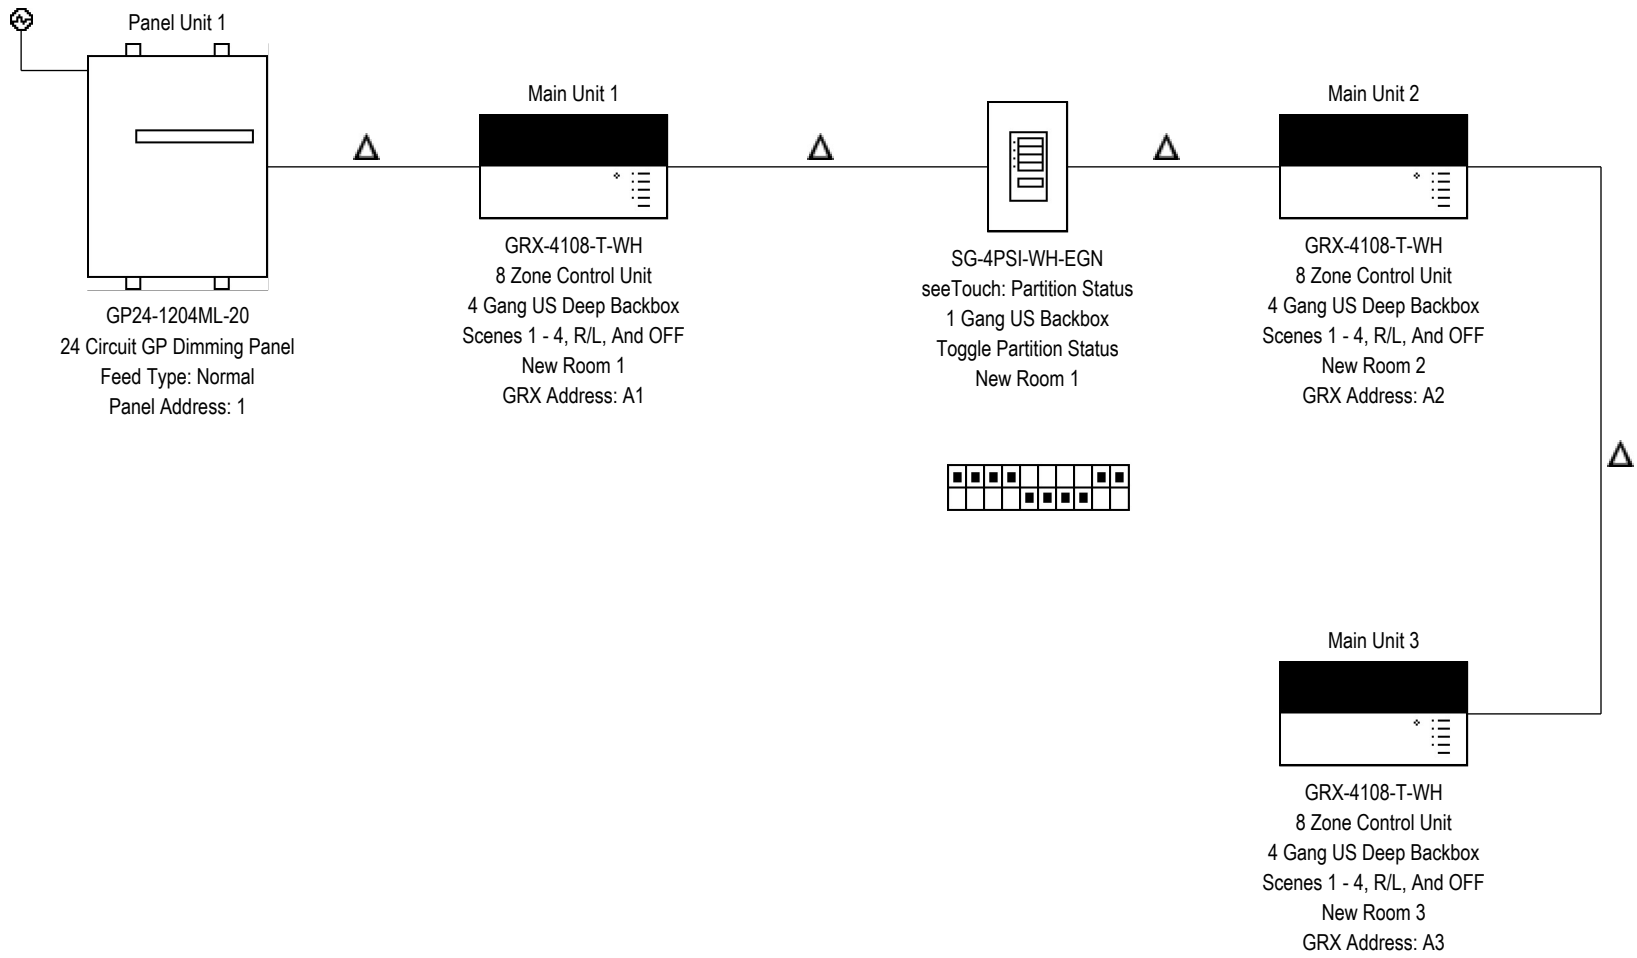

LIGHTING CONTROLS RISER DIAGRAM
 NOT TO SCALE