


MEDIA SECOND FLOOR

ROUTE CABLING CONCEALED IN EXISTING STOREFRONT FRAMING.  
SURFACE MOUNTED BOXES ARE TO BE FINISHED TYPE, STAMPED  
STEEL WITH VISIBLE KNOCK OUTS NOT PERMITTED.



**A** ELECTRICAL FIRE ALARM PLAN - 2ND FLOOR

E1.2 SCALE: 1/8" = 1'-0"

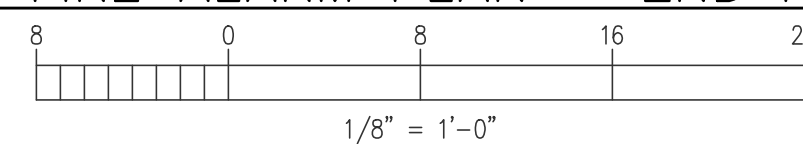

**NOTES:**

1. GENERAL: REUSE EXISTING DEVICE LOCATIONS WHERE NOTED ON E2.1, WHERE POSSIBLE.
2. INSTALL FLEX CONDUIT IN EXISTING HOLLOW STUD WALLS WHERE POSSIBLE TO CONCEAL SURFACE MOUNTED WIREMOLD. USE OF SURFACE WIREMOLD WILL NEED TO BE APPROVED PER INSTALLATION. REFERENCE DETAILS H&J/EO.1 FOR WIREMOLD INSTALLATION.
3. EXISTING FIRE ALARM PULL STATIONS ARE TYPICALLY INSTALLED GREATER THAN 48" AFF. LOWER NEW DEVICE BOX TO THE APPROPRIATE HEIGHT, PER DETAIL J/EO.1, AND REPAIR WALL AS REQUIRED. PROVIDE A FINISHED METAL COVER FOR EXISTING BOX, WITH BEVELED EDGES, PAINTED TO MATCH SURROUNDING AREAS.

REVISION	DATE	BY
A	1/4/13	JDV
B	2/8/13	JDV

PROJECT NO.	DATE	DRAWN BY	CHECKED BY
12608	08.28.2012	EMJ/JDV	DJB

SHEET NUMBER

E1.2