

Contract Documents and Specifications

For

Strom Thurmond Wellness and Fitness Center

Interior Renovations: Painting and Casework

For

University of South Carolina

Project # 50002896

May 9, 2016

TABLE OF CONTENTS

Project Number: 50002896

Project Name: Strom Thurmond Wellness and Fitness Center Interior
Renovations: Painting and Casework

Section 1	Number of Pages
Table of Contents	1
Invitation for Minor Const Quotes (SE-311, 2015, Rev 1/2016 Edition)	1
Standard Bid Quote (SE-331, 2015, Rev 1/2016 Edition)	1
USC Supplemental General Conditions for Construction Projects	5
Contractor's One-Year Guarantee	1
Section 2 – Technical Specifications:	
064020 Interior Architectural Woodwork	5
099123 Interior Painting	5

SE-311 INVITATION FOR MINOR CONSTRUCTION QUOTES

PROJECT NAME: Strom Thurmond Wellness and Fitness Center Interior Renovations: Painting and Casework

PROJECT NUMBER: 50002896

PROJECT LOCATION: University of South Carolina Columbia Campus

BID SECURITY REQUIRED? Yes No

PERFORMANCE BOND REQUIRED? Yes No

PAYMENT BOND REQUIRED? Yes No

CONSTRUCTION COST RANGE: \$ Less than \$50,000

DESCRIPTION OF PROJECT: Interior painting of soffit areas and replacement of laminate on existing casework. A site visit will be offered following the pre-bid meeting. Small and minority business participation is highly recommended. Physical Site Location is 1000 Blossom Street.

BIDDING DOCUMENTS/PLANS MAY BE OBTAINED FROM: purchasing.sc.edu. Facilities/Construction/Solicitations/Awards.

PLAN DEPOSIT AMOUNT: \$ \$0.00 **IS DEPOSIT REFUNDABLE** Yes No N/A

Bidders must obtain Bidding Documents/Plans from the above listed source(s) to be listed as an official plan holder. Only those Bidding Documents/Plans obtained from the above listed source(s) are official. Bidders rely on copies of Bidding Documents/Plans obtained from any other source at their own risk.

IN ADDITION TO THE ABOVE OFFICIAL SOURCE(S), BIDDING DOCUMENTS/PLANS ARE ALSO AVAILABLE AT:
N/A

All questions & correspondence concerning this Invitation shall be addressed to the A/E.

A/E NAME: Garvin Design Group

A/E CONTACT: Kim Bendillo

A/E ADDRESS: Street/PO Box:1021 Lincoln Street

City: Columbia

State: SC

ZIP: 29201-

EMAIL: kbendillo@garvindesigngroup.com

TELEPHONE: 803-212-1032

FAX: _____

AGENCY: University of South Carolina

AGENCY PROJECT COORDINATOR: Aimee B. Rish

ADDRESS: Street/PO Box:743 Greene Street

City: Columbia

State: SC

ZIP: 29208-

EMAIL: arish@fmc.sc.edu

TELEPHONE: 803-777-2261

FAX: 803-777-7334

PRE-QUOTE CONFERENCE: Yes No

MANDATORY ATTENDANCE: Yes No

PRE-QUOTE DATE: 5/24/2016

TIME: 10:00am

PLACE: Strom Thurmond Main Lobby; 1000 Blossom St.

QUOTE CLOSING DATE: 5/31/2016

TIME: 2:00pm

PLACE: Strom Thurmond Main Lobby; 1000 Blossom St.

QUOTE DELIVERY ADDRESSES:

HAND-DELIVERY:

Attn: Aimee B. Rish "Bid Enclosed"

743 Greene Street

Columbia, SC 29208

MAIL SERVICE:

Attn: Aimee B. Rish "Bid Enclosed"

743 Greene Street

Columbia, SC 29208

APPROVED BY: _____

(Agency Project Coordinator)

DATE: _____

SE-331 QUOTE FORM

Quotes shall be submitted only on SE-331.

QUOTE SUBMITTED BY: _____
(Offeror's Name)

QUOTE SUBMITTED TO: University of South Carolina
(Owner's Name)

FOR: PROJECT NAME: Strom Thurmond Wellness and Fitness Center Interior Renovations:
Painting and Casework

PROJECT NUMBER: 50002896

OFFER

- In response to the Invitation for Minor Construction Quotes, and in compliance with the Instructions to Bidders for the above-named Project, the undersigned **OFFEROR** proposes and agrees, if this Quote is accepted, to enter into a Contract with the Owner in the form included in the Solicitation Documents, and to perform all Work as specified or indicated in the Solicitation Documents, for the prices and within the time frames indicated in the Solicitation and in accordance with the other terms and conditions stated.
- Pursuant to Section 11-35-3030(1) of the SC Code of Laws, as amended, **OFFEROR** has submitted Bid Security as follows in the amount and form required by the Solicitation Documents:

Bid Bond with Power of Attorney Electronic Bid Bond Cashier's Check

(Bidder check one)

- OFFEROR** acknowledges the receipt of the following Addenda to the Solicitation documents and has incorporated the effects of said Addenda into its Quote (Bidder, check only boxes that apply.):

ADDENDA: #1 #2 #3 #4 #5

- OFFEROR** agrees that this Quote, including all bid alternates, if any, may not be revoked or withdrawn after the opening of quotes, and shall remain open for acceptance for a period of 60 Days following the Quote Date, or for such longer period of time that **OFFEROR** may agree to in writing upon request of the Owner.
- OFFEROR** agrees that from the compensation to be paid, the Owner shall retain as Liquidated Damages the amount of \$ 100.00 for each calendar day the actual construction time required to achieve Substantial Completion exceeds the specified or adjusted Contract Time for Substantial Completion, as provided in the Contract Documents.
- OFFEROR** herewith submits its offer to provide all labor, materials, equipment, tools of trades and labor, accessories, appliances, warranties and guarantees, and to pay all royalties, fee, permits, licenses and applicable taxes necessary to complete the following items of construction work:

6.1 BASE QUOTE \$ _____
(enter BASE QUOTE in figures only)

6.1.1 ALTERNATE NO. 1 \$ _____ to be ADDED / DEDUCTED from BASE QUOTE.
(circle one)

6.1.2 ALTERNATE NO. 2 \$ _____ to be ADDED / DEDUCTED from BASE QUOTE.
(circle one)

SC Contractor's License Number: _____

Classification(s) & Limits: _____

Address: _____

Telephone/Fax _____

E-mail _____

This Quote is hereby submitted on behalf of the Offeror named above.

BY: _____
(Signature of Offeror's Representative)

(Print or Type Name of Offeror's Representative)

TITLE: _____

USC SUPPLEMENTAL GENERAL CONDITIONS
FOR CONSTRUCTION PROJECTS

WORK AREAS

1. The Contractor shall maintain the job site in a safe manner at all times. This includes (but is not limited to) the provision and/or maintenance of lighting, fencing, barricades around obstructions, and safety and directional signage.
2. Contractor's employees shall take all reasonable means not to interrupt the flow of student traffic in building corridors, lobbies, stairs and exterior walks. All necessary and reasonable safety precautions shall be taken to prevent injury to building occupants while transporting materials and equipment through the work area. Providing safe, accessible, plywood-shielded pedestrian ways around construction may be required if a suitable alternative route is not available.
3. At the beginning of the project, the USC Project Manager will establish the Contractor's lay-down area. This area will also be used for the Contractor's work vehicles. The lay-down area will be clearly identified to the contractor by the Project Manager, with a sketch or drawing provided to USC Parking Services. In turn, Parking Services will mark off this area with a sign containing the project name, Project Manager's name, Contractor name and contact number, and end date. Where this area is subject to foot traffic, protective barriers will be provided as specified by the Project Manager. The area will be maintained in a neat and orderly fashion.
4. Work vehicles parked in the lay down area (or designated parking areas) will be clearly marked and display a USC-furnished placard for identification. No personal vehicles will be allowed in this area, or in any areas surrounding the construction site. Personal vehicles must be parked in the perimeter parking lots or garages. Temporary parking permits can be obtained at the Contractor's expense at the USC Parking Office located in the Pendleton Street parking garage. Refer to the CAMPUS VEHICLE EXPECTATIONS (below) for additional information.
5. Contractor is responsible for removal of all debris from the site, and is required to provide the necessary dumpsters which will be emptied on a regular basis. Construction waste must not be placed in University dumpsters. The construction site must be thoroughly cleaned with all trash picked up and properly disposed of on a daily basis and the site must be left in a safe and sanitary condition each day. The University will inspect job sites regularly and will fine any contractor found to be in violation of this requirement an amount of up to \$1,000 per violation.
6. Where it is necessary to jump curbs, dimensional lumber and plywood must be built up to appropriate curb elevation to protect curbs from damage. Contractor will be responsible for any project related damage.
7. The Contractor shall be responsible for erosion and sediment control measures where ground disturbances are made.

PROJECT FENCING

8. All construction projects with exterior impacts shall have construction fencing at the perimeter. Fencing shall be 6' chain link with black or green privacy fabric (80-90% blockage). For fence panels with footed stands, sandbag weights shall be placed on the inside of the fence. Ripped sandbags shall be replaced immediately.
9. For projects with long fencing runs and/or high profile locations, decorative USC banners shall be used on top of privacy fabric; banners should be used at a ratio of one banner for every five fence

panels. USC Project Manager will make arrangements for banner delivery for Contractor to hang.

10. The use of plastic safety fencing is discouraged and shall only be used on a temporary basis (less than four weeks) where absolutely necessary. Safety fencing shall be a neon yellow-green, high-visibility fencing equal to 'Kryptonight' by Tenax. Safety fencing shall be erected and maintained in a neat and orderly fashion throughout the project.
11. Vehicles and all other equipment shall be contained within a fenced area if they are on site for more than 3 consecutive calendar days.

BEHAVIOR

12. Fraternalization between Contractor's employees and USC students, faculty or staff is strictly prohibited.
13. USC will not tolerate rude, abusive or degrading behavior on the job site. Heckling and cat-calling directed toward students, faculty or staff or any other person on USC property is strictly prohibited. Any contractor whose employees violate this requirement will be assessed a fine of up to \$500 per violation.
14. Contractor's employees must adhere to the University's policy of maintaining a drug-free and tobacco-free campus. Tobacco product trash that is found on the jobsite may result in a \$25/piece fee.

HAZARDOUS MATERIALS & SAFETY COMPLIANCE

15. A USC Permit to Work must be signed prior to any work being performed by the general contractor or sub-contractor(s).
16. The contractor will comply with all regulations set forth by OSHA, EPA and SCDHEC. Contractor must also adhere to USC's internal policies and procedures (available by request). Upon request, the contractor will submit all Safety Programs and Certificates of Insurance to the University for review.
17. Contractor must notify the University immediately upon the discovery of suspect material which may contain asbestos or other such hazardous materials. These materials must not be disturbed until approved by the USC Project Manager.
18. In the event of an OSHA inspection, the Contractor shall immediately call the Facilities Call Center, 803-777-4217, and report that an OSHA inspector is on site. An employee from USC's Safety Unit will arrive to assist in the inspection.

LANDSCAPE & TREE PROTECTION

19. In conjunction with the construction documents, the USC Arborist shall direct methods to minimize damage to campus trees. Tree protection fencing is required to protect existing trees and other landscape features to be affected by a construction project. The location of this fence will be evaluated for each situation with the USC Arborist, Landscape Architect and Project Manager. Tree protection fencing may be required along access routes as well as within the project area itself. Fence locations may have to be reset throughout the course of the project.
20. The tree protection fence shall be 6' high chain link fence with 80-90% privacy screening unless otherwise approved by USC Arborist and/or Landscape Architect. If the tree protection fence is completely within a screened jobsite fence perimeter, privacy fabric is not required. In-ground

fence posts are preferred in most situations for greater protection. If utility or pavement conflicts are present, fence panels in footed stands are acceptable. See attached detail for typical tree protection fencing.

21. No entry, vehicle parking, or materials storage will be allowed inside the tree protection zone. A 4" layer of mulch shall be placed over the tree protection area to maintain moisture in the root zone.
22. Where it is necessary to cross walks, tree root zones (i.e., under canopy) or lawns the following protective measures shall be taken:
 - a. For single loads up to 9,000 lbs., a 3/4" minimum plywood base shall be placed over 4" of mulch.
 - b. For single loads over 9,000 lbs., two layers of 3/4" plywood shall be placed over 4" of mulch.
 - c. Plywood sheets shall be replaced as they deteriorate or delaminate with exposure.
 - d. For projects requiring heavier loads, a construction entry road consisting of 10' X 16' oak logging mats on 12" coarse, chipped, hardwood base. Mulch and logging mats shall be supplemented throughout the project to keep matting structurally functional.
23. Damage to any trees during construction shall be assessed by the USC Arborist, who will stipulate what action will be taken for remediation of damage. The cost of any and all remediation will be assumed by the contractor at no additional cost to the project. Compensation for damages may be assessed up to \$500 per caliper inch of tree (up to 8") and \$500 per inch of diameter at breast height (for trees over 8").
24. Damage to trunks and limbs, as well as disturbance of the root zone under the dripline of tree, including compaction of soil, cutting or filling, or storage of materials, shall qualify as damage and subject to remediation.
25. Any damage to existing pavements or landscaping (including lawn areas and irrigation) will be remediated before final payment is made.

TEMPORARY FACILITIES

26. Contractor will be responsible for providing its own temporary toilet facilities, unless prior arrangements are made with the USC Project Manager.
27. Contractor must provide its own electrical power supply. Water may be available to the extent of existing sources. Any needed or desired taps, connections, or metering devices, shall be at the sole expense of the contractor.
28. Use of USC communications facilities (telephones, computers, etc.) by the Contractor is prohibited, unless prior arrangements are made with the USC Project Manager.

CAMPUS KEYS

29. Contractor must sign a Contractor Key Receipt/Return form before any keys are issued. Keys must be returned immediately upon the completion of the work. The Contractor will bear the cost of any re-keying necessary due to the loss of or failure to return keys.

WELDING


30. A welding (hot work) permit must be issued by the University Fire Marshall before any welding can begin inside a building. The USC Project Manager will coordinate.

PROJECT EVALUATION & CLOSE-OUT

31. For all projects over \$100,000, including IDCs, a Contractor Performance Evaluation (SE 397) will be reviewed with the GC at the beginning of the project and a copy given to the GC. At the end of the project the form will be completed by the USC Project Manager and a Construction Performance rating will be established.
32. Contractor must provide all O&M manuals, as-built drawings, and training of USC personnel on new equipment, controls, etc. prior to Substantial Completion. Final payment will not be made until this is completed.

CAMPUS VEHICLE EXPECTATIONS

33. Personal vehicles must be parked in the perimeter parking lots or garages. Temporary parking permits can be obtained at the Contractor's expense at the USC Parking Office located in the Pendleton Street parking garage.
34. All motorized vehicle traffic on USC walkways and landscape areas must be approved by the USC Project Manager and Parking Division, have a USC parking placard, and be parked within the approved laydown area. Violators may be subject to ticketing, towing and fines.
35. All motorized vehicles that leak or drip liquids are prohibited from traveling or parking on walks or landscaped areas.
36. Drivers of equipment or motor vehicles that damage university hardscape or landscape will be held responsible for damages and restoration expense.
37. All vehicles parked on landscape, hardscape, or in the process of service delivery, must display adequate safety devices, i.e. flashing lights, cones, signage, etc.
38. All drivers of equipment and vehicles shall be respectful of University landscape, equipment, structures, fixtures and signage.
39. All incidents of property damage shall be reported to Parking Services or the Work Management Center.

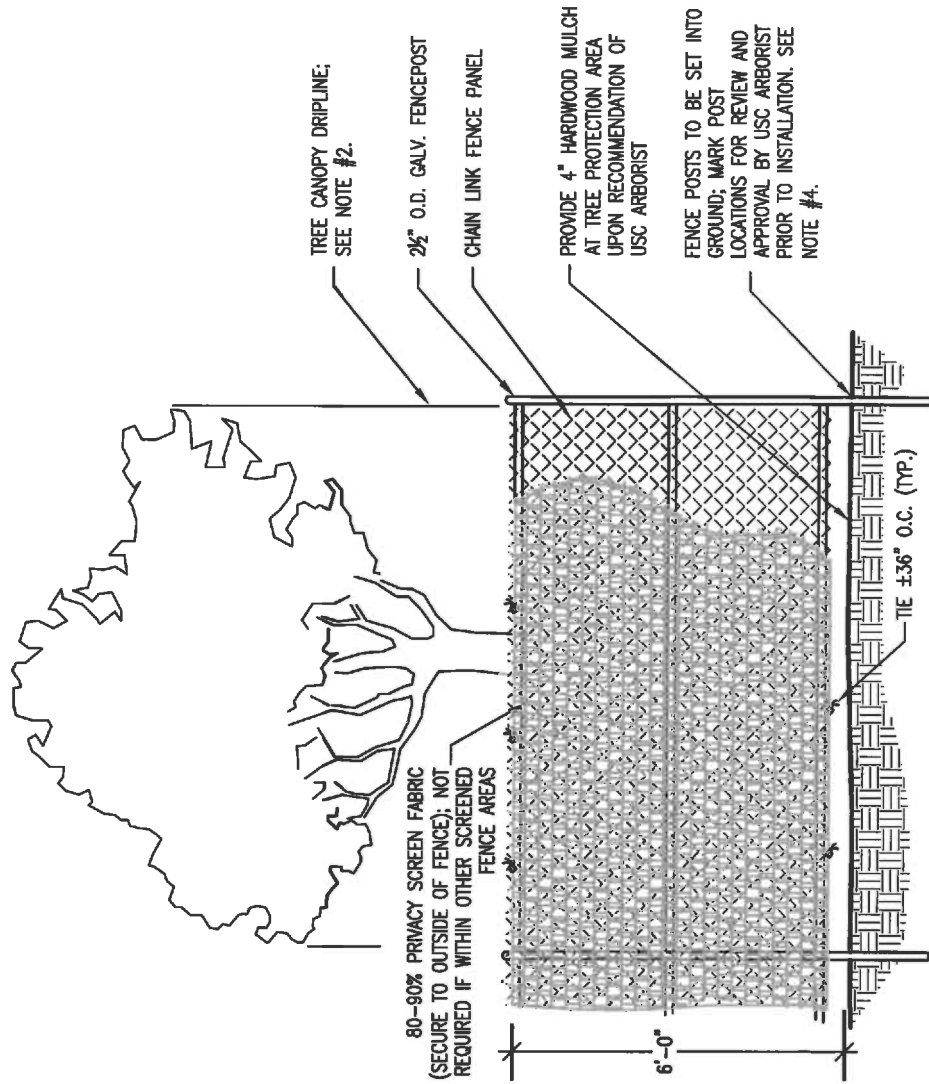

NOTES:

1. PROVIDE PROTECTION FENCING FOR ALL TREES WITHIN AREA OF DISTURBANCE AND CONSTRUCTION ACCESS.
2. PROTECTION FENCING SHALL BE IN PLACE PRIOR TO BEGINNING CONSTRUCTION.
3. PROTECTION FENCING TO BE PLACED AT THE OUTSIDE OF THE CANOPY DRIPLINE, OR AT A DISTANCE OF ONE FOOT PER ONE INCH OF TREE DIAMETER, MEASURED AT BREAST HEIGHT, WHICHEVER IS LARGER, UNLESS OTHERWISE INDICATED ON LANDSCAPE PLAN OR APPROVED BY UNIVERSITY ARBORIST.
4. IN-GROUND POSTS ARE STANDARD. IF EXISTING ROOTS, UTILITIES OR PAVEMENT PRECLUDE USE OF IN-GROUND POSTS, FOOTED STANDS ARE ACCEPTABLE. SAND BAGS SHALL BE PLACED ON THE INSIDE OF FENCE.
5. DAMAGE TO ANY TREES DURING CONSTRUCTION SHALL BE ASSESSED BY UNIVERSITY ARBORIST AND THE UNIVERSITY ARBORIST SHALL STIPULATE WHAT ACTION WILL BE TAKEN FOR REMEDIATION OF DAMAGE. THE COST OF ANY AND ALL REMEDIATION WILL BE ASSUMED BY CONTRACTOR AT NO ADDITIONAL COST TO THE PROJECT.
6. DISTURBANCE OF ROOT ZONE UNDER DRIPLINE OF TREE, INCLUDING COMPACTION OF SOIL, CUTTING OR FILLING OR STORAGE OF MATERIALS SHALL QUALIFY AS DAMAGE AND SUBJECT TO REMEDIATION.

TREE PROTECTION FENCING (IN-GROUND) WITH SCREENING

NO SCALE REVISED 8.28.14

Project Name: Strom Thurmond Wellness and Fitness Center Interior Renovations: Painting and Casework

Project Number: 50002896

University of South Carolina

CONTRACTOR'S ONE YEAR GUARANTEE

STATE OF _____

COUNTY OF _____

WE _____
as General Contractor on the above-named project, do hereby guarantee that all work executed under the requirements of the Contract Documents shall be free from defects due to faulty materials and /or workmanship for a period of one (1) year from date of acceptance of the work by the Owner and/or Architect/Engineer; and hereby agree to remedy defects due to faulty materials and/or workmanship, and pay for any damage resulting wherefrom, at no cost to the Owner, provided; however, that the following are excluded from this guarantee;

Defects or failures resulting from abuse by Owner.

Damage caused by fire, tornado, hail, hurricane, acts of God, wars, riots, or civil commotion.

[Name of Contracting Firm]

*By _____

Title _____

*Must be executed by an office of the Contracting Firm.

SWORN TO before me this
_____ day of _____, 2____ (seal)

_____ State

My commission expires _____

SECTION 064020 - INTERIOR ARCHITECTURAL WOODWORK

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Plastic-laminate cabinets (resurfacing of existing units only—all 'wood laminate' surfaces including cabinet doors) as indicated in drawings and images.

1.3 DEFINITIONS

- A. Interior architectural woodwork includes wood furring, blocking, shims, and hanging strips for installing woodwork items unless concealed within other construction before woodwork installation.
- B. HPDL: High pressure decorative laminate.
- C. Exposed: As used in the Section, "exposed" portions of casework include surfaces visible when doors and drawers are closed. Bottoms of casework more than 4'-0" above finish floor are considered exposed. Visible surfaces in open casework or behind clear doors also are considered as exposed.
- D. Semi-exposed: As used in this Section, "semi-exposed" portions of casework include those members behind opaque doors, such as shelves, divisions, interior faces of ends, case backs, drawer sides, back and bottoms, and back face of doors. Tops of cases 6'-6" or more above finish floor shall be considered semi-exposed.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated, including cabinet hardware and accessories, finishing materials and processes.
- B. Shop Drawings: Show location of each item, dimensioned plans and elevations, large-scale details, attachment devices, and other components.
 - 1. Show extent of panels to be replaced.
 - 2. Show locations and sizes of cutouts and holes for plumbing fixtures, faucets and other items installed in architectural woodwork.

- C. Samples for Verification:

Approved samples may be returned to Contractor and used as part of the Work.

1. Plastic laminate, 8 by 10 inches (200 by 250 mm), for each type, color, pattern, and surface finish.
 - D. Product Certificates: For each type of product, signed by product manufacturer.
 - E. Woodwork Quality Standard Compliance Certificates: AWI Quality Certification Program certificates.
 - F. Qualification Data: For installer and fabricator.
- 1.5 QUALITY ASSURANCE
- A. Single Source Responsibility: Fabricator is responsible for finishing and installing of casework specified in this Section.
 - B. Fabricator/Installer Qualifications: Shop that employs skilled workers who custom-fabricate products similar to those required for this Project, for at least 5 years and whose products have a record of successful in-service performance. Provide references from Completed Work.
 - C. Quality Standard: Unless otherwise indicated, comply with AWI's "Architectural Woodwork Quality Standards" for grades of interior architectural woodwork indicated for construction, finishes, installation, and other requirements.
 1. Provide AWI Quality Certification Program labels and certificates indicating that woodwork, including installation, complies with requirements of grades specified.
 - D. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 01 Section "Project Management and Coordination."
- 1.6 PROJECT CONDITIONS
- A. Environmental Limitations: Do not deliver or install woodwork until building is enclosed, wet work is complete, and HVAC system is operating and maintaining temperature and relative humidity at occupancy levels during the remainder of the construction period.
 - B. Field Measurements: Where woodwork is indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication, and indicate measurements on Shop Drawings. Coordinate fabrication schedule with construction progress to avoid delaying the Work.
- 1.7 WARRANTY
- A. Furnish warranty with provisions for repairing or replacing, at not additional cost to Owner, casework items that exhibit defects in material or workmanship for 2 years.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. General: Provide materials that comply with requirements of AWI's quality standard for each type of woodwork and quality grade specified, unless otherwise indicated.
- B. High-Pressure Decorative Laminate (HPDL): NEMA LD 3, grades Standard and Premium, and as required by woodwork quality standard.
 - 1. Manufacturer: Subject to compliance with requirements, provide high-pressure decorative laminates by one of the following:
 - a. Formica Corporation.
 - 2. Colors and Patterns: DecoMetal #M5306 Plex Argent.

2.2 MISCELLANEOUS MATERIALS

- A. Anchors: Select material, type, size, and finish required for each substrate for secure anchorage. Provide nonferrous-metal or hot-dip galvanized anchors and inserts on inside face of exterior walls and elsewhere as required for corrosion resistance. Provide toothed-steel or lead expansion sleeves for drilled-in-place anchors.
- B. Adhesives, General: Do not use adhesives that contain urea formaldehyde.
- C. VOC Limits for Installation Adhesives and Glues: Use installation adhesives that comply with the following limits for VOC content when calculated according to 40 CFR 59, Subpart D (EPA Method 24):
 - 1. Wood Glues: 30 g/L.
 - 2. Contact Adhesive: 250 g/L.
- D. Adhesive for Bonding Plastic Laminate: Unpigmented contact cement or Contact cement.
 - 1. Adhesive for Bonding Edges: Hot-melt adhesive or adhesive specified above for faces.

2.3 FABRICATION, GENERAL

- A. Interior Woodwork Grade: Unless otherwise indicated, provide Custom Grade interior woodwork complying with referenced quality standard.
- B. Wood Moisture Content: Comply with requirements of referenced quality standard for wood moisture content in relation to ambient relative humidity during fabrication and in installation areas.
- C. Fabricate woodwork to dimensions, profiles, and details indicated.
- D. Complete fabrication, including assembly, finishing, and hardware application, to maximum extent possible before shipment to Project site. Disassemble components only as necessary for shipment and

installation. Where necessary for fitting at site, provide ample allowance for scribing, trimming, and fitting.

1. Trial fit assemblies at fabrication shop that cannot be shipped completely assembled. Install dowels, screws, bolted connectors, and other fastening devices that can be removed after trial fitting. Verify that various parts fit as intended and check measurements of assemblies against field measurements indicated on Shop Drawings before disassembling for shipment.
- E. Shop-cut openings to maximum extent possible to receive hardware, appliances, plumbing fixtures, electrical work, and similar items. Locate openings accurately and use templates or roughing-in diagrams to produce accurately sized and shaped openings. Sand edges of cutouts to remove splinters and burrs.

2.4 PLASTIC-LAMINATE CABINETS

- A. Grade: Custom.
- B. AWI Type of Cabinet Construction: Flush overlay, on Existing Cabinets.
- C. Laminate Cladding for Exposed Surfaces: High-pressure decorative laminate complying with the following requirements:
1. Horizontal Surfaces Other Than Tops: Grade HGS.
 2. Vertical Surfaces: Grade VGS.
 3. Edges: PVC edge banding, 0.12 inch (3 mm) thick, matching laminate in color, pattern, and finish.
- D. Colors, Patterns, and Finishes: As indicated above.

2.5 HARDWARE

- A. Remove, protect and replace existing hardware to exact locations.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Before installation, condition woodwork to average prevailing humidity conditions in installation areas.
- B. Remove existing hardware, label per location for replacement over new surface.
- C. Before installing architectural woodwork, examine shop-fabricated work for completion and complete work as required, including removal of packing and backpriming.

3.2 INSTALLATION

- A. Grade: Install woodwork to comply with requirements for the same grade specified in Part 2 for fabrication of type of woodwork involved.

- B. Assemble woodwork and complete fabrication at Project site to comply with requirements for fabrication in Part 2, to extent that it was not completed in the shop.
- C. Install woodwork level, plumb, true, and straight. Shim as required with concealed shims. Install level and plumb (including tops) to a tolerance of 1/8 inch in 96 inches (3 mm in 2400 mm).
- D. Scribe and cut woodwork to fit adjoining work, refinish cut surfaces, and repair damaged finish at cuts.
- E. Anchor woodwork to anchors or blocking built in or directly attached to substrates. Secure with countersunk, concealed fasteners and blind nailing as required for complete installation. No exposed fastening. Utilize pre-drilled hardware locations.
- F. Cabinets: Install without distortion so doors and drawers fit openings properly and are accurately aligned. Adjust hardware to center doors and drawers in openings and to provide unencumbered operation.
 - 1. Install cabinets with no more than 1/8 inch in 96-inch (3 mm in 2400-mm) sag, bow, or other variation from a straight line.
 - 2. Maintain direction of grain for all new laminate surfacing.
- G. Touch up finishing work specified in this Section after installation of woodwork. Be sure all exposed edges are smooth.

3.3 ADJUSTING AND CLEANING

- A. Repair damaged and defective woodwork, where possible, to eliminate functional and visual defects; where not possible to repair, replace woodwork. Adjust joinery for uniform appearance.
- B. Clean, lubricate, and adjust hardware.
- C. Clean woodwork on exposed and semi-exposed surfaces.

END OF SECTION 064020

SECTION 099123 - INTERIOR PAINTING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes surface preparation and the application of paint systems on, but not limited to the following interior substrates:

1. Gypsum board band at Rotunda-Base Bid.
2. Gypsum board band at Concourse-Add Alternate No. 1.

1.2 ACTION SUBMITTALS

- A. Samples for Verification: For each type of paint system and in each color and gloss of topcoat.

1. Submit Samples on rigid backing, 8 inches (200 mm) square.
2. Label each Sample for location and application area per designation on Finish Schedule.

1.3 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials, from the same product run that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Paint: 5 percent, but not less than 1 gal. (3.8 L) of each material and color applied.

1.4 QUALITY ASSURANCE

- A. Mockups: Apply mockups of **each** paint system/color indicated and each color and finish selected to verify preliminary selections made under Sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.

1. Architect will select one surface to represent surfaces and conditions for application of each paint system specified in Part 3.
 - a. Vertical and Horizontal Surfaces: Provide samples of at least 100 sq. ft. (9 sq. m).
 - b. Trim: Provide samples of at least 5 lineal ft.
2. Final approval of color selections will be based on mockups.
 - a. If preliminary color selections are not approved, apply additional mockups of additional colors selected by Architect at no added cost to Owner.

3. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless Architect specifically approves such deviations in writing.
4. Subject to compliance with requirements, approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F (7 deg C).
 1. Maintain containers in clean condition, free of foreign materials and residue.
 2. Remove rags and waste from storage areas daily.

1.6 FIELD CONDITIONS

- A. Owner will provide lift to access for Rotunda (Base Bid) and remainder of Concourse band (Add Alt. No. 1). Contractor to provide scaffolding or lift required to access area above climbing wall (over opening in main floor)-for Add Alt. No 1. Contractors encouraged to visit site prior to bid.
- B. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F (10 and 35 deg C).
- C. Do not apply paints when relative humidity exceeds 85 percent; at temperatures less than 5 deg F (3 deg C) above the dew point; or to damp or wet surfaces.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by the following paint manufacturers:
 1. Benjamin Moore & Co.
 2. PPG Architectural Finishes, Inc.
 3. Sherwin-Williams Company (The).

2.2 PAINT, GENERAL

- A. Material Compatibility:
 1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
 2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.

- B. VOC Content: Products shall comply with VOC limits of authorities having jurisdiction and, for interior paints and coatings applied at Project site, the following VOC limits, exclusive of colorants added to a tint base, when calculated according to 40 CFR 59, Subpart D (EPA Method 24)].
 - 1. Flat Paints and Coatings: 50 g/L.
 - 2. Nonflat Paints and Coatings: 150 g/L.
 - 3. Primers, Sealers, and Undercoaters: 200 g/L.
 - 4. Anticorrosive and Antirust Paints Applied to Ferrous Metals: 250 g/L.
 - 5. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
 - 6. Pretreatment Wash Primers: 420 g/L.
- C. Colors: To match Architect's selection and existing conditions, and per mock-up adjustments, as required. See Elevations in Documents.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
 - 1. Gypsum Board: 12 percent.
- C. Gypsum Board Substrates: Verify that finishing compound is sanded smooth. Make minor repairs if necessary.
- D. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- E. Proceed with coating application only after unsatisfactory conditions have been corrected.
 - 1. Application of coating indicates acceptance of surfaces and conditions.

3.2 PREPARATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Manual" applicable to substrates indicated.
- B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
 - 1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.

- C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.
 - 1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.
- D. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- E. Proceed with coating application only after unsatisfactory conditions have been corrected.
 - 1. Application of coating indicates acceptance of surfaces and conditions.

3.3 APPLICATION

- A. Apply paints according to manufacturer's written instructions and to recommendations in "MPI Manual."
 - 1. Use applicators and techniques suited for paint and substrate indicated.
 - 2. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
- B. Tint each undercoat a lighter shade to facilitate identification of each coat if multiple coats of same material are to be applied. Tint undercoats to match color of topcoat, but provide sufficient difference in shade of undercoats to distinguish each separate coat.
- C. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.
- D. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.

3.4 FIELD QUALITY CONTROL

- A. Dry Film Thickness Testing: Owner may engage the services of a qualified testing and inspecting agency to inspect and test paint for dry film thickness.
 - 1. Contractor shall touch up and restore painted surfaces damaged by testing.
 - 2. If test results show that dry film thickness of applied paint does not comply with paint manufacturer's written recommendations, Contractor shall pay for testing and apply additional coats as needed to provide dry film thickness that complies with paint manufacturer's written recommendations.

3.5 CLEANING AND PROTECTION

- A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.

- B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.
 - C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
 - D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.
- 3.6 INTERIOR PAINTING SCHEDULE—See Finish Elevation, verify sheen condition in field, confirm in Mock-ups.
- A. Gypsum Board Substrates:
 - 1. High-Performance Architectural Latex System:
 - a. Prime Coat: Primer sealer, latex, interior, MPI #50.
 - b. Intermediate Coat: Latex, interior, high performance architectural, matching topcoat.
 - c. Topcoat: Latex, interior, high performance architectural, (Gloss: Level 2— Low-Sheen Eg-Shel), MPI #138.

END OF SECTION 099123