
WOODROW COLLEGE STEAM PIPE REPLACEMENT

PROJECT NUMBER H27-2338-A COLUMBIA, SC CONSTRUCTION DOCUMENTS

DRAWING INDEX GENERAL MECHANICAL DETAILS, NOTES, MANHOLE DIAGRAMS AND LEGEND Swygert & Associates OF

CTS\16225\DRAWINGS\HVAC\16225-T1.dw

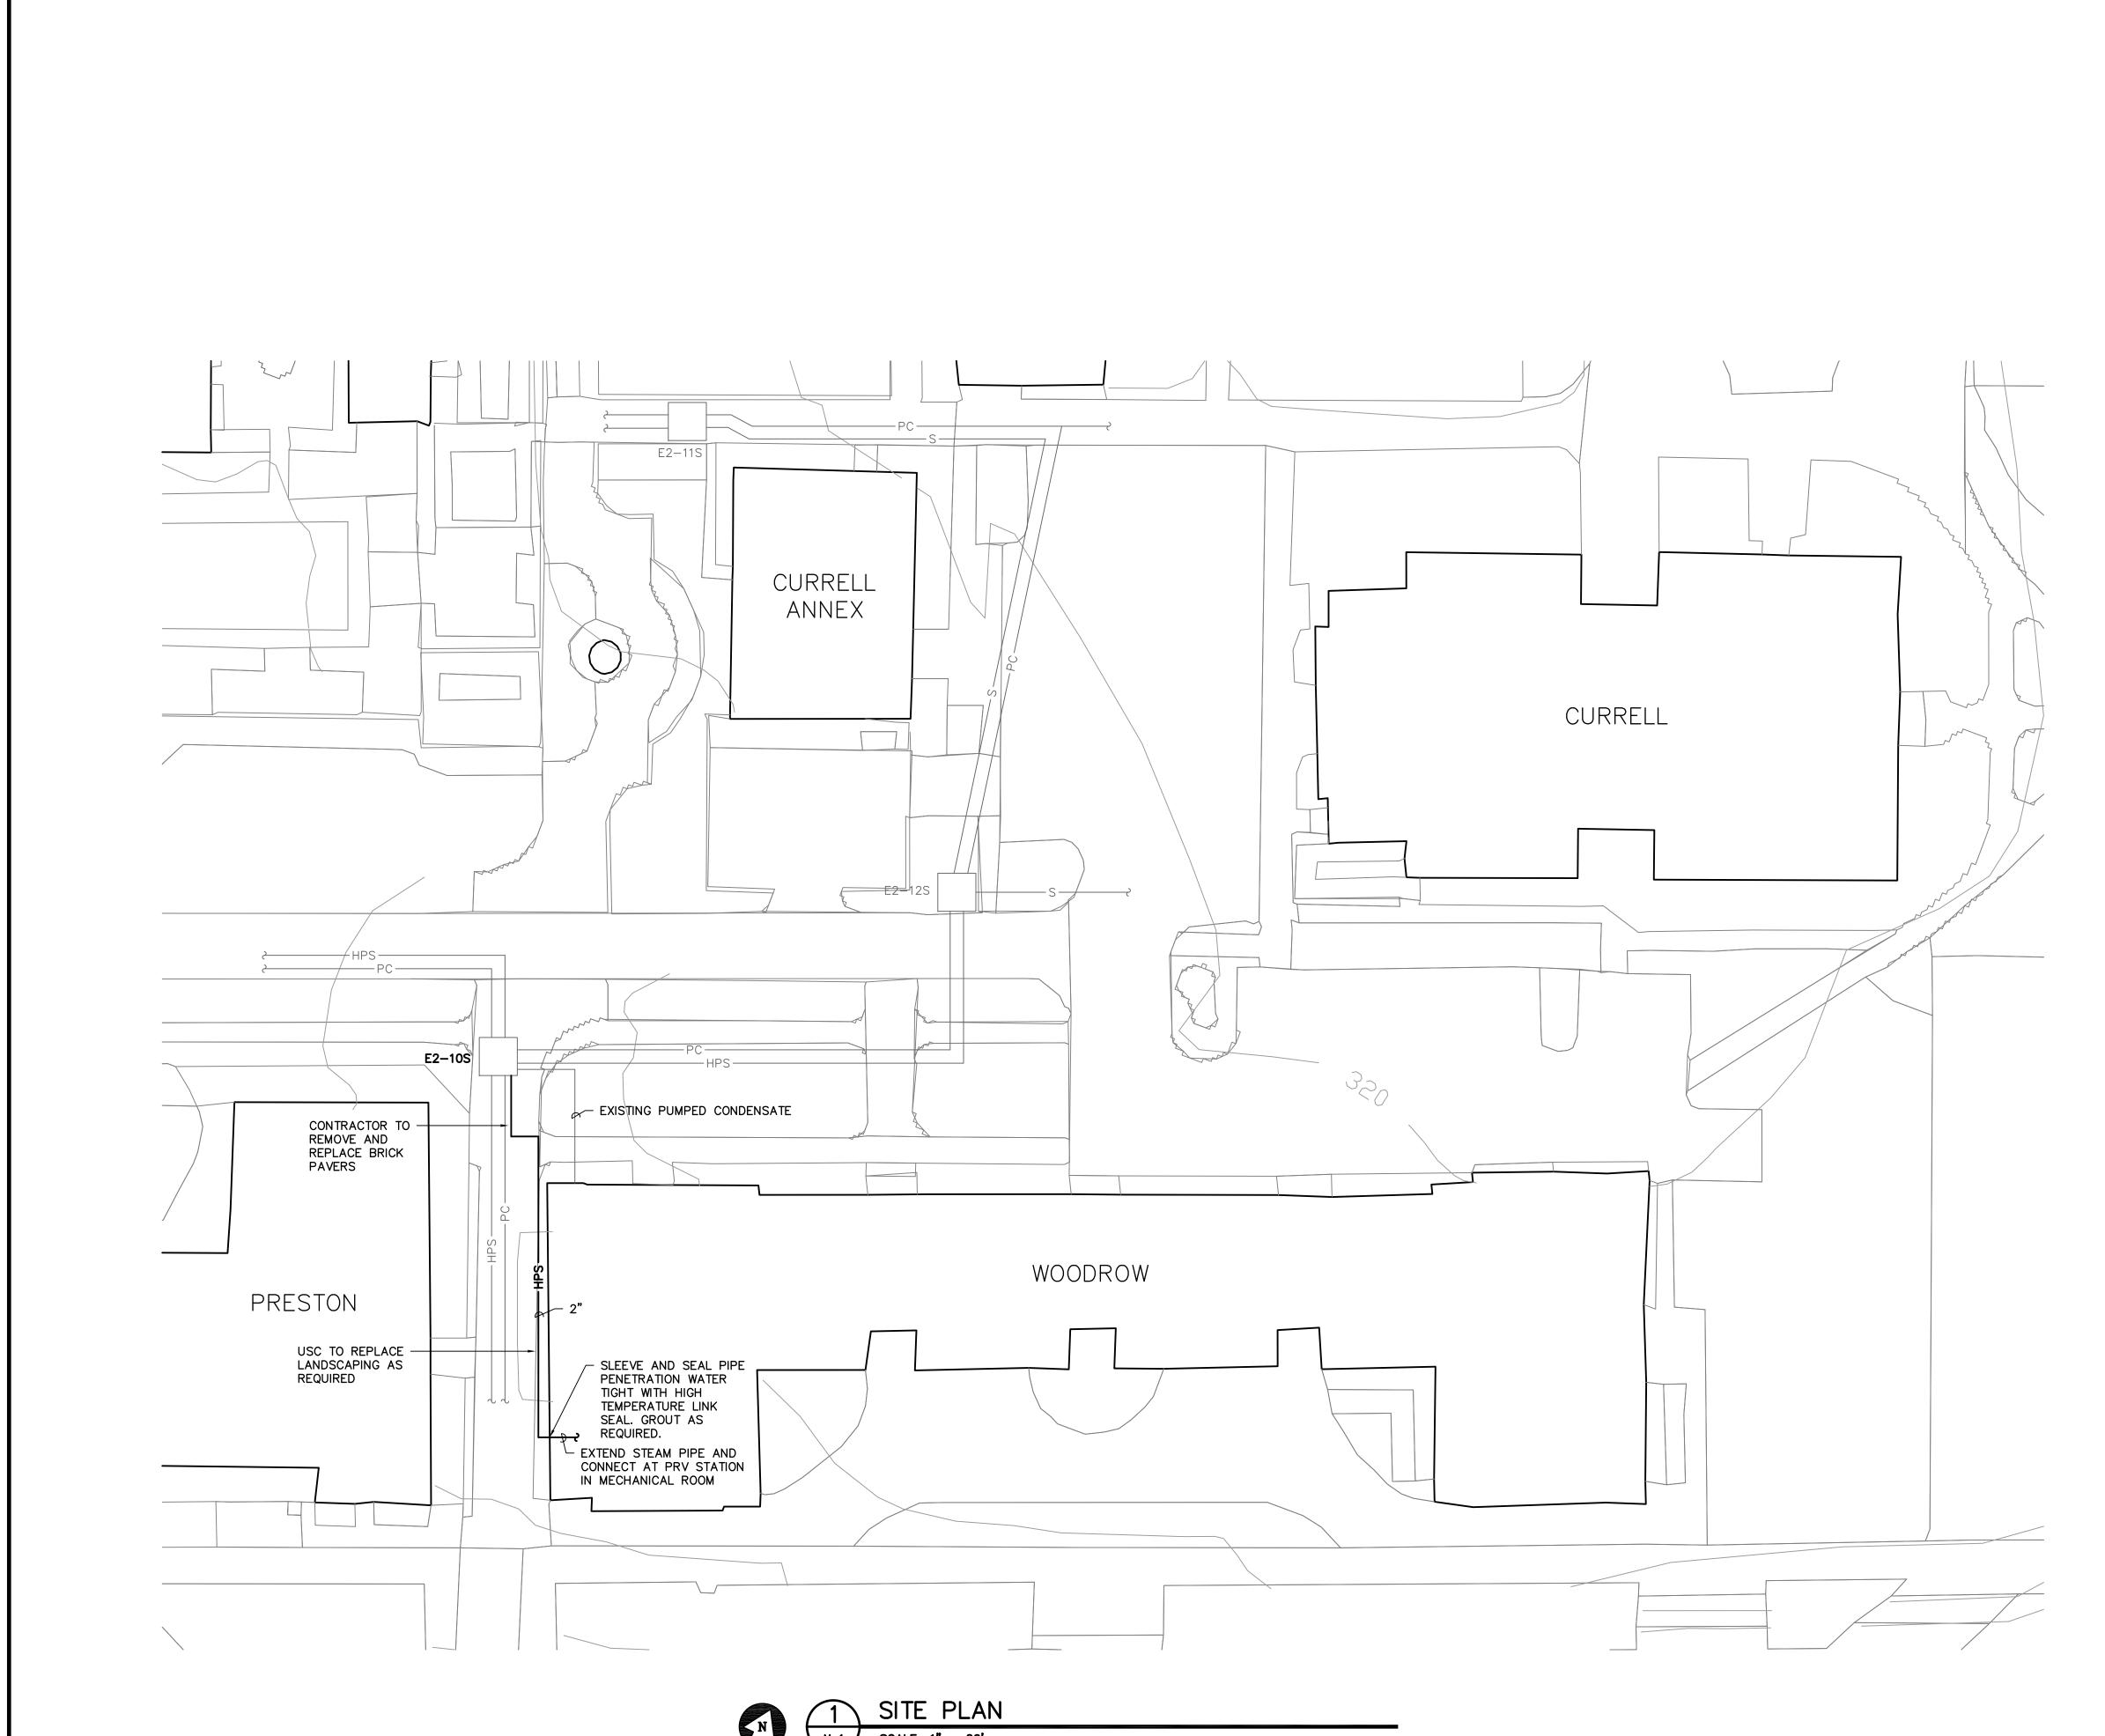

STEAM



Swygert & Associates CONSULTING ENGINEERS DBA Swygert & Assoc., Ltd.
Post Office Box 11686
Columbia, S.C. 29211


Telephone: (803) 791-9300
Facsimile: (803) 791-9330
mail@swygert-associates.com


M-1OF SHEET IN SET: OF

WOODROW COLLEGE REPLACEMENT PROJECT # H27-233

UTILITY PIPE ENTRY DETAIL

NO SCALE



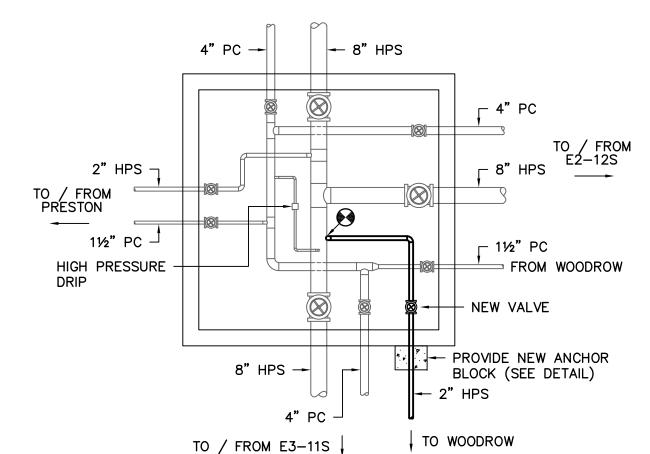



INSTALL HORIZONTAL BRACE TO ADJACENT POST ON EACH SIDE OF CORNER - 2½" O.D. GALV. FENCEPOST (TYP.) PAVED AREAS: SECURE EVERY POST SUPPORT Bracket with Sandbag

1. TREE PROTECTION FENCING SHALL BE PLACED BETWEEN ALL EXISTING TREES AND AROUND PROJECT WORK AREA AS APPROVED BY USC. 2. SEE "USC SUPPLEMENTAL GENERAL CONDITIONS FOR CONSTRUCTION PROJECTS" FOR ADDITIONAL INFORMATION. 3. PROVIDE PROTECTION FENCE FOR ALL TREES TO REMAIN. 4. PROTECTION FENCING TO BE PLACED OUTSIDE OF DRIPLINE OF TREE CANOPY UNLESS OTHERWISE APPROVED BY USC PROJECT MANAGER. 5. A 4" LAYER OF HARDWOOD MULCH SHALL BE PLACED OVER TREE PROTECTION AREA. 6. PROTECTION FENCING SHALL BE IN PLACE AND HARDWOOD MULCH PLACED PRIOR TO BEGINNING CONSTRUCTION. 7. REQUESTS FOR PAYMENT SHALL NOT BE APPROVED UNTIL PROTECTION FENCING AND MULCH IS IN PLACE. 8. LOCATION OF THE PROTECTION FENCING SHALL BE MARKED BY USC ARBORIST AND APPROVED BY USC PROJECT MANAGER BEFORE INSTALLATION. WHERE CONSTRUCTION IS LIKELY TO OCCUR WITHIN 5' OF PROPOSED LOCATION OF PROTECTION FENCING, CONTRACTOR SHALL HAVE LIMITS OF CONSTRUCTION MARKED BY SURVEY BEFORE PROTECTION FENCING IS INSTALLED. 9. SCREEN FABRIC SHALL BE DARK GREEN 85% OPAQUE, POLYETHEYLENE KNIT MESH, UV STABILIZED WITH BURST STRENGTH OF AT LEAST 210 P.S.I.

STAKE EVERY POST SUPPORT

BRACKET WITH 18" REBAR J-HOOK

TIE ±24" O.C. (TYP.)

SCREEN FABRIC -

24" X 24" POST

SUPPORT BRACKET (TYP.)

WORK AREA SCREENING AND TREE PROTECTION FENCE PANEL DETAIL

NO SCALE

STANDARD ANCHOR ASSEMBLY

CONDUIT

AIR VENT

INSULATION

SERVICE PIPE

SECTION A-A

NO SCALE

ANCHOR PLATE

CONTINUOUSLY WELDED

NOTE: DETAIL TYPICAL FOR

THAN 5' FROM MANHOLE.

A = ANCHOR PLATE HEIGHT

= CONDUIT O. D. + 1"

= CONDUIT O. D. + 6"

t* = ANCHOR PLATE THICKNESS 1/2" UP TO 22" CONDUIT SIZE

3/4" FOR 24" AND LARGER CONDUIT

* SPECIAL PLATE THICKNESS REQUIRED

THE TOP AND BOTTOM OF ANCHOR PLATE.

FOR SYSTEMS W/ EXPANSION JOINTS

NOTE: A CONCRETE BLOCK SHALL BE CAST OVER THE

LENGTH AND SHALL EXTEND A MINIMUM OF 9" BEYOND


PLATE AND CONDUIT AND SHALL BE AT LEAST 30" IN

B = ANCHOR PLATE WIDTH

TWO PIPES. ANCHOR ASSEMBLIES

TO BE POSITIONED NO FURTHER

BRICK PAVERS MORTARED BRICK PAVERS

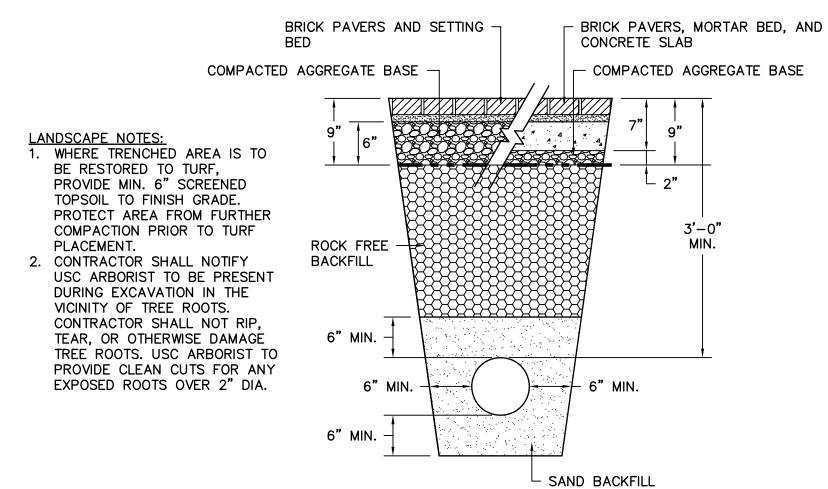

BACKFILL DETAIL

FOAMGLASS ·

6" MIN

NO SCALE

TO BE LEFT LEVEL WITH EXISTING GRADE OR PATCH

1 FT. MINIMUM

ROCK FREE

BACKFILL

6" MINIMUM SIDE TO SIDE

SAND BACKFILL

JACKET

PAVERS TO MATCH

EXISTING

BACKFILL DETAIL AT PAVERS

NO SCALE

GENERAL NOTES

- DO NOT SCALE DRAWINGS. VERIFY ALL REQUIRED INFORMATION IN THE FIELD BY VISITING SITE PRIOR TO SUBMITTING BID.
- EXACT ROUTING OF PIPING SHALL BE SET IN FIELD TO MINIMIZE CONFLICTS WITH ALL ABOVE AND UNDERGROUND STRUCTURES, TREES, FENCES, WALKS, WALLS, AND UTILITIES.
- ALL PIPING IS SHOWN DIAGRAMMATIC. HOWEVER, CONTRACTOR SHALL PROVIDE ALL REQUIRED FITTINGS, PIPING, AND INSULATION FOR ALL OFFSETS AND/OR CHANGES IN ELEVATIONS. WHERE NECESSARY DUE TO INTERFERENCE. CONTRACTOR SHALL MODIFY EXISTING PIPING, EQUIPMENT, ETC.
- 4. ALL VALVES AND SPECIALTIES SHALL BE LINE SIZE UNLESS INDICATED OTHERWISE ON DRAWINGS.
- 5. ALL STEAM AND PUMPED CONDENSATE SHALL PITCH DOWN A MINIMUM OF ONE INCH PER FIFTY FEET.
- 6. ALL OPENINGS THROUGH EXISTING STRUCTURES SHALL BE CORE DRILLED.
- 7. COLD SPRING ALL STEAM LINES FIFTY (50) PERCENT.
- WHERE PIPING ENTERS MANHOLE CONSTRUCT ENTRY AS REQUIRED. ALL PIPES TO BE SLEEVED AND LINK SEALED TO MAKE
- 9. ALL PIPING AND FITTINGS IN MANHOLES TO BE INSULATED, SEE SPECIFICATIONS.
- 10. CONTRACTOR SHALL COORDINATE AND OBTAIN APPROVAL FROM OWNER FOR INTERRUPTIONS AND CONNECTIONS TO EXISTING UTILITY SYSTEMS.
- 11. CONTRACTOR SHALL COORDINATE TREE AND LANDSCAPING REPLACEMENT WITH USC. IN GENERAL USC WILL REPLACE SMALL TREES THAT ARE NOTED TO BE REPLACED. CONTRACTOR IS RESPONSIBLE FOR SOD REPLACEMENT.
- 12. CONTRACTOR IS RESPONSIBLE FOR REMOVAL AND REPLACEMENT OF ALL BRICK PAVERS TO MATCH THE EXISTING CONDITION.
- 13. CONTRACTOR SHALL CONTACT PALMETTO UTILITY PROTECTION SERVICES TO LOCATE UTILITIES PRIOR TO DIGGING. INFORMATION OBTAINED FROM PALMETTO UTILITY PROTECTION SERVICES AND DURING DIGGING SHALL BE INDICATED ON THE AS-BUILT DRAWINGS.
- 14. CONSTRUCT TEMPORARY FENCING AROUND PROJECT AREA TO PROTECT THE SITE AND PEDESTRIANS.

LEGEND			
SYMBOL			DESCRIPTION
	—s—	~	NEW HIGH PRESSURE STEAM LINE
	—PC—	\sim	NEW PUMPED CONDENSATE LINE
۰–ځ		- ੇ	EXISTING PIPE TO BE REMOVED OR ABANDONED
ح	— PC —		EXISTING PUMPED CONDENSATE LINE
ح	—s—		EXISTING HIGH PRESSURE STEAM LINE
<u>ک</u>	— GC —		EXISTING GRAVITY CONDENSATE LINE
2	— CR —		EXISTING CHILLED WATER RETURN LINE
2	— cs —		EXISTING CHILLED WATER SUPPLY LINE
2	—Е—		EXISTING HIGH VOLTAGE ELECTRICAL LINE
2	— c —		EXISTING COMMUNICATIONS LINE
2	— EC —		EXISTING ELECTRICAL AND COMMUNICATIONS PRIMARY DUCT
2	— SS —		EXISTING SANITARY SEWER LINE
2	— HG —		EXISTING HIGH PRESSURE GAS LINE
2	— LG —	~	EXISTING LOW PRESSURE GAS LINE
2	— SD —	~	EXISTING STORM DRAIN LINE
		~	VELAN GATE VALVE, SEE SPECS
	•		CONNECTION POINT OF NEW TO EXISTING

SWYGERT AND ASSOCIATES, LTD. NO. C00227

Swygert & Associates CONSULTING ENGINEERS

M-2OF

DBA Swygert & Assoc., Ltd.
Post Office Box 11686
Columbia, S.C. 29211

Telephone: (803) 791-9300
Facsimile: (803) 791-0830
mail@swygert-associates.com

HEET IN SET: OF

LANNING FRUCTION SC 29208

PLA STRI

AMPUS ND CON COLUMBIA