



AMENDMENT NO. 1 TO SOLICITATION

DATE: August 30, 2018
TO: ALL VENDORS
FROM: Tracy Fountain
SUBJECT: USC-RFQ-3345-TF
DESCRIPTION: **Furnish, Deliver and Install Valcom – Support Security Alert System at USC Beaufort Campus**

This Amendment No. 1 modifies the Request for Quotes only in the manner and to the extent as stated herein.

- Item #1** **Change Deadline for Quotes to September 4, 2018 at 10:00 a.m.**
 - Item #2** **Questions and Answers from Vendors – See page 2**
 - Item #3** **Floor Plans attached pages 3-5**
-
-

OFFERORS SHALL ACKNOWLEDGE RECEIPT OF AMENDMENT NO. 1 IN THE SPACE PROVIDED BELOW AND RETURN IT WITH THEIR QUOTE RESPONSE. FAILURE TO DO SO MAY SUBJECT QUOTE TO REJECTION.

Authorized Signature

Name of Offeror

Date

Vendor Questions Answers from USC in Red

QUESTIONS FROM OFFERORS - AMENDMENT (JUN 2017) THE SOLICITATION IS AMENDED AS PROVIDED HEREIN. INFORMATION OR CHANGES RESULTING FROM QUESTIONS WILL BE SHOWN IN A QUESTIONAND-ANSWER FORMAT. ALL QUESTIONS RECEIVED HAVE BEEN REPRINTED BELOW. THE "STATE'S RESPONSE" SHOULD BE READ WITHOUT REFERENCE TO THE QUESTIONS. THE QUESTIONS ARE INCLUDED SOLELY TO PROVIDE A CROSS-REFERENCE TO THE POTENTIAL OFFEROR THAT SUBMITTED THE QUESTION. QUESTIONS DO NOT FORM A PART OF THE CONTRACT; THE "STATE'S RESPONSE" DOES. ANY RESTATEMENT OF PART OR ALL OF AN EXISTING PROVISION OF THE SOLICITATION IN AN ANSWER DOES NOT MODIFY THE ORIGINAL PROVISION EXCEPT AS FOLLOWS: UNDERLINED TEXT IS ADDED TO THE ORIGINAL PROVISION. STRICKEN TEXT IS DELETED. [02-2A097-1]

1. Could you provide a drawing for the layout of the requested system?

Answer: Attached is a floor plan encompassing both student Housing buildings for this installation. The vendor has moderate freedom to place the system in a manner that allows students to hear the alerts from their rooms. USCB IT provides power outlets and a data network connection in IT Closets. The quote for 6 total speakers assumes placement of 1 functioning speaker in the stairwell breezeway on each of the 1st, 2nd, and 3rd floors of each of the two Housing buildings.

2. What is the brand/model of the existing emergency system?

Answer: The existing emergency systems on campus are Valcom. These two buildings are new construction and now simply need the hardware to be connected to the rest of the campus. The existing Valcom system has various pieces and parts including Valcom app, telephone, and elaunch servers. The servers are available using the USCB data network.

3. Related, can you describe, or provide documentation for, the integration of this Valcom receiver to the existing emergency system?

Answer: The current USC Beaufort emergency system is comprised of Valcom equipment. This request for quotes will allow us to purchase the items required to bring two newly constructed Housing buildings online in a manner that is compatible with the whole system. USCB IT provides power outlets and the data network connection to connect the new items to the existing system.



NILES BOLTON
42361 12/15/2017
PROJECT # 117052
DRAWN BY: KJR
CHECKED BY: KWR

NILES BOLTON ASSOCIATES



NILES BOLTON ASSOCIATES
#S-92021
3060 Peachtree Rd. N.W.
Suite 600
Atlanta, GA 30305
T 404 365 7600
F 404 365 7610

www.nilesbolton.com

No.	Description	Date
1	ISSUED FOR PERMIT SET	11/03/17
A	ISSUED FOR PERMIT SET II	12/18/17
B	ISSUED FOR CONSTRUCTION	01/31/18

This drawing is an instrument of service and shall remain the property of the drafter and shall not be reproduced, distributed or used in any way without the permission of the drafter.

BOUNDARY ROW & NEWCASTLE STREET STUDENT HOUSING
1109 & 1117 BOUNDARY STREET
BEAUFORT, SOUTH CAROLINA, 29902
303 ASSOCIATES

SHEET TITLE:

FLOOR PLAN- LEVEL 1


SHEET NUMBER:

A1.110

ISSUED FOR CONSTRUCTION
12/18/2017



RELEASED FOR CONSTRUCTION

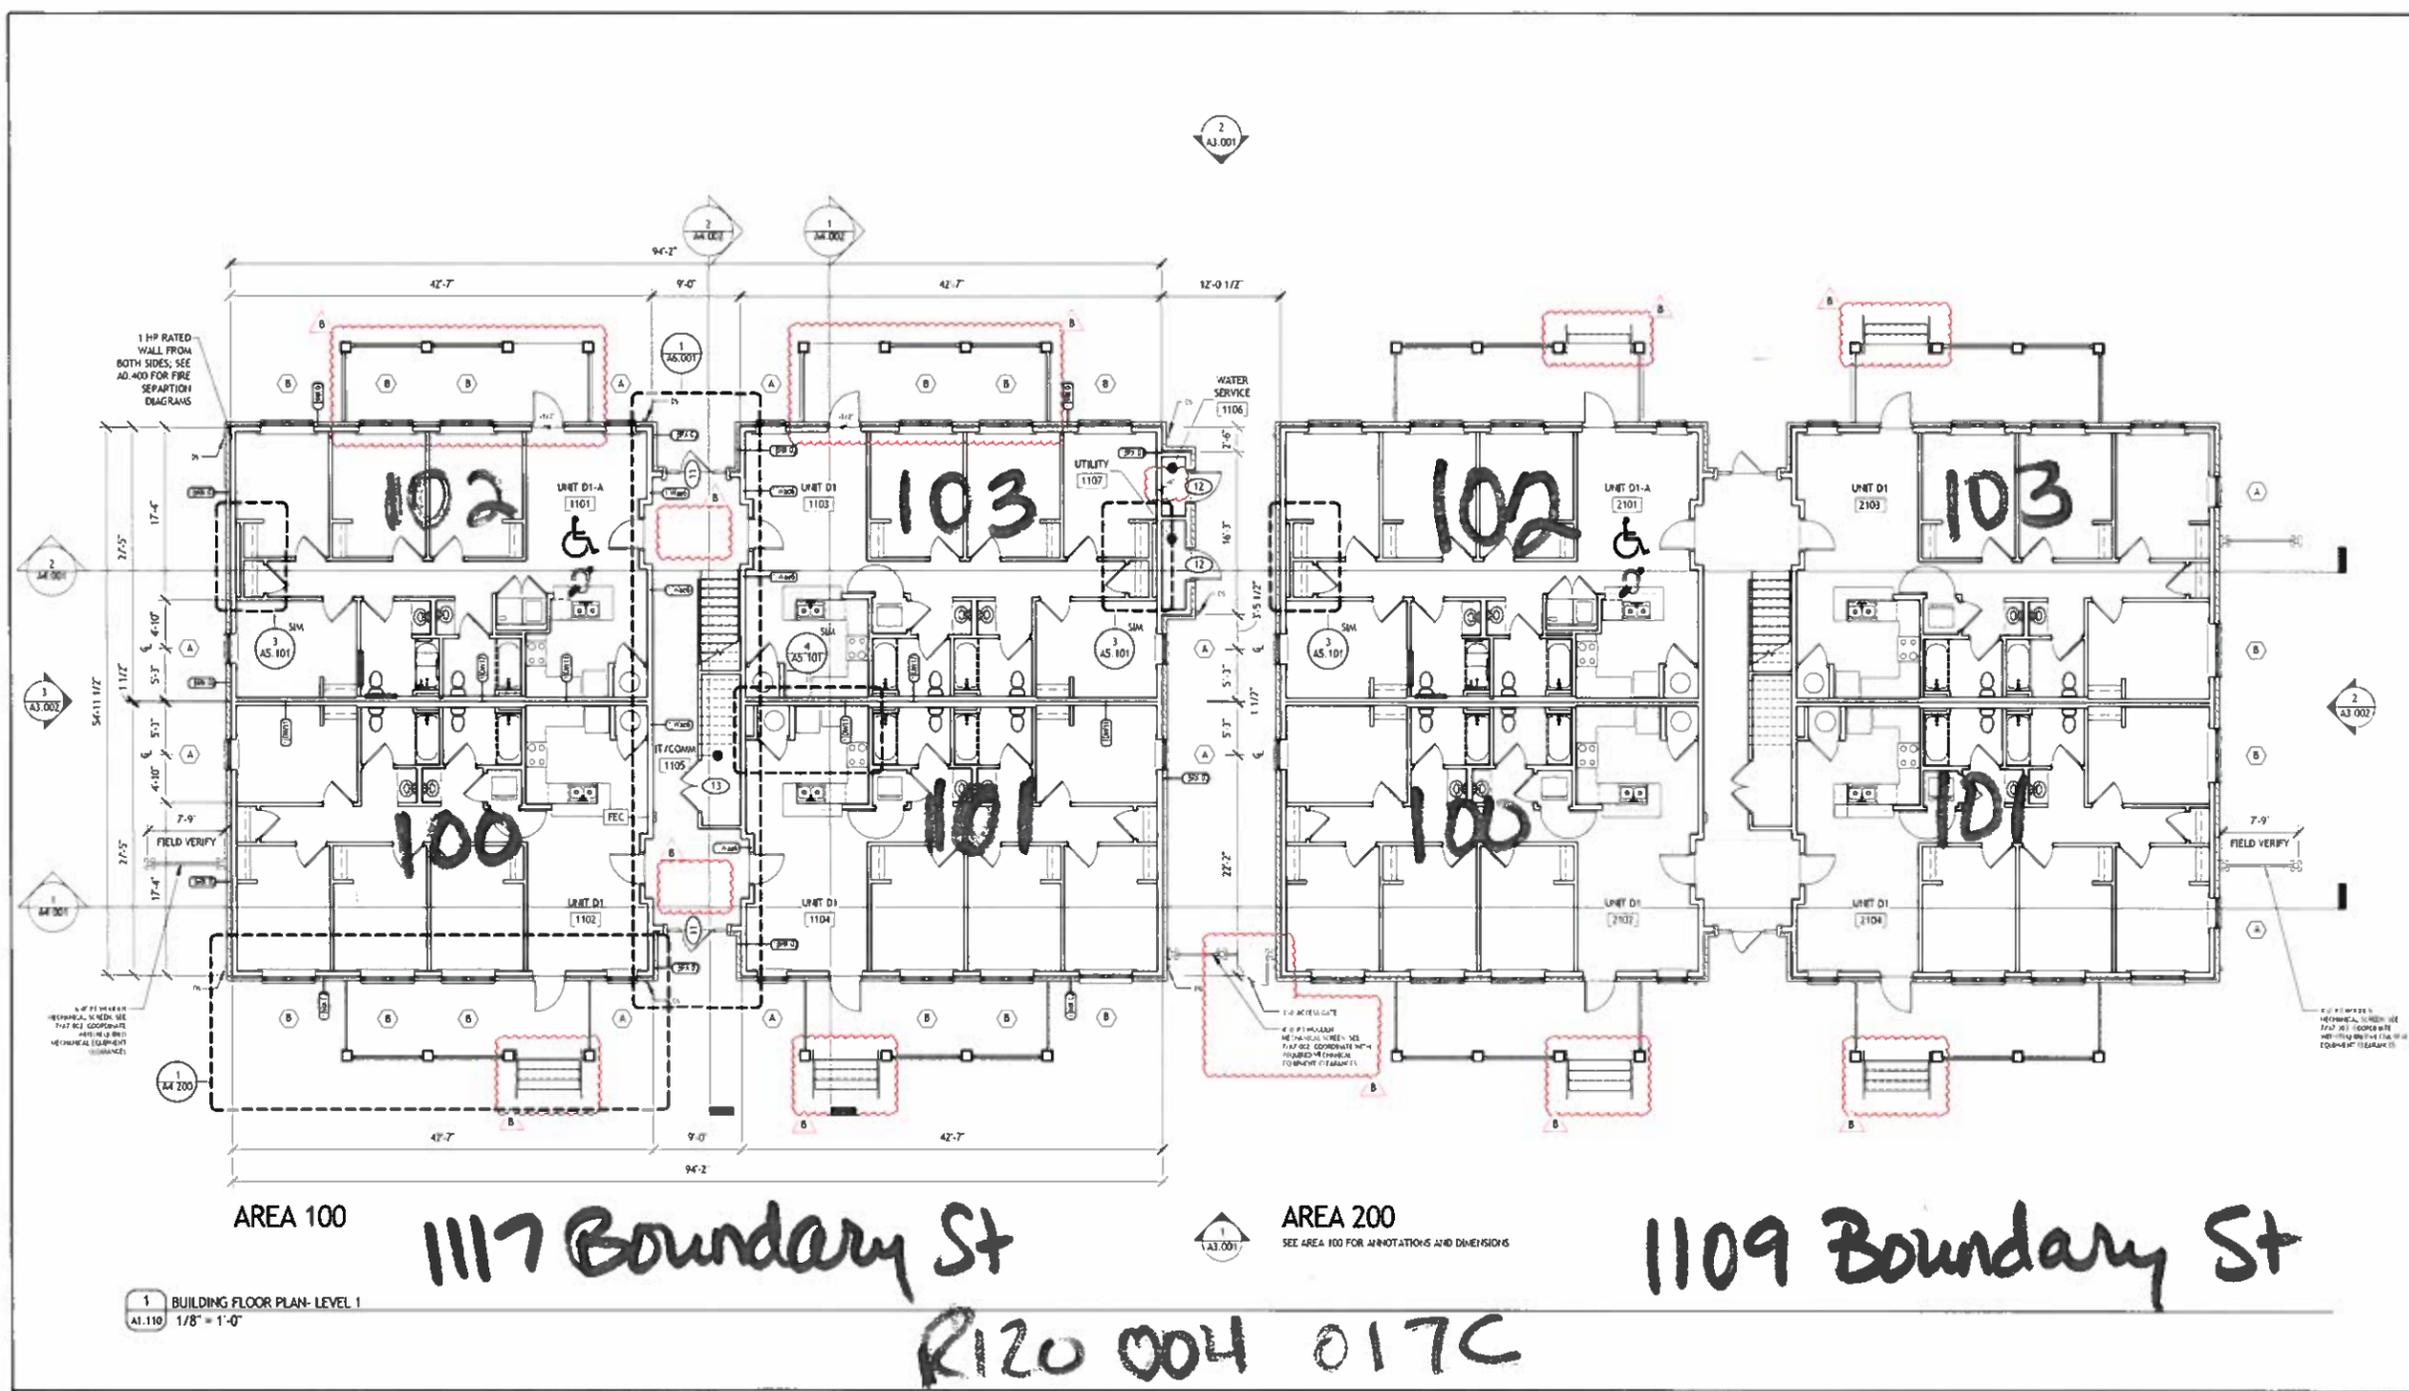

FLOOR PLAN NOTES

- SEE CIVIL ENGINEER'S DRAWINGS FOR SITE WORK AND SIDEWALK DETAILS. 2% MAX SLOPE AT EXTERIOR DOOR LOCATIONS.
- SEE LIFE SAFETY PLANS FOR WALL RATINGS AND GENERAL NOTES.
- SEE AS 100 FOR ACCESSIBILITY REQUIREMENTS, MINIMUM CLEARANCES, AND MOUNTING HEIGHTS.
- REFER TO UNIT PLANS FOR UNIT DIMENSIONS AND ACCESSIBILITY INFORMATION.
- DOOR ARE 4" FROM STRUCTURE OR CENTER IN THE HOST WALL UNLESS DIMENSIONED OTHERWISE.
- REFER TO THE A6 SERIES DRAWINGS FOR ALL STAIR INFORMATION.
- ALL DOOR HARDWARE IS TO BE COORDINATED WITH THE CODE REQUIRED EGRESS COMPONENTS, ACCESSIBILITY REQUIREMENTS, AND ACCESS CONTROL REQUIREMENTS PER THE LOW VOLTAGE DRAWINGS.
- ACCESS CONTROL FOR ALL DOORS ARE TO BE COORDINATED WITH THE LOW VOLTAGE CONSULTANT, ARCHITECT, AND THE CLIENT.
- ALL SLABS ON GRADE TO RECEIVE VAPOR BARRIER, HARDENER AND BREATHABLE SEALERS.
- ANY WINDOW OR GLASS WITHIN A 24" HORIZONTAL DISTANCE OF A DOOR SHALL HAVE TEMPERED GLAZING. ANY WINDOW OR GLAZING LESS THAN 18" AFF SHALL BE TEMPERED. ANY WINDOW OR GLAZING WITHIN A BATHROOM SHALL BE TEMPERED.

13. REFER TO THE A5 SERIES DRAWINGS FOR INDIVIDUAL UNIT PLANS & DIMENSIONS

14. ALL FIRE BARRIERS ARE TO BE LABELED WITH PERMANENT SIGNS OR STENCILING IN ALL CONCEALED SPACES INCLUDING ABOVE DECORATIVE CEILING. LETTERS TO BE 2" HIGH (MINIMUM) ON A CONTRASTING BACKGROUND, SPACED 12"-0" HORIZ. WITH A MINIMUM OF ONE PER WALL OR BARRIER. THE HOURLY RATING OF THE WALL OR BARRIER MUST BE INCLUDED.

ALL UNITS ON THIS LEVEL TO MEET FHA ACCESSIBILITY REQUIREMENTS, INCLUDING, BUT NOT LIMITED TO BLOCKING AT ALL REQUIRED LOCATIONS.

LEGEND:

- UNITS W/ MOBILITY FEATURES
- UNITS W/ COMMUNICATION FEATURES
- FD- FLOOR DRAIN: MINIMUM SLOPE OF 1/8" PER FOOT AND A MAX OF 2"
- WINDOW TYPE
- PARTITION DESIGNATION SEE G0 001
- DOOR DESIGNATION (SEE DOOR SCHEDULE AB 101)
- DS - DOWNSPOUT LOCATION

C:\TEMP\117052\USG-BRCH-R16_07_Arched300.dwg
2/1/2018 11:51:36 AM



NILES BOLTON
#2361 12/15/2017
PROJECT # 117052
DRAWN BY: KJR
CHECKED BY: KWR

NILES BOLTON ASSOCIATES



NILES BOLTON ASSOCIATES
#B-92021
3060 Peachtree Rd. N.W.
Suite 600
Atlanta, GA 30305
T 404 365 7600
F 404 365 7610
www.nilesbolton.com


No.	Description	Date
A	ISSUED FOR PERMIT SET	11/03/17
B	ISSUED FOR PERMIT SET II	12/18/17
C	ISSUED FOR CONSTRUCTION	01/31/18

This drawing, as a contract document, is and shall remain the property of the Architect and shall not be reproduced, distributed, or used in any way without the permission of the Architect.

BOUNDARY ROW & NEWCASTLE STREET STUDENT HOUSING
1109 & 1117 BOUNDARY STREET
BEAUFORT, SOUTH CAROLINA, 29902
303 ASSOCIATES

SHEET TITLE:
FLOOR PLAN- LEVEL 2

SHEET NUMBER:
A1.210
ISSUED FOR CONSTRUCTION
12/18/2017

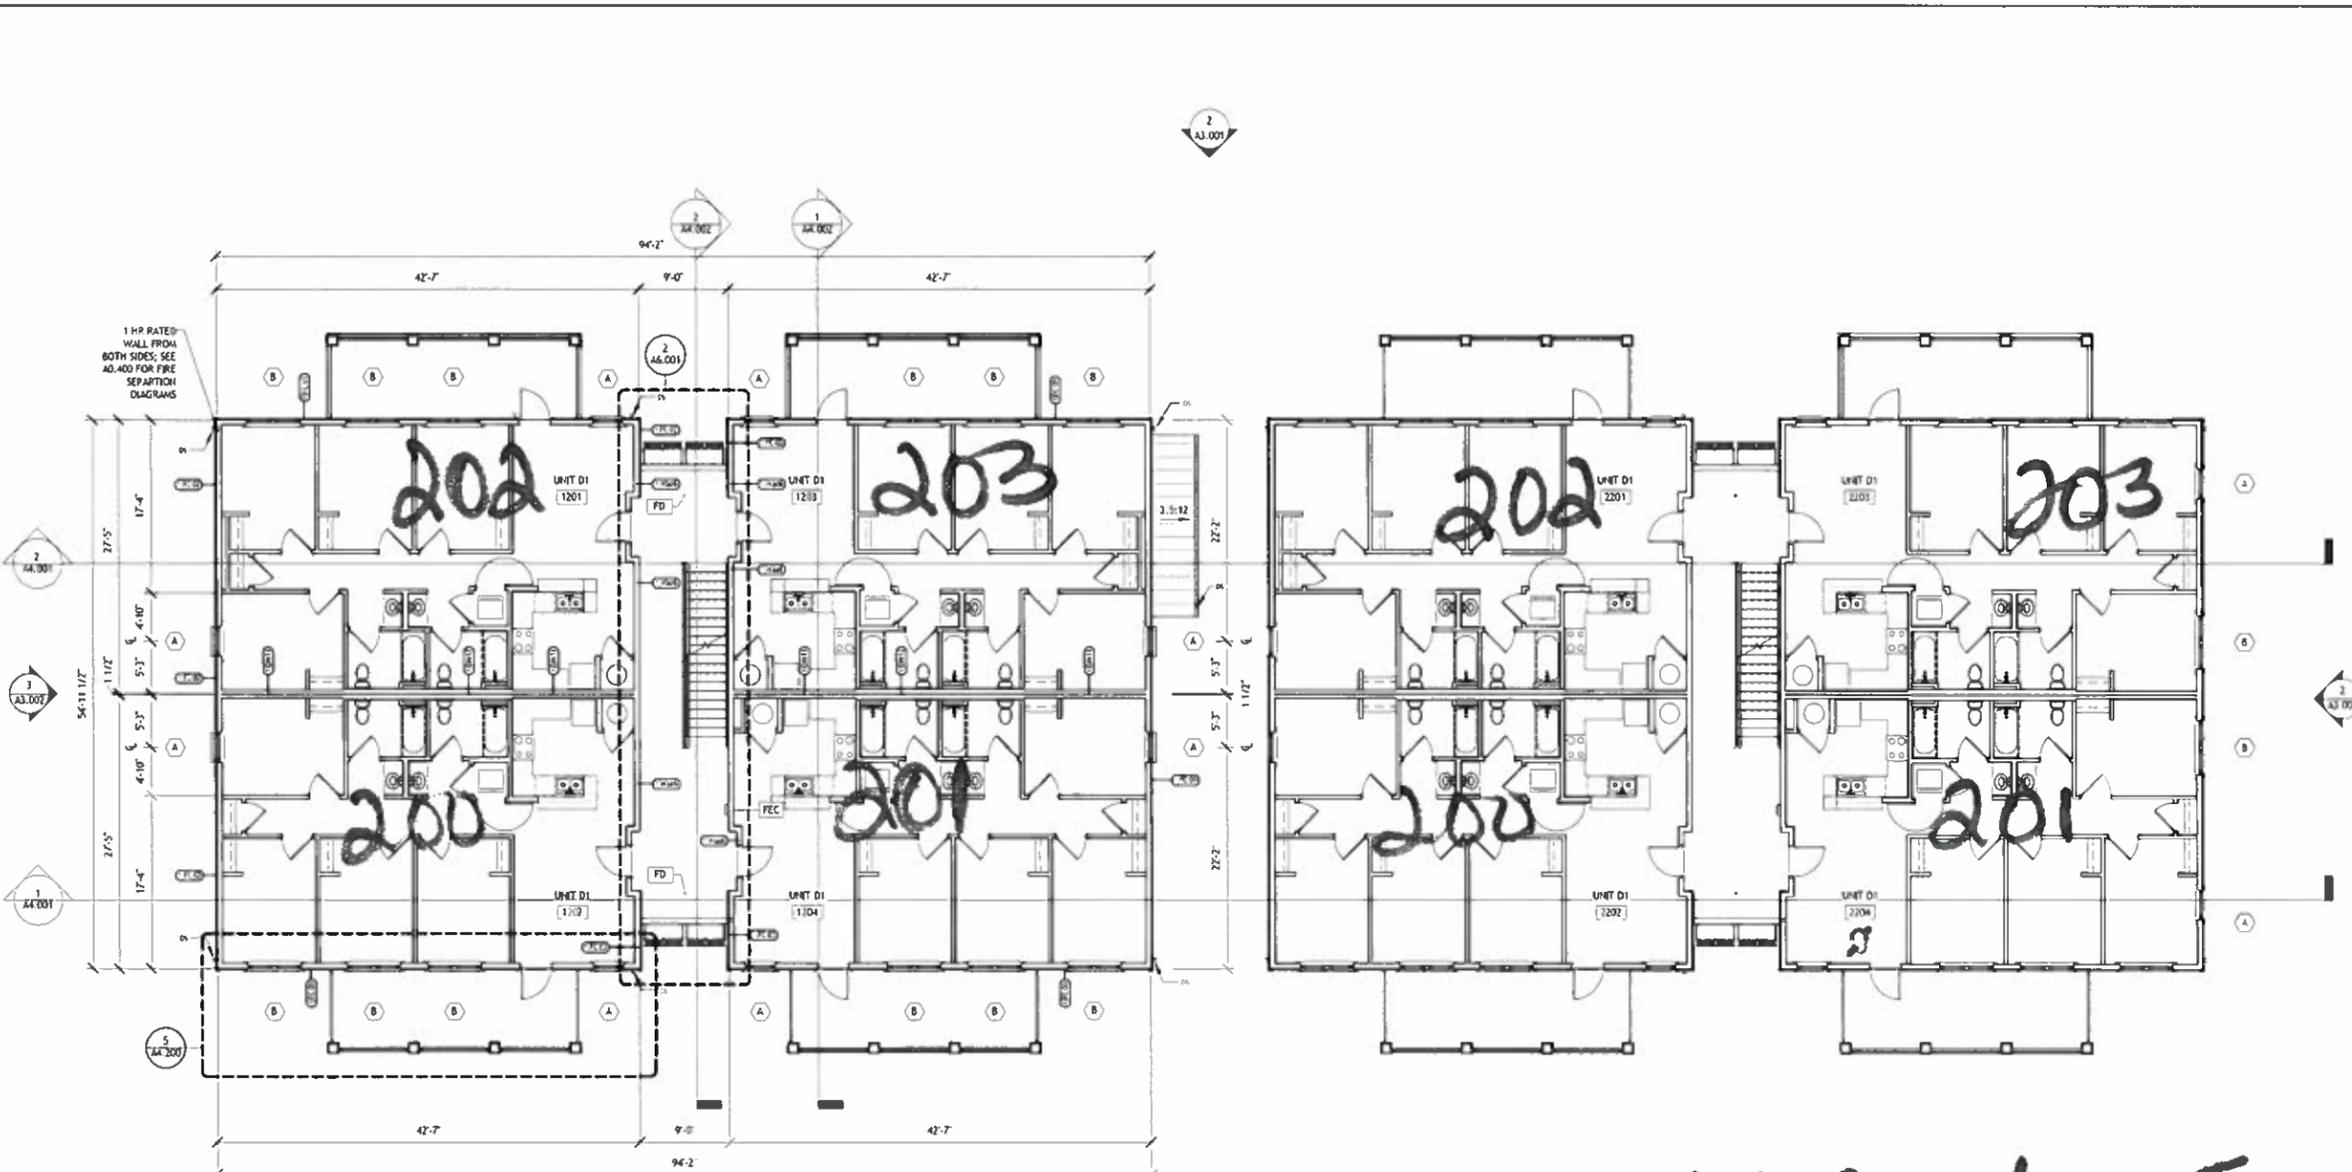

AREA 100

1117 Boundary St

AREA 200

1109 Boundary St

1 BUILDING FLOOR PLAN- LEVEL 2
A1.210 1/8" = 1'-0"

R120004 017C

FLOOR PLAN NOTES

- SEE CIVIL ENGINEER'S DRAWINGS FOR SITE WORK AND SIDEWALK DETAILS. 2) MAX SLOPE AT EXTERIOR DOOR LOCATIONS.
- SEE LIFE SAFETY PLANS FOR WALL RATINGS AND GENERAL NOTES.
- SEE AS.00 FOR ACCESSIBILITY REQUIREMENTS, MINIMUM CLEARANCES, AND MOUNTING HEIGHTS.
- REFER TO UNIT PLANS FOR UNIT DIMENSIONS AND ACCESSIBILITY INFORMATION.
- DOOR ARE 4" FROM STRUCTURE OR CENTER IN THE HOST WALL UNLESS DIMENSIONED OTHERWISE.
- REFER TO THE A6 SERIES DRAWINGS FOR ALL STAIR INFORMATION.
- ALL DOOR HARDWARE IS TO BE COORDINATED WITH THE CODE REQUIRED EGRESS COMPONENTS, ACCESSIBILITY REQUIREMENTS, AND ACCESS CONTROL REQUIREMENTS PER THE LOW VOLTAGE DRAWINGS.
- ACCESS CONTROL FOR ALL DOORS ARE TO BE COORDINATED WITH THE LOW VOLTAGE CONSULTANT, ARCHITECT, AND THE CLIENT.
- ALL SLABS ON GRADE TO RECEIVE VAPOR BARRIER, HARDENER AND BREATHABLE SEALERS.
- ANY WINDOW OR GLASS WITHIN A 24" HORIZONTAL DISTANCE OF A DOOR SHALL HAVE TEMPERED GLAZING. ANY WINDOW OR GLAZING LESS THAN 18" AFF SHALL BE TEMPERED. ANY WINDOW OR GLAZING WITHIN A BATHROOM SHALL BE TEMPERED.

- REFER TO THE A6 SERIES DRAWINGS FOR INDIVIDUAL UNIT PLANS & DIMENSIONS
- ALL FIRE BARRIERS ARE TO BE LABELED WITH PERMANENT SIGNS OR STENCILING IN ALL CONCEALED SPACES INCLUDING ABOVE DECORATIVE CEILING. LETTERS TO BE 2" HIGH (MINIMUM) ON A CONTRASTING BACKGROUND, SPACED 12-0" (MAX) WITH A MINIMUM OF ONE PER WALL OR BARRIER. THE HOURLY RATING OF THE WALL OR BARRIER MUST BE INCLUDED.

LEGEND:

- UNITS W/ MOBILITY FEATURES
- UNITS W/ COMMUNICATION FEATURES
- FD- FLOOR DRAIN MINIMUM SLOPE OF 1/8" PER FOOT AND A MAX OF 2.
- WINDOW TYPE
- PARTITION DESIGNATION (SEE G0.00)
- DOOR DESIGNATION (SEE DOOR SCHEDULE A8.101)
- DS- DRIPSPOUT LOCATION

C:\TEMP\117052_USER\MARCH 19.17_11090217.DWG
1/29/2018 2:49:08 PM



RELEASED FOR CONSTRUCTION



NILES BOLTON
#2341 12/13/2017
PROJECT # : 117052
DRAWN BY : KJR
CHECKED BY : KWR

NILES BOLTON ASSOCIATES



NILES BOLTON ASSOCIATES
#B-92021
3060 Peachtree Rd. N.W.
Suite 600
Atlanta, GA 30305
T 404 365 7600
F 404 365 7610
www.nilesbolton.com

No.	Description	Date
1	ISSUED FOR PERMIT SET	11/03/17
A	ISSUED FOR PERMIT SET II	12/18/17
B	ISSUED FOR CONSTRUCTION	01/31/18


This drawing, as a contract document, is to be used only for the project and site identified herein. It is not to be reproduced, distributed or used in any way without the permission of Niles Bolton Associates.

BOUNDARY ROW & NEWCASTLE STREET STUDENT HOUSING
1109 & 1117 BOUNDARY STREET
BEAUFORT, SOUTH CAROLINA, 29902
303 ASSOCIATES

SHEET TITLE:
FLOOR PLAN- LEVEL 3

SHEET NUMBER:
A1.310
ISSUED FOR CONSTRUCTION
12/18/2017

RELEASED FOR CONSTRUCTION

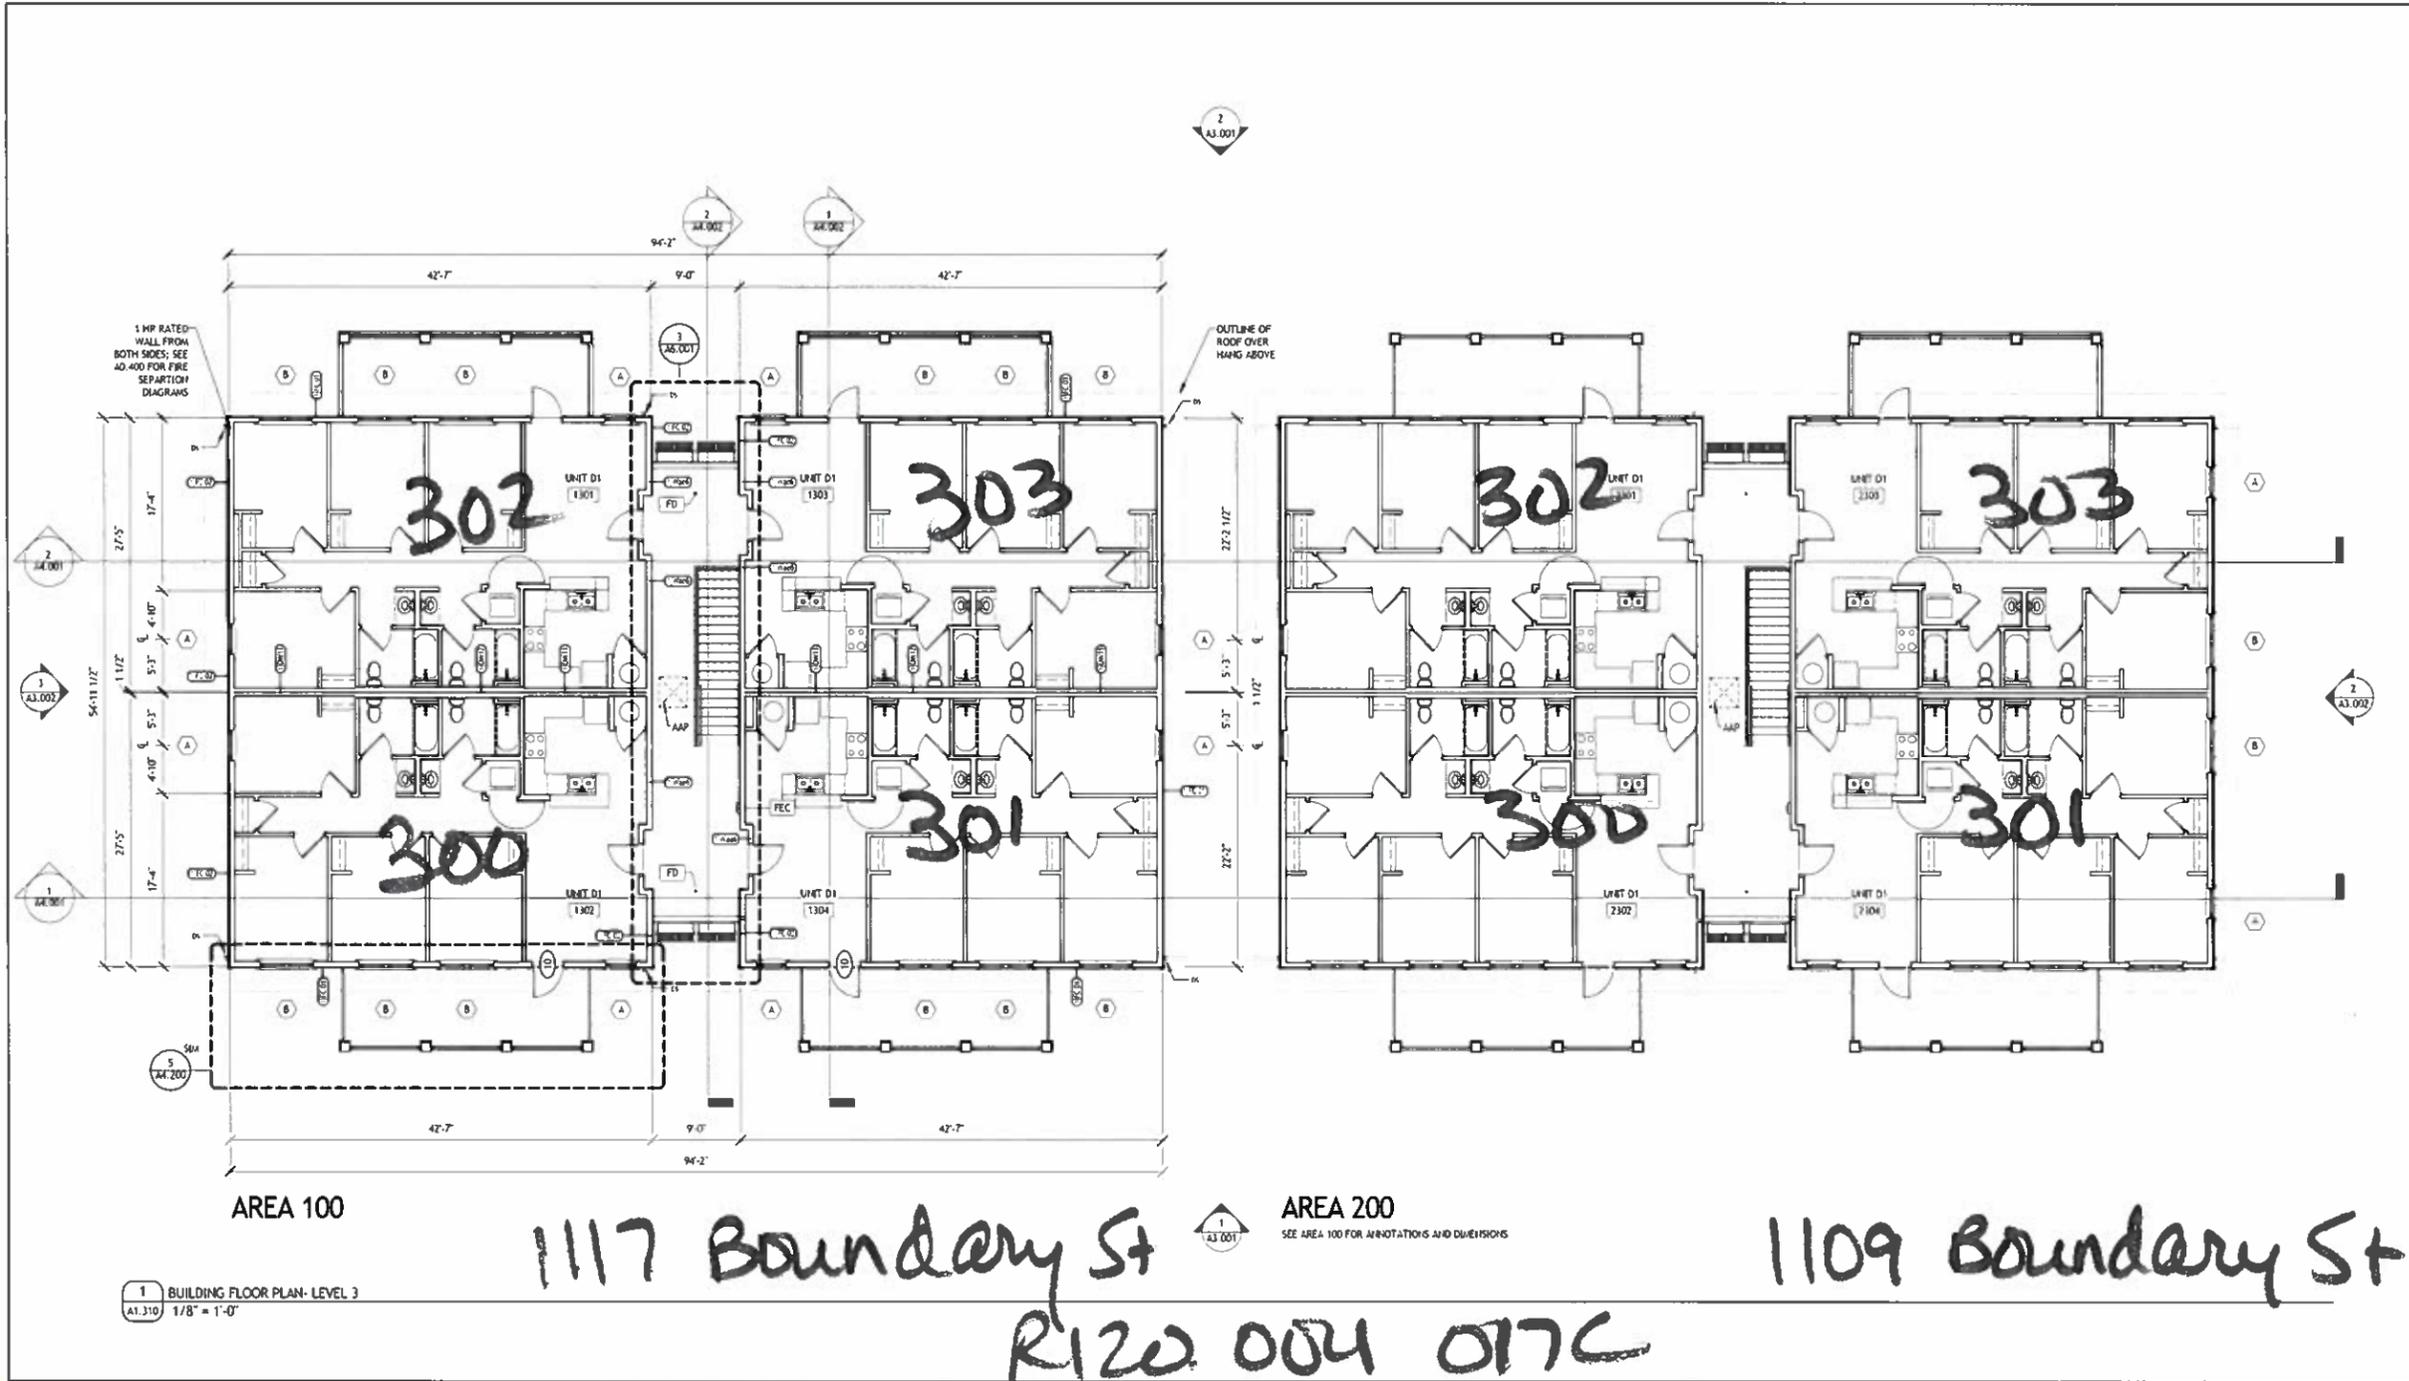

FLOOR PLAN NOTES

- SEE CIVIL ENGINEER'S DRAWINGS FOR SITE WORK AND SIDEWALK DETAILS. 2) MAX SLOPE AT EXTERIOR DOOR LOCATIONS.
- SEE LIFE SAFETY PLANS FOR WALL RATINGS AND GENERAL NOTES.
- SEE AS-00 FOR ACCESSIBILITY REQUIREMENTS, MINIMUM CLEARANCES, AND MOUNTING HEIGHTS.
- REFER TO UNIT PLANS FOR UNIT DIMENSIONS AND ACCESSIBILITY INFORMATION.
- DOOR ARE 4\" FROM STRUCTURE OR CENTER IN THE HOST WALL UNLESS DIMENSIONED OTHERWISE.
- REFER TO THE A6 SERIES DRAWINGS FOR ALL STAIR INFORMATION.
- ALL DOOR HARDWARE IS TO BE COORDINATED WITH THE CODE REQUIRED EGRESS COMPONENTS, ACCESSIBILITY REQUIREMENTS, AND ACCESS CONTROL REQUIREMENTS PER THE LOW VOLTAGE DRAWINGS.
- ACCESS CONTROL FOR ALL DOORS ARE TO BE COORDINATED WITH THE LOW VOLTAGE CONSULTANT, ARCHITECT, AND THE CLIENT.
- ALL SLABS ON GRADE TO RECEIVE VAPOR BARRIER, HARDENER AND BREATHABLE SEALERS.
- ANY WINDOW OR GLASS WITHIN A 24\" HORIZONTAL DISTANCE OF A DOOR SHALL HAVE TEMPERED GLAZING. ANY WINDOW OR GLAZING LESS THAN 18\" AFF SHALL BE TEMPERED. ANY WINDOW OR GLAZING WITHIN A BATHROOM SHALL BE TEMPERED.

13. REFER TO THE A5 SERIES DRAWINGS FOR INDIVIDUAL UNIT PLANS & DIMENSIONS.

14. ALL FIRE BARRIERS ARE TO BE LABELED WITH PERMANENT SIGNS OR STENCILING IN ALL CONCEALED SPACES INCLUDING ABOVE DECORATIVE CEILING. LETTERS TO BE 2\" HIGH UPRIGHT, ON A CONTRASTING BACKGROUND, SPACED 12\"-0\" (MAX) WITH A MINIMUM OF ONE PER WALL OR BARRIER. THE HOURLY RATING OF THE WALL OF BARRIER MUST BE INCLUDED.

LEGEND:

- UNITS W/ MOBILITY FEATURES
- UNITS W/ COMMUNICATION FEATURES
- FD- FLOOR DRAIN. MINIMUM SLOPE OF 1/8\" PER FOOT AND A MAX OF 2\".
- WINDOW TYPE
- PARTITION DESIGNATION SEE G0.00
- DOOR DESIGNATION (SEE DOOR SCHEDULE AB.101)
- DS - DOWNSPOUT LOCATION

C:\TEMP\117052\USCH-ARCH-R16_07_17\area02.rvt
1/28/2018 2:49:13 PM